

## Basic performance data - WAMAK BW 19 EVI

Heating - EN 14511		
Heating capacity [kW]	B0 / W35 (max)	19.5
	B0 / W35 (min)	19.5
	B0 / W34	19.5
Electrical power input [kW]	B0 / W35 (max)	4.3
	B0 / W35 (min)	4.3
	B0 / W34	4.2
Heating efficiency faktor [COP]	B0 / W35 (max)	4.50
	B0 / W35 (min)	4.50
	B0 / W34	4.60
Seasonal space heating energy efficiency - SCOP EN 14825		
Average Climate / Low Temperature [35 °C]	SCOP	5.07
	$\eta$ [ % ]	202.6
	Label	A+++
	Qhe [ kWh ]	7912.8
	Pdesignh [ kW ]	19.5
	Tbivalent [ °C ]	-10
Cooling		
Cooling capacity - [kW]	A35 / W23-18	19.9
	A25 / W23-18	20.9
	A35 / W12-7	19.9
	A25 / W12-7	19.9
Seasonal space cooling energy efficiency - SEER EN 14825		
[ W 23 / 18 °C ]	SEER	5.28
	Qce [ kWh ]	2107.5
	$\eta_c$ [ % ]	211.3
Sound EN 12102		
Acoustic power - Lw	dB(A)	47.1
Acoustic pressure - Lp	1 m dB(A)	39.1
	5 m dB(A)	25.1
	10 m dB(A)	19.1
Mechanical and operational information		
Compressor type (3~ 400/50)	SCROLL / 1 /	On/Off
Refrigerant	R410A (GWP - 2088)	3 kg
Operating limit temperatures heating - (min / max ) [°C]		25 / <b>65</b>
Operating limit temperatures source - (min / max ) [°C]		<b>-10 (7)</b> / 30
Weight		180 kg

## Main technical data - WAMAK BW 19 EVI

Enclosure type		VN800		Heat energy rejection side data				
Basic dimensions	Height [mm]	1270		Operating limit temperatures heating	MAX [°C]	65		
	Width [mm]	850			MIN [°C]	25		
	Length [mm]	630		for more see operating limits diagram				
Weight [kg]	180		Condenser	Port size	1.1/4 "			
Colour	Gray			Type	BPHE			
Enclosure IP Class	IP20			Count	1			
Refrigeration cycle				Material	AISI 316			
Compressor	Type	Scroll		Maximal operating pressure - refrigerant [bar]			45	
	Number of stages	1		Maximal operating pressure - Water [bar]			6	
	On/Off			Testing pressure [bar]			70	
	Power factor Cosφ	0.64		Heat transfer medium			Water	
	Winding resistance	1.79 Ohm		Volume flow @ dT 5K (nom) - Water [m3/h]			3.36	
Refrigerant		R410A		Internal pressure drop - Water [kPa]			12	
	Volme	3 kg		ECM speed circulator - condenser			UPMXL GEO 32-125	
	GWP	2088		Flow sensor consumer - analogue			0..10V	
	Safety class	A1		Temperature difference	@ 35°C (nom)	5 K		
Refrigeration oil type	POE RL32-3MAF		@ 55°C		8 K			
	Oil volume	1.24 L			@ 65°C	10 K		
Maximal pressure - refrigerant [bar]	45		Renewable energy extraction side data					
	PED class	1		Operating limit temperatures source	MIN [°C]	-10 (7)		
EVI - vapour injection with economizer			for more see operating limits diagram					
Electrical connection data			Evaporator	Port size	1.1/2 "			
Line voltage [#~ V/Hz]	3~ 400/50			Type	BPHE			
	Current	nominal [A]		9.32		Count	1	
		maximal [A]		16.00		Material	AISI 316	
	starting [A]	18.9		Maximal operating pressure - refrigerant [bar]			28	
Softstart	MCI 15		Heat transfer medium				Ethylenglykol	
Main safety	C25		Brine proportion [%]				29	
Control System			Antifreeze to [°C]				-15	
Main controller	SIEMENS	RVS 21	AVS 55.199	Maximal operating pressure - Ethylenglykol [bar]			6	
Extension module	AVS75.391	AVS75.391	AVS75.3xx	Volume flow - Ethylenglykol [m3/h]			4.60	
		LPB OCI346	Modbus OCI352	Internal pressure drop - Ethylenglykol [kPa]			12	
Bus Clip-In		Web server OZW672	ToSyMo	Temperature difference - Ethylenglykol			3 K	
Online connection				ECM speed circulator - evaporator			UPMXL GEO 32-125	
*** with accessory								

# WAMAK BW 19 EVI

## ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	BW 19 EVI
Air-to-water heat pump	no
Brine-to-water heat pump	yes
Water-to-water heat pump	no
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	low (35°C - 30°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	19.5	kW	Seasonal space heating energy efficiency	$\eta_s$	202.6	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	19.5	kW	Tj = -7 °C	COPd	4.60	-
Tj = +2 °C	Pdh	19.4	kW	Tj = +2 °C	COPd	5.0	-
Tj = +7 °C	Pdh	19.3	kW	Tj = +7 °C	COPd	5.4	-
Tj = +12 °C	Pdh	19.3	kW	Tj = +12 °C	COPd	5.7	-
Tj = bivalent temperature	Pdh	19.5	kW	Tj = bivalent temperature	COPd	4.5	-
Tj = operation limit temperature	Pdh	---	kW	Tj = operation limit temperature	COPd	---	-
Bivalent temperature	Tbiv	-10	°C	Tj = operation limit temperature	TOL	---	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	65	°C
Off mode	Poff	0.010	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	3.8	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.000	kW	For air-to-water heat pumps: Rated air flow rate, outdoors			
Other items				For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Capacity control	fixed						
Sound power level							
indoors	Lwa	47	dB				
outdoors	Lwa	---	dB				
Annual energy consumption	Q <sub>HE</sub>	7912.8	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk

# WAMAK BW 19 EVI

## ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	BW 19 EVI
Air-to-water heat pump	no
Brine-to-water heat pump	yes
Water-to-water heat pump	no
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	middle (55°C - 47°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	20.3	kW	Seasonal space heating energy efficiency	$\eta_s$	160.7	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	20.3	kW	Tj = -7 °C	COPd	3.27	-
Tj = +2 °C	Pdh	20.1	kW	Tj = +2 °C	COPd	4.2	-
Tj = +7 °C	Pdh	19.7	kW	Tj = +7 °C	COPd	4.7	-
Tj = +12 °C	Pdh	19.6	kW	Tj = +12 °C	COPd	5.1	-
Tj = bivalent temperature	Pdh	20.3	kW	Tj = bivalent temperature	COPd	2.9	-
Tj = operation limit temperature	Pdh	---	kW	Tj = operation limit temperature	COPd	---	-
Bivalent temperature	Tbiv	-10	°C	Tj = operation limit temperature	TOL	---	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	65	°C
Off mode	Poff	0.010	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	3.8	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.000	kW	For air-to-water heat pumps:			
Other items				Rated air flow rate, outdoors	-	---	m <sup>3</sup> /h
Capacity control	fixed			For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Sound power level							
indoors	Lwa	47	dB				
outdoors	Lwa	---	dB				
Annual energy consumption	Q <sub>HE</sub>	10400.3	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk



**ENERG** Y IIA  
 енергия - ενεργεια IE IA

**WAMAK**

BW 19 EVI



55 °C

35 °C



**A+++**

**A+++**



47 dB



--- dB

■ 22  
 ■ 21  
 ■ 20  
 kW

■ 20  
 ■ 20  
 ■ 19  
 kW



2019

811/2013

BW 19 EVI

**ErP Data**

	55 °C	35 °C
Energy class	<b>A+++</b>	<b>A+++</b>
$\eta$ [%]	160.7	202.6
$P_{rated}$ [kW]	21	20
$Q_{HE}$ [kWh/y]	10401	7913
SCOP [-]	4.02	5.07
$T_{bivalent}$ [°C]	-10	-10

CONTROLLER



+ QAA55/75  
 - QAA55/75

class VII  
 class III

3.5% ↓  
 1.5% ↓

Heating performance data

Version: v2024.010-BW-WW

Source - Brine [0°C] / Low Temperature [35°C]

ZHI18K1P-TFM\_R410A\_1\_BWW

Operating conditions		Qh	P	COP
1	B0 / W30-35	19.5	4.3	4.50
2	B0 / W30-35 ( MIN )	19.5	4.3	4.50
A	B0 / Wxx-34	19.5	4.2	4.60
B	B0 / Wxx-30	19.4	3.9	5.02
C	B0 / Wxx-27	19.3	3.6	5.36
D	B0 / Wxx-24	19.3	3.4	5.70
E	B0 / Wxx-35	19.5	4.3	4.50
F	B0 / Wxx-35	19.5	4.3	4.50

SCOP DATA EN 14825:2018	
Source - Brine [0°C] / Low Temperature [35°C]	
SCOPon	5.09
SCOPnet	5.09
SCOP	5.07
η [ % ]	202.63
Label	A+++
Qh [ kWh ]	7913
Pdesignh [ kW ]	19.5
Tbivalent [ °C ]	-10

Source - Brine [0°C] / Medium Temperature [55°C]

Operating conditions		Qh	P	COP
1	B0 / W47-55	20.3	7.1	2.86
2	B0 / W47-55 ( MIN )	20.3	6.9	2.86
A	B0 / Wxx-52	20.3	6.4	3.27
B	B0 / Wxx-42	20.1	4.9	4.17
C	B0 / Wxx-36	19.7	4.3	4.61
D	B0 / Wxx-30	19.6	3.9	5.09
E	B0 / Wxx-55	20.3	7.1	2.86
F	B0 / Wxx-54	20.3	6.6	3.09

SCOP DATA EN 14825:2018	
Source - Brine [0°C] / Medium Temperature [55°C]	
SCOPon	4.03
SCOPnet	4.03
SCOP	4.02
η [ % ]	160.68
Label	A+++
Qh [ kWh ]	10400
Pdesignh [ kW ]	20.3
Tbivalent [ °C ]	-10

Source - Water [10°C] / Low Temperature [35°C]

Operating conditions		Qh	P	COP
1	W10 / W30-35	24.7	4.3	5.76
2	W10 / W30-35 ( MIN )	24.7	4.3	5.76
A	W10 / Wxx-34	24.7	4.2	5.89
B	W10 / Wxx-30	24.7	3.8	6.45
C	W10 / Wxx-27	24.8	3.6	6.87
D	W10 / Wxx-24	24.8	3.4	7.30
E	W10 / Wxx-35	24.7	4.3	5.76
F	W10 / Wxx-35	24.7	4.3	5.76

SCOP DATA EN 14825:2018	
Source - Water [10°C] / Low Temperature [35°C]	
SCOPon	6.53
SCOPnet	6.53
SCOP	6.50
η [ % ]	259.82
Label	A+++
Qh [ kWh ]	7816
Pdesignh [ kW ]	24.7
Tbivalent [ °C ]	-10.00

**Source - Water [10°C] / Medium Temperature [55°C]**

	Operating conditions	Qh	P	COP
1	W10 / W47-55	25.1	7.1	3.53
2	W10 / W47-55 ( MIN )	25.1	7.1	3.53
A	W10 / Wxx-52	25.2	6.4	3.94
B	W10 / Wxx-42	25.0	4.8	5.17
C	W10 / Wxx-36	25.0	4.2	5.89
D	W10 / Wxx-30	25.0	3.8	6.52
E	W10 / Wxx-55	25.1	7.1	3.53
F	W10 / Wxx-55	25.1	7.1	3.53

SCOP DATA EN 14825:2018	
<b>Source - Water [10°C] / Medium Temperature [55°C]</b>	
SCOPon	4.97
SCOPnet	4.97
SCOP	4.95
η [ % ]	197.93
Label	A+++
Qh [ kWh ]	10439
Pdesignh [ kW ]	25.1
Tbivalent [ °C ]	-10.00

**Low temperature cooling W 12 / 7°C**

	Operating conditions	Qc	P	EER
A	W30-35 / W12-7	15.2	4.6	3.27
B	W26-xx / W12-7	15.5	4.2	3.67
C	W22-xx / W12-7	15.8	3.9	4.09
D	W18-xx / W12-7	15.9	3.7	4.31

SEER DATA EN 14825:2018 [ W 12 / 7°C ]	
SEERon	3.96
SEER	3.95
Qc [ kWh ]	8880
η [ % ]	157.86


**Radiant cooling W 23 / 18°C**

	Operating conditions	Qc	P	EER
A	W50-xx / W23-18	18.1	7.6	2.37
B	W40-xx / W23-18	19.3	5.9	3.25
C	W30-35 / W23-18	20.4	4.6	4.39
D	W26-xx / W23-18	20.8	4.2	4.91

SEER DATA EN 14825:2018 [ W 23 / 18°C ]	
SEERon	5.30
SEER	5.28
Qc [ kWh ]	8880
η [ % ]	211.30


Performance lines - heating

- Qh-nom-35
- Qh-min-35
- Qh-max-65
- Qh-nom-45
- Qh-nom-55
- Qh-nom-65

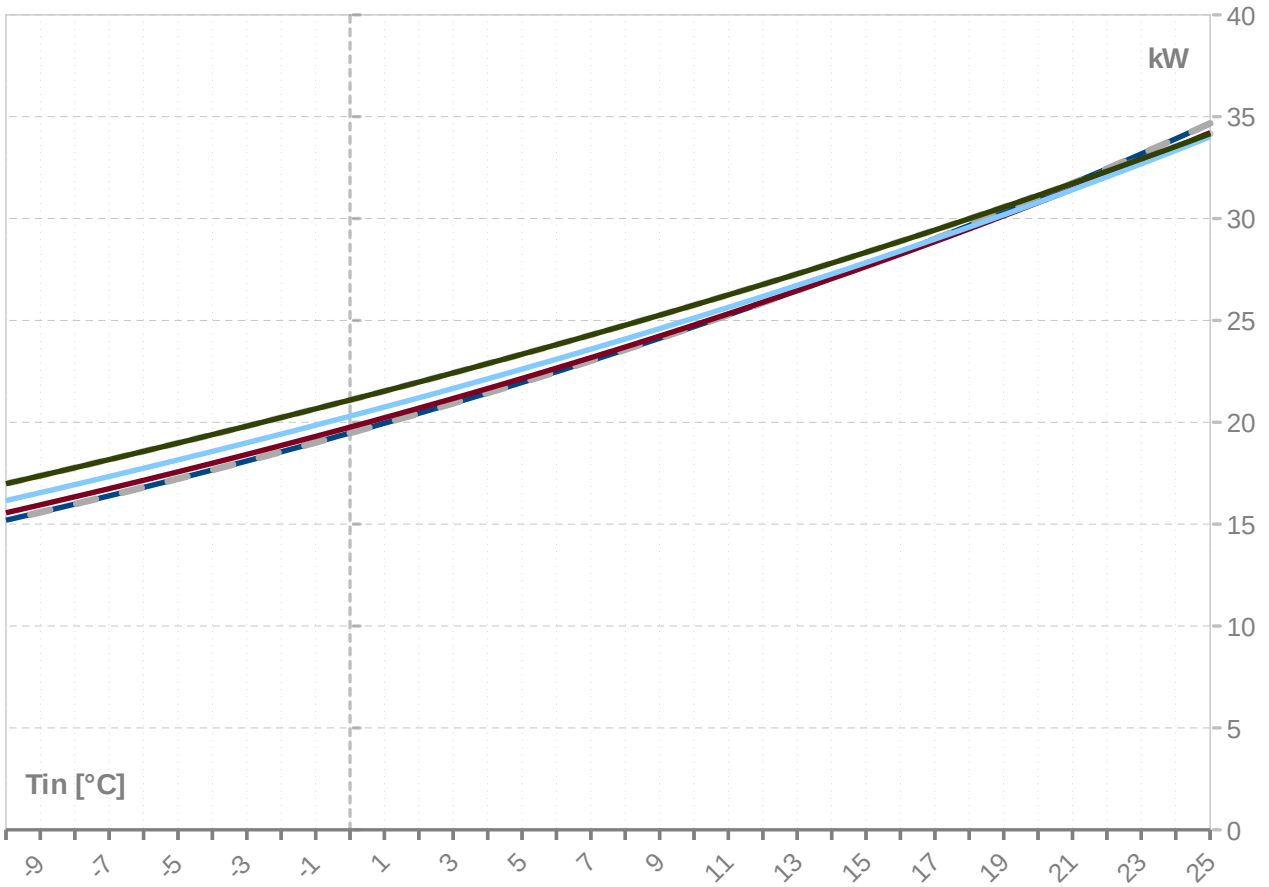

Performance lines - cooling

- Qc-nom-12-7
- Qc-nom-23-18

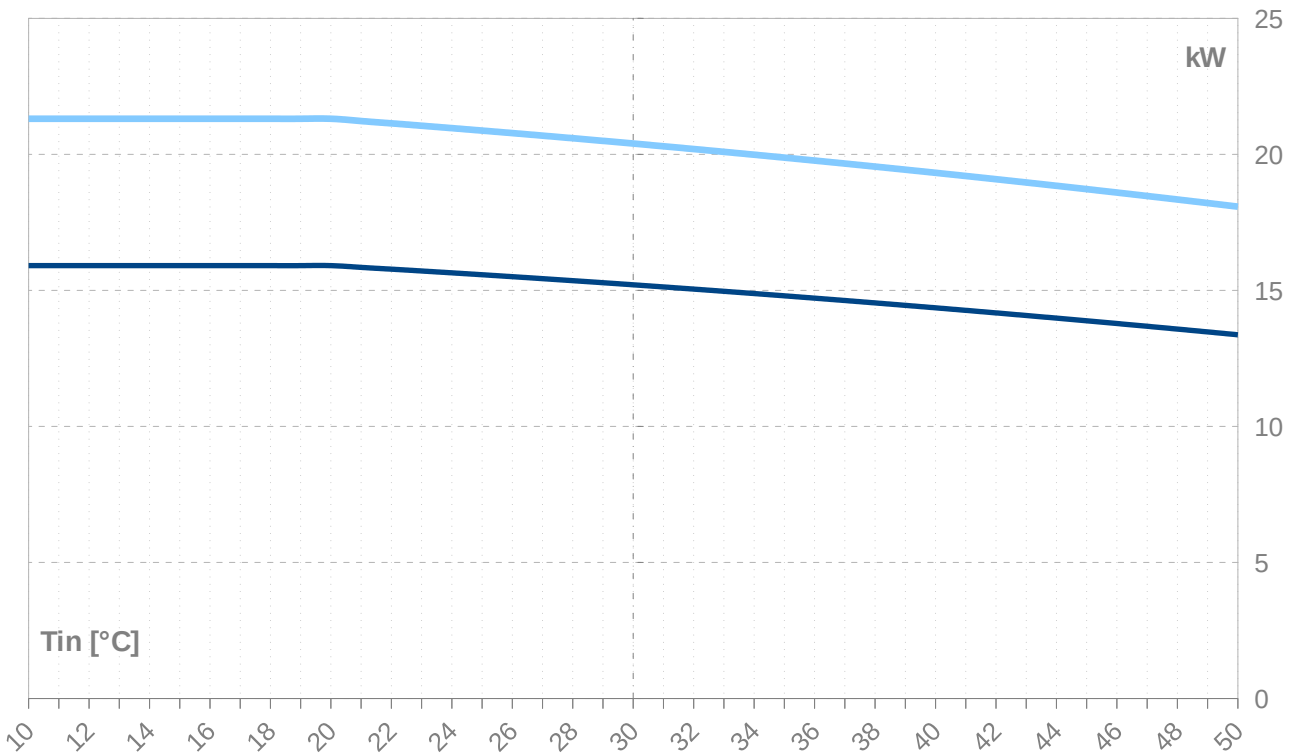

Th -OU		35										
Ts -IN	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
25	<b>34.7</b>	34.7	34.7	<b>4.3</b>	4.3	4.3	<b>8.10</b>	30.7	30.7	30.7	9.3	
24	<b>33.9</b>	33.9	33.9	<b>4.3</b>	4.3	4.3	<b>7.93</b>	29.9	29.9	29.9	9.3	
23	<b>33.2</b>	33.2	33.2	<b>4.3</b>	4.3	4.3	<b>7.76</b>	29.2	29.2	29.2	9.3	
22	<b>32.4</b>	32.4	32.4	<b>4.3</b>	4.3	4.3	<b>7.60</b>	28.5	28.5	28.5	9.3	
21	<b>31.7</b>	31.7	31.7	<b>4.3</b>	4.3	4.3	<b>7.43</b>	27.7	27.7	27.7	9.3	
20	<b>31.0</b>	31.0	31.0	<b>4.3</b>	4.3	4.3	<b>7.27</b>	27.0	27.0	27.0	9.3	
19	<b>30.3</b>	30.3	30.3	<b>4.3</b>	4.3	4.3	<b>7.11</b>	26.4	26.4	26.4	9.3	
18	<b>29.7</b>	29.7	29.7	<b>4.3</b>	4.3	4.3	<b>6.95</b>	25.7	25.7	25.7	9.3	
17	<b>29.0</b>	29.0	29.0	<b>4.3</b>	4.3	4.3	<b>6.79</b>	25.0	25.0	25.0	9.3	
16	<b>28.3</b>	28.3	28.3	<b>4.3</b>	4.3	4.3	<b>6.64</b>	24.4	24.4	24.4	9.3	
15	<b>27.7</b>	27.7	27.7	<b>4.3</b>	4.3	4.3	<b>6.48</b>	23.7	23.7	23.7	9.3	
14	<b>27.1</b>	27.1	27.1	<b>4.3</b>	4.3	4.3	<b>6.33</b>	23.1	23.1	23.1	9.3	
13	<b>26.5</b>	26.5	26.5	<b>4.3</b>	4.3	4.3	<b>6.18</b>	22.5	22.5	22.5	9.3	
12	<b>25.9</b>	25.9	25.9	<b>4.3</b>	4.3	4.3	<b>6.04</b>	21.9	21.9	21.9	9.3	
11	<b>25.3</b>	25.3	25.3	<b>4.3</b>	4.3	4.3	<b>5.90</b>	21.3	21.3	21.3	9.3	
10	<b>24.7</b>	24.7	24.7	<b>4.3</b>	4.3	4.3	<b>5.76</b>	20.7	20.7	20.7	9.4	
9	<b>24.1</b>	24.1	24.1	<b>4.3</b>	4.3	4.3	<b>5.62</b>	20.1	20.1	20.1	9.4	
8	<b>23.6</b>	23.6	23.6	<b>4.3</b>	4.3	4.3	<b>5.48</b>	19.6	19.6	19.6	9.4	
7	<b>23.0</b>	23.0	23.0	<b>4.3</b>	4.3	4.3	<b>5.35</b>	19.0	19.0	19.0	9.4	
6	<b>22.5</b>	22.5	22.5	<b>4.3</b>	4.3	4.3	<b>5.22</b>	18.5	18.5	18.5	9.4	
5	<b>22.0</b>	22.0	22.0	<b>4.3</b>	4.3	4.3	<b>5.09</b>	17.9	17.9	17.9	9.4	
4	<b>21.4</b>	21.4	21.4	<b>4.3</b>	4.3	4.3	<b>4.97</b>	17.4	17.4	17.4	9.4	
3	<b>20.9</b>	20.9	20.9	<b>4.3</b>	4.3	4.3	<b>4.85</b>	16.9	16.9	16.9	9.4	
2	<b>20.4</b>	20.4	20.4	<b>4.3</b>	4.3	4.3	<b>4.73</b>	16.4	16.4	16.4	9.4	
1	<b>20.0</b>	20.0	20.0	<b>4.3</b>	4.3	4.3	<b>4.61</b>	15.9	15.9	15.9	9.4	
0	<b>19.5</b>	19.5	19.5	<b>4.3</b>	4.3	4.3	<b>4.50</b>	15.4	15.4	15.4	9.4	
-1	<b>19.0</b>	19.0	19.0	<b>4.3</b>	4.3	4.3	<b>4.39</b>	15.0	15.0	15.0	9.4	
-2	<b>18.5</b>	18.5	18.5	<b>4.3</b>	4.3	4.3	<b>4.28</b>	14.5	14.5	14.5	9.4	
-3	<b>18.1</b>	18.1	18.1	<b>4.3</b>	4.3	4.3	<b>4.17</b>	14.0	14.0	14.0	9.4	
-4	<b>17.7</b>	17.7	17.7	<b>4.3</b>	4.3	4.3	<b>4.07</b>	13.6	13.6	13.6	9.4	
-5	<b>17.2</b>	17.2	17.2	<b>4.3</b>	4.3	4.3	<b>3.97</b>	13.2	13.2	13.2	9.4	
-6	<b>16.8</b>	16.8	16.8	<b>4.3</b>	4.3	4.3	<b>3.87</b>	12.7	12.7	12.7	9.4	
-7	<b>16.4</b>	16.4	16.4	<b>4.3</b>	4.3	4.3	<b>3.77</b>	12.3	12.3	12.3	9.4	
-8	<b>16.0</b>	16.0	16.0	<b>4.3</b>	4.3	4.3	<b>3.68</b>	11.9	11.9	11.9	9.4	
-9	<b>15.6</b>	15.6	15.6	<b>4.3</b>	4.3	4.3	<b>3.59</b>	11.5	11.5	11.5	9.4	
-10	<b>15.2</b>	15.2	15.2	<b>4.3</b>	4.3	4.3	<b>3.50</b>	11.1	11.1	11.1	9.4	
-11	<b>14.8</b>	14.8	14.8	<b>4.3</b>	4.3	4.3	<b>3.41</b>	10.8	10.8	10.8	9.4	
-12	<b>14.4</b>	14.4	14.4	<b>4.3</b>	4.3	4.3	<b>3.33</b>	10.4	10.4	10.4	9.4	
-13	<b>14.1</b>	14.1	14.1	<b>4.3</b>	4.3	4.3	<b>3.25</b>	10.0	10.0	10.0	9.4	
-14	<b>13.7</b>	13.7	13.7	<b>4.3</b>	4.3	4.3	<b>3.17</b>	9.7	9.7	9.7	9.4	
-15	<b>13.3</b>	13.3	13.3	<b>4.3</b>	4.3	4.3	<b>3.09</b>	9.3	9.3	9.3	9.4	

-- attention: operating limits not reflected in performance table

ZHI18K1P-TFM\_R410A\_1\_BWW

Th -OU	45										
[°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin min [kW]	Pin max [kW]	COP nom kW / kW	Qc nom [kW]	Qc min [kW]	Qc max [kW]	I nom [A]
25	<b>34.2</b>	34.2	34.2	<b>5.3</b>	5.3	5.3	<b>6.43</b>	29.2	29.2	29.2	10.4
24	<b>33.5</b>	33.5	33.5	<b>5.3</b>	5.3	5.3	<b>6.29</b>	28.5	28.5	28.5	10.4
23	<b>32.8</b>	32.8	32.8	<b>5.3</b>	5.3	5.3	<b>6.15</b>	27.8	27.8	27.8	10.4
22	<b>32.1</b>	32.1	32.1	<b>5.3</b>	5.3	5.3	<b>6.02</b>	27.1	27.1	27.1	10.4
21	<b>31.4</b>	31.4	31.4	<b>5.3</b>	5.3	5.3	<b>5.88</b>	26.5	26.5	26.5	10.4
20	<b>30.8</b>	30.8	30.8	<b>5.4</b>	5.4	5.4	<b>5.75</b>	25.8	25.8	25.8	10.4
19	<b>30.1</b>	30.1	30.1	<b>5.4</b>	5.4	5.4	<b>5.62</b>	25.1	25.1	25.1	10.4
18	<b>29.5</b>	29.5	29.5	<b>5.4</b>	5.4	5.4	<b>5.50</b>	24.5	24.5	24.5	10.4
17	<b>28.9</b>	28.9	28.9	<b>5.4</b>	5.4	5.4	<b>5.37</b>	23.8	23.8	23.8	10.4
16	<b>28.2</b>	28.2	28.2	<b>5.4</b>	5.4	5.4	<b>5.25</b>	23.2	23.2	23.2	10.4
15	<b>27.6</b>	27.6	27.6	<b>5.4</b>	5.4	5.4	<b>5.13</b>	22.6	22.6	22.6	10.5
14	<b>27.0</b>	27.0	27.0	<b>5.4</b>	5.4	5.4	<b>5.02</b>	22.0	22.0	22.0	10.5
13	<b>26.5</b>	26.5	26.5	<b>5.4</b>	5.4	5.4	<b>4.90</b>	21.4	21.4	21.4	10.5
12	<b>25.9</b>	25.9	25.9	<b>5.4</b>	5.4	5.4	<b>4.79</b>	20.8	20.8	20.8	10.5
11	<b>25.3</b>	25.3	25.3	<b>5.4</b>	5.4	5.4	<b>4.68</b>	20.3	20.3	20.3	10.5
10	<b>24.8</b>	24.8	24.8	<b>5.4</b>	5.4	5.4	<b>4.57</b>	19.7	19.7	19.7	10.5
9	<b>24.2</b>	24.2	24.2	<b>5.4</b>	5.4	5.4	<b>4.47</b>	19.2	19.2	19.2	10.5
8	<b>23.7</b>	23.7	23.7	<b>5.4</b>	5.4	5.4	<b>4.37</b>	18.6	18.6	18.6	10.5
7	<b>23.2</b>	23.2	23.2	<b>5.4</b>	5.4	5.4	<b>4.27</b>	18.1	18.1	18.1	10.5
6	<b>22.7</b>	22.7	22.7	<b>5.4</b>	5.4	5.4	<b>4.17</b>	17.6	17.6	17.6	10.5
5	<b>22.2</b>	22.2	22.2	<b>5.4</b>	5.4	5.4	<b>4.07</b>	17.1	17.1	17.1	10.5
4	<b>21.7</b>	21.7	21.7	<b>5.4</b>	5.4	5.4	<b>3.98</b>	16.6	16.6	16.6	10.5
3	<b>21.2</b>	21.2	21.2	<b>5.4</b>	5.4	5.4	<b>3.89</b>	16.1	16.1	16.1	10.5
2	<b>20.7</b>	20.7	20.7	<b>5.4</b>	5.4	5.4	<b>3.80</b>	15.6	15.6	15.6	10.5
1	<b>20.2</b>	20.2	20.2	<b>5.4</b>	5.4	5.4	<b>3.71</b>	15.1	15.1	15.1	10.5
0	<b>19.8</b>	19.8	19.8	<b>5.4</b>	5.4	5.4	<b>3.63</b>	14.7	14.7	14.7	10.5
-1	<b>19.3</b>	19.3	19.3	<b>5.4</b>	5.4	5.4	<b>3.54</b>	14.2	14.2	14.2	10.5
-2	<b>18.9</b>	18.9	18.9	<b>5.4</b>	5.4	5.4	<b>3.46</b>	13.8	13.8	13.8	10.5
-3	<b>18.4</b>	18.4	18.4	<b>5.4</b>	5.4	5.4	<b>3.38</b>	13.3	13.3	13.3	10.5
-4	<b>18.0</b>	18.0	18.0	<b>5.4</b>	5.4	5.4	<b>3.31</b>	12.9	12.9	12.9	10.5
-5	<b>17.6</b>	17.6	17.6	<b>5.4</b>	5.4	5.4	<b>3.23</b>	12.5	12.5	12.5	10.5
-6	<b>17.2</b>	17.2	17.2	<b>5.4</b>	5.4	5.4	<b>3.16</b>	12.1	12.1	12.1	10.5
-7	<b>16.7</b>	16.7	16.7	<b>5.4</b>	5.4	5.4	<b>3.09</b>	11.7	11.7	11.7	10.5
-8	<b>16.3</b>	16.3	16.3	<b>5.4</b>	5.4	5.4	<b>3.02</b>	11.3	11.3	11.3	10.5
-9	<b>15.9</b>	15.9	15.9	<b>5.4</b>	5.4	5.4	<b>2.95</b>	10.9	10.9	10.9	10.5
-10	<b>15.6</b>	15.6	15.6	<b>5.4</b>	5.4	5.4	<b>2.88</b>	10.5	10.5	10.5	10.5
-11	<b>15.2</b>	15.2	15.2	<b>5.4</b>	5.4	5.4	<b>2.82</b>	10.1	10.1	10.1	10.5
-12	<b>14.8</b>	14.8	14.8	<b>5.4</b>	5.4	5.4	<b>2.75</b>	9.8	9.8	9.8	10.5
-13	<b>14.4</b>	14.4	14.4	<b>5.4</b>	5.4	5.4	<b>2.69</b>	9.4	9.4	9.4	10.4
-14	<b>14.1</b>	14.1	14.1	<b>5.3</b>	5.3	5.3	<b>2.63</b>	9.1	9.1	9.1	10.4
-15	<b>13.7</b>	13.7	13.7	<b>5.3</b>	5.3	5.3	<b>2.57</b>	8.7	8.7	8.7	10.4

-- attention: operating limits not reflected in performance table

Th -OU		55										
	[°C]											
Ts -IN	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
25	<b>34.0</b>	34.0	34.0	<b>7.0</b>	7.0	7.0	<b>4.85</b>	27.5	27.5	27.5	12.3	
24	<b>33.3</b>	33.3	33.3	<b>7.0</b>	7.0	7.0	<b>4.75</b>	26.8	26.8	26.8	12.3	
23	<b>32.7</b>	32.7	32.7	<b>7.0</b>	7.0	7.0	<b>4.65</b>	26.1	26.1	26.1	12.3	
22	<b>32.0</b>	32.0	32.0	<b>7.0</b>	7.0	7.0	<b>4.55</b>	25.5	25.5	25.5	12.3	
21	<b>31.4</b>	31.4	31.4	<b>7.1</b>	7.1	7.1	<b>4.46</b>	24.8	24.8	24.8	12.3	
20	<b>30.8</b>	30.8	30.8	<b>7.1</b>	7.1	7.1	<b>4.36</b>	24.2	24.2	24.2	12.3	
19	<b>30.2</b>	30.2	30.2	<b>7.1</b>	7.1	7.1	<b>4.27</b>	23.6	23.6	23.6	12.4	
18	<b>29.6</b>	29.6	29.6	<b>7.1</b>	7.1	7.1	<b>4.18</b>	23.0	23.0	23.0	12.4	
17	<b>29.0</b>	29.0	29.0	<b>7.1</b>	7.1	7.1	<b>4.09</b>	22.4	22.4	22.4	12.4	
16	<b>28.4</b>	28.4	28.4	<b>7.1</b>	7.1	7.1	<b>4.01</b>	21.8	21.8	21.8	12.4	
15	<b>27.8</b>	27.8	27.8	<b>7.1</b>	7.1	7.1	<b>3.92</b>	21.2	21.2	21.2	12.4	
14	<b>27.3</b>	27.3	27.3	<b>7.1</b>	7.1	7.1	<b>3.84</b>	20.6	20.6	20.6	12.4	
13	<b>26.7</b>	26.7	26.7	<b>7.1</b>	7.1	7.1	<b>3.76</b>	20.1	20.1	20.1	12.4	
12	<b>26.2</b>	26.2	26.2	<b>7.1</b>	7.1	7.1	<b>3.68</b>	19.5	19.5	19.5	12.4	
11	<b>25.6</b>	25.6	25.6	<b>7.1</b>	7.1	7.1	<b>3.60</b>	19.0	19.0	19.0	12.4	
10	<b>25.1</b>	25.1	25.1	<b>7.1</b>	7.1	7.1	<b>3.53</b>	18.5	18.5	18.5	12.4	
9	<b>24.6</b>	24.6	24.6	<b>7.1</b>	7.1	7.1	<b>3.45</b>	18.0	18.0	18.0	12.4	
8	<b>24.1</b>	24.1	24.1	<b>7.1</b>	7.1	7.1	<b>3.38</b>	17.4	17.4	17.4	12.4	
7	<b>23.6</b>	23.6	23.6	<b>7.1</b>	7.1	7.1	<b>3.31</b>	16.9	16.9	16.9	12.4	
6	<b>23.1</b>	23.1	23.1	<b>7.1</b>	7.1	7.1	<b>3.24</b>	16.4	16.4	16.4	12.4	
5	<b>22.6</b>	22.6	22.6	<b>7.1</b>	7.1	7.1	<b>3.18</b>	16.0	16.0	16.0	12.4	
4	<b>22.1</b>	22.1	22.1	<b>7.1</b>	7.1	7.1	<b>3.11</b>	15.5	15.5	15.5	12.4	
3	<b>21.7</b>	21.7	21.7	<b>7.1</b>	7.1	7.1	<b>3.05</b>	15.0	15.0	15.0	12.4	
2	<b>21.2</b>	21.2	21.2	<b>7.1</b>	7.1	7.1	<b>2.99</b>	14.6	14.6	14.6	12.4	
1	<b>20.7</b>	20.7	20.7	<b>7.1</b>	7.1	7.1	<b>2.92</b>	14.1	14.1	14.1	12.4	
0	<b>20.3</b>	20.3	20.3	<b>7.1</b>	7.1	7.1	<b>2.86</b>	13.7	13.7	13.7	12.4	
-1	<b>19.9</b>	19.9	19.9	<b>7.1</b>	7.1	7.1	<b>2.81</b>	13.2	13.2	13.2	12.4	
-2	<b>19.4</b>	19.4	19.4	<b>7.1</b>	7.1	7.1	<b>2.75</b>	12.8	12.8	12.8	12.3	
-3	<b>19.0</b>	19.0	19.0	<b>7.1</b>	7.1	7.1	<b>2.69</b>	12.4	12.4	12.4	12.3	
-4	<b>18.6</b>	18.6	18.6	<b>7.0</b>	7.0	7.0	<b>2.64</b>	12.0	12.0	12.0	12.3	
-5	<b>18.2</b>	18.2	18.2	<b>7.0</b>	7.0	7.0	<b>2.59</b>	11.6	11.6	11.6	12.3	
-6	<b>17.7</b>	17.7	17.7	<b>7.0</b>	7.0	7.0	<b>2.53</b>	11.2	11.2	11.2	12.3	
-7	<b>17.3</b>	17.3	17.3	<b>7.0</b>	7.0	7.0	<b>2.48</b>	10.8	10.8	10.8	12.3	
-8	<b>16.9</b>	16.9	16.9	<b>7.0</b>	7.0	7.0	<b>2.43</b>	10.4	10.4	10.4	12.2	
-9	<b>16.5</b>	16.5	16.5	<b>6.9</b>	6.9	6.9	<b>2.39</b>	10.1	10.1	10.1	12.2	
-10	<b>16.2</b>	16.2	16.2	<b>6.9</b>	6.9	6.9	<b>2.34</b>	9.7	9.7	9.7	12.2	
-11	<b>15.8</b>	15.8	15.8	<b>6.9</b>	6.9	6.9	<b>2.29</b>	9.3	9.3	9.3	12.1	
-12	<b>15.4</b>	15.4	15.4	<b>6.9</b>	6.9	6.9	<b>2.25</b>	9.0	9.0	9.0	12.1	
-13	<b>15.0</b>	15.0	15.0	<b>6.8</b>	6.8	6.8	<b>2.20</b>	8.6	8.6	8.6	12.1	
-14	<b>14.7</b>	14.7	14.7	<b>6.8</b>	6.8	6.8	<b>2.16</b>	8.3	8.3	8.3	12.0	
-15	<b>14.3</b>	14.3	14.3	<b>6.8</b>	6.8	6.8	<b>2.11</b>	8.0	8.0	8.0	12.0	

-- attention: operating limits not reflected in performance table

Th -OU	65 (T-max)										
[°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin min [kW]	Pin max [kW]	COP nom kW / kW	Qc nom [kW]	Qc min [kW]	Qc max [kW]	I nom [A]
25	<b>34.2</b>	34.2	34.2	<b>9.2</b>	9.2	9.2	<b>3.71</b>	25.6	25.6	25.6	15.1
24	<b>33.5</b>	33.5	33.5	<b>9.2</b>	9.2	9.2	<b>3.63</b>	24.9	24.9	24.9	15.1
23	<b>32.9</b>	32.9	32.9	<b>9.2</b>	9.2	9.2	<b>3.56</b>	24.3	24.3	24.3	15.1
22	<b>32.3</b>	32.3	32.3	<b>9.2</b>	9.2	9.2	<b>3.50</b>	23.7	23.7	23.7	15.1
21	<b>31.7</b>	31.7	31.7	<b>9.3</b>	9.3	9.3	<b>3.43</b>	23.1	23.1	23.1	15.1
20	<b>31.1</b>	31.1	31.1	<b>9.3</b>	9.3	9.3	<b>3.36</b>	22.5	22.5	22.5	15.1
19	<b>30.6</b>	30.6	30.6	<b>9.3</b>	9.3	9.3	<b>3.30</b>	21.9	21.9	21.9	15.1
18	<b>30.0</b>	30.0	30.0	<b>9.3</b>	9.3	9.3	<b>3.24</b>	21.3	21.3	21.3	15.1
17	<b>29.4</b>	29.4	29.4	<b>9.3</b>	9.3	9.3	<b>3.17</b>	20.8	20.8	20.8	15.1
16	<b>28.9</b>	28.9	28.9	<b>9.3</b>	9.3	9.3	<b>3.11</b>	20.2	20.2	20.2	15.1
15	<b>28.3</b>	28.3	28.3	<b>9.3</b>	9.3	9.3	<b>3.06</b>	19.7	19.7	19.7	15.1
14	<b>27.8</b>	27.8	27.8	<b>9.3</b>	9.3	9.3	<b>3.00</b>	19.1	19.1	19.1	15.1
13	<b>27.3</b>	27.3	27.3	<b>9.3</b>	9.3	9.3	<b>2.94</b>	18.6	18.6	18.6	15.1
12	<b>26.8</b>	26.8	26.8	<b>9.3</b>	9.3	9.3	<b>2.89</b>	18.1	18.1	18.1	15.1
11	<b>26.3</b>	26.3	26.3	<b>9.3</b>	9.3	9.3	<b>2.83</b>	17.6	17.6	17.6	15.1
10	<b>25.8</b>	25.8	25.8	<b>9.3</b>	9.3	9.3	<b>2.78</b>	17.1	17.1	17.1	15.1
9	<b>25.3</b>	25.3	25.3	<b>9.2</b>	9.2	9.2	<b>2.73</b>	16.6	16.6	16.6	15.1
8	<b>24.8</b>	24.8	24.8	<b>9.2</b>	9.2	9.2	<b>2.68</b>	16.1	16.1	16.1	15.1
7	<b>24.3</b>	24.3	24.3	<b>9.2</b>	9.2	9.2	<b>2.63</b>	15.7	15.7	15.7	15.1
6	<b>23.8</b>	23.8	23.8	<b>9.2</b>	9.2	9.2	<b>2.58</b>	15.2	15.2	15.2	15.1
5	<b>23.3</b>	23.3	23.3	<b>9.2</b>	9.2	9.2	<b>2.54</b>	14.7	14.7	14.7	15.0
4	<b>22.9</b>	22.9	22.9	<b>9.2</b>	9.2	9.2	<b>2.49</b>	14.3	14.3	14.3	15.0
3	<b>22.4</b>	22.4	22.4	<b>9.2</b>	9.2	9.2	<b>2.45</b>	13.9	13.9	13.9	15.0
2	<b>22.0</b>	22.0	22.0	<b>9.2</b>	9.2	9.2	<b>2.40</b>	13.4	13.4	13.4	15.0
1	<b>21.5</b>	21.5	21.5	<b>9.1</b>	9.1	9.1	<b>2.36</b>	13.0	13.0	13.0	14.9
0	<b>21.1</b>	21.1	21.1	<b>9.1</b>	9.1	9.1	<b>2.32</b>	12.6	12.6	12.6	14.9
-1	<b>20.7</b>	20.7	20.7	<b>9.1</b>	9.1	9.1	<b>2.27</b>	12.2	12.2	12.2	14.9
-2	<b>20.2</b>	20.2	20.2	<b>9.1</b>	9.1	9.1	<b>2.23</b>	11.8	11.8	11.8	14.9
-3	<b>19.8</b>	19.8	19.8	<b>9.0</b>	9.0	9.0	<b>2.19</b>	11.4	11.4	11.4	14.8
-4	<b>19.4</b>	19.4	19.4	<b>9.0</b>	9.0	9.0	<b>2.16</b>	11.0	11.0	11.0	14.8
-5	<b>19.0</b>	19.0	19.0	<b>9.0</b>	9.0	9.0	<b>2.12</b>	10.6	10.6	10.6	14.7
-6	<b>18.6</b>	18.6	18.6	<b>8.9</b>	8.9	8.9	<b>2.08</b>	10.2	10.2	10.2	14.7
-7	<b>18.2</b>	18.2	18.2	<b>8.9</b>	8.9	8.9	<b>2.04</b>	9.9	9.9	9.9	14.7
-8	<b>17.8</b>	17.8	17.8	<b>8.8</b>	8.8	8.8	<b>2.01</b>	9.5	9.5	9.5	14.6
-9	<b>17.4</b>	17.4	17.4	<b>8.8</b>	8.8	8.8	<b>1.97</b>	9.1	9.1	9.1	14.6
-10	<b>17.0</b>	17.0	17.0	<b>8.8</b>	8.8	8.8	<b>1.94</b>	8.8	8.8	8.8	14.5
-11	<b>16.6</b>	16.6	16.6	<b>8.7</b>	8.7	8.7	<b>1.90</b>	8.5	8.5	8.5	14.5
-12	<b>16.2</b>	16.2	16.2	<b>8.7</b>	8.7	8.7	<b>1.87</b>	8.1	8.1	8.1	14.4
-13	<b>15.8</b>	15.8	15.8	<b>8.6</b>	8.6	8.6	<b>1.84</b>	7.8	7.8	7.8	14.3
-14	<b>15.5</b>	15.5	15.5	<b>8.6</b>	8.6	8.6	<b>1.81</b>	7.5	7.5	7.5	14.3
-15	<b>15.1</b>	15.1	15.1	<b>8.5</b>	8.5	8.5	<b>1.77</b>	7.1	7.1	7.1	14.2

-- attention: operating limits not reflected in performance table

Tc -OU		W 12 / 7 °C										
Ts -IN	Qc nom	Qc min	Qc max	Pin nom	Pin min	Pin max	EER	Qh nom	Qh min	Qh max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
40	<b>14.4</b>	14.4	14.4	<b>5.9</b>	5.9	5.9	<b>2.42</b>	19.9	19.9	19.9	11.1	
39	<b>14.5</b>	14.5	14.5	<b>5.8</b>	5.8	5.8	<b>2.49</b>	19.9	19.9	19.9	10.9	
38	<b>14.5</b>	14.5	14.5	<b>5.7</b>	5.7	5.7	<b>2.57</b>	19.8	19.8	19.8	10.7	
37	<b>14.6</b>	14.6	14.6	<b>5.5</b>	5.5	5.5	<b>2.65</b>	19.8	19.8	19.8	10.6	
36	<b>14.7</b>	14.7	14.7	<b>5.4</b>	5.4	5.4	<b>2.73</b>	19.7	19.7	19.7	10.5	
35	<b>14.8</b>	14.8	14.8	<b>5.2</b>	5.2	5.2	<b>2.82</b>	19.7	19.7	19.7	10.3	
34	<b>14.9</b>	14.9	14.9	<b>5.1</b>	5.1	5.1	<b>2.91</b>	19.7	19.7	19.7	10.2	
33	<b>15.0</b>	15.0	15.0	<b>5.0</b>	5.0	5.0	<b>2.99</b>	19.6	19.6	19.6	10.1	
32	<b>15.0</b>	15.0	15.0	<b>4.9</b>	4.9	4.9	<b>3.08</b>	19.6	19.6	19.6	9.9	
31	<b>15.1</b>	15.1	15.1	<b>4.8</b>	4.8	4.8	<b>3.18</b>	19.6	19.6	19.6	9.8	
30	<b>15.2</b>	15.2	15.2	<b>4.6</b>	4.6	4.6	<b>3.27</b>	19.5	19.5	19.5	9.7	
29	<b>15.3</b>	15.3	15.3	<b>4.5</b>	4.5	4.5	<b>3.37</b>	19.5	19.5	19.5	9.6	
28	<b>15.4</b>	15.4	15.4	<b>4.4</b>	4.4	4.4	<b>3.46</b>	19.5	19.5	19.5	9.5	
27	<b>15.4</b>	15.4	15.4	<b>4.3</b>	4.3	4.3	<b>3.56</b>	19.5	19.5	19.5	9.4	
26	<b>15.5</b>	15.5	15.5	<b>4.2</b>	4.2	4.2	<b>3.67</b>	19.5	19.5	19.5	9.3	
25	<b>15.6</b>	15.6	15.6	<b>4.1</b>	4.1	4.1	<b>3.77</b>	19.4	19.4	19.4	9.2	
24	<b>15.6</b>	15.6	15.6	<b>4.0</b>	4.0	4.0	<b>3.87</b>	19.4	19.4	19.4	9.1	
23	<b>15.7</b>	15.7	15.7	<b>3.9</b>	3.9	3.9	<b>3.98</b>	19.4	19.4	19.4	9.0	
22	<b>15.8</b>	15.8	15.8	<b>3.9</b>	3.9	3.9	<b>4.09</b>	19.4	19.4	19.4	8.9	
21	<b>15.8</b>	15.8	15.8	<b>3.8</b>	3.8	3.8	<b>4.20</b>	19.4	19.4	19.4	8.9	
20	<b>15.9</b>	15.9	15.9	<b>3.7</b>	3.7	3.7	<b>4.31</b>	19.4	19.4	19.4	8.8	



Tc [°C]		W 23 / 18 °C										
0	Qc nom	Qc min	Qc max	Pin nom	Pin min	Pin max	EER	Qh nom	Qh min	Qh max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
40	<b>19.3</b>	19.3	19.3	<b>5.9</b>	5.9	5.9	<b>3.25</b>	24.9	24.9	25.3	11.0	
39	<b>19.4</b>	19.4	19.4	<b>5.8</b>	5.8	5.8	<b>3.35</b>	24.8	24.8	25.2	10.9	
38	<b>19.6</b>	19.6	19.6	<b>5.7</b>	5.7	5.7	<b>3.46</b>	24.8	24.8	25.2	10.7	
37	<b>19.7</b>	19.7	19.7	<b>5.5</b>	5.5	5.5	<b>3.56</b>	24.8	24.8	25.1	10.6	
36	<b>19.8</b>	19.8	19.8	<b>5.4</b>	5.4	5.4	<b>3.67</b>	24.8	24.8	25.1	10.4	
35	<b>19.9</b>	19.9	19.9	<b>5.2</b>	5.2	5.2	<b>3.79</b>	24.7	24.7	25.0	10.3	
34	<b>20.0</b>	20.0	20.0	<b>5.1</b>	5.1	5.1	<b>3.90</b>	24.7	24.7	25.0	10.1	
33	<b>20.1</b>	20.1	20.1	<b>5.0</b>	5.0	5.0	<b>4.02</b>	24.7	24.7	25.0	10.0	
32	<b>20.2</b>	20.2	20.2	<b>4.9</b>	4.9	4.9	<b>4.14</b>	24.7	24.7	24.9	9.9	
31	<b>20.3</b>	20.3	20.3	<b>4.8</b>	4.8	4.8	<b>4.26</b>	24.7	24.7	24.9	9.8	
30	<b>20.4</b>	20.4	20.4	<b>4.6</b>	4.6	4.6	<b>4.39</b>	24.7	24.7	24.9	9.7	
29	<b>20.5</b>	20.5	20.5	<b>4.5</b>	4.5	4.5	<b>4.52</b>	24.7	24.7	24.8	9.6	
28	<b>20.6</b>	20.6	20.6	<b>4.4</b>	4.4	4.4	<b>4.65</b>	24.7	24.7	24.8	9.5	
27	<b>20.7</b>	20.7	20.7	<b>4.3</b>	4.3	4.3	<b>4.78</b>	24.7	24.7	24.8	9.4	
26	<b>20.8</b>	20.8	20.8	<b>4.2</b>	4.2	4.2	<b>4.91</b>	24.7	24.7	24.8	9.3	
25	<b>20.9</b>	20.9	20.9	<b>4.1</b>	4.1	4.1	<b>5.05</b>	24.7	24.7	24.7	9.2	
24	<b>21.0</b>	21.0	21.0	<b>4.0</b>	4.0	4.0	<b>5.19</b>	24.7	24.7	24.7	9.1	
23	<b>21.1</b>	21.1	21.1	<b>3.9</b>	3.9	3.9	<b>5.33</b>	24.7	24.7	24.7	9.0	
22	<b>21.1</b>	21.1	21.1	<b>3.9</b>	3.9	3.9	<b>5.48</b>	24.7	24.7	24.7	8.9	
21	<b>21.2</b>	21.2	21.2	<b>3.8</b>	3.8	3.8	<b>5.62</b>	24.7	24.7	24.7	8.9	
20	<b>21.3</b>	21.3	21.3	<b>3.7</b>	3.7	3.7	<b>5.77</b>	24.7	24.7	24.7	8.8	







-- attention: operating limits not reflected in performance table

LEGEND:


Ts-IN: Temperature renewable source - inlet [°C]  
Th-OU: Temperature heating - outlet (flow) [°C]  
Tc-OU: Temperature cooling - outlet (flow) [°C]  
Qh nom: Heating capacity nominal  
Qh min: Heating capacity minimal  
Qh max: Heating capacity maximal  
Pin nom: Power input at nominal heating capacity  
Pin min: Power input at minimal heating capacity  
Pin max: Power input at maximal heating capacity  
COP nom: coefficient of performance at nominal heating capacity  
Qc nom: cooling / heat extraction capacity at nominal heating capacity  
Qc min: cooling / heat extraction at minimal heating capacity  
Qc max: cooling / heat extraction at maximal heating capacity  
I nom: Current at nominal heating capacity  
EER: energy efficiency ratio at nominal cooling capacity

### Operating limits

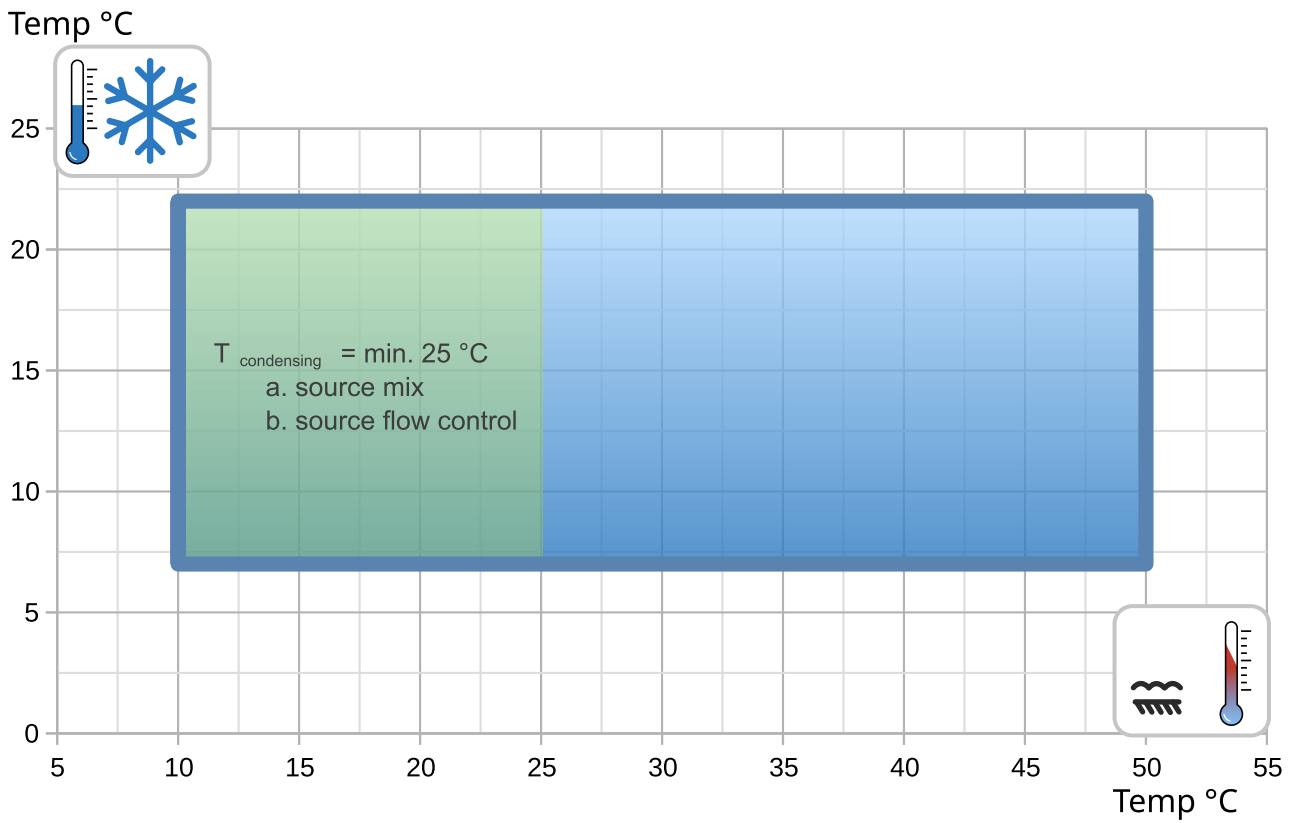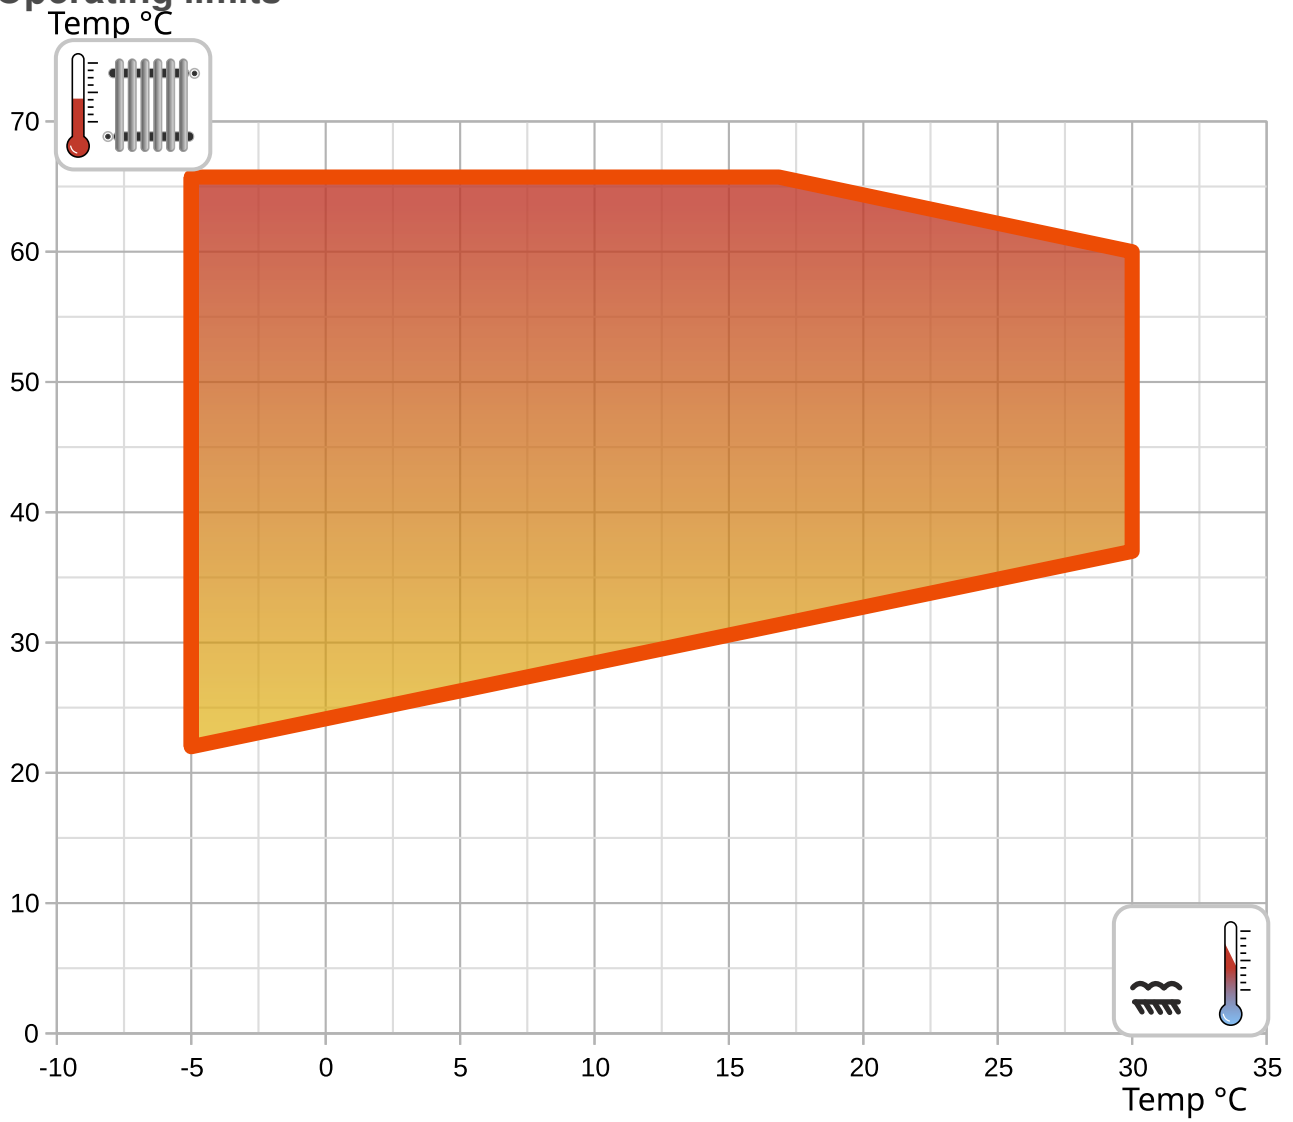


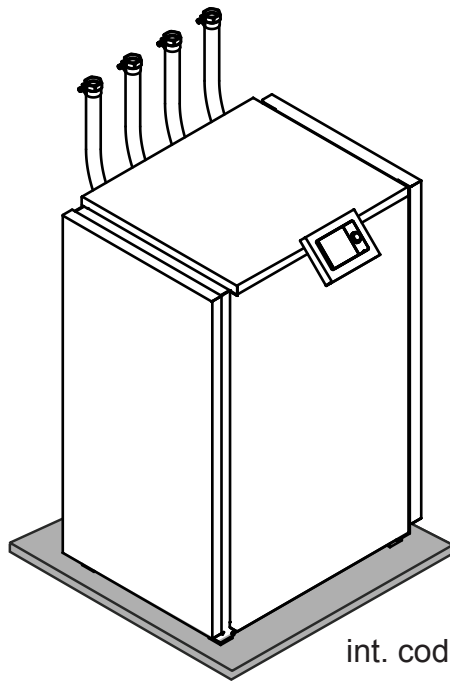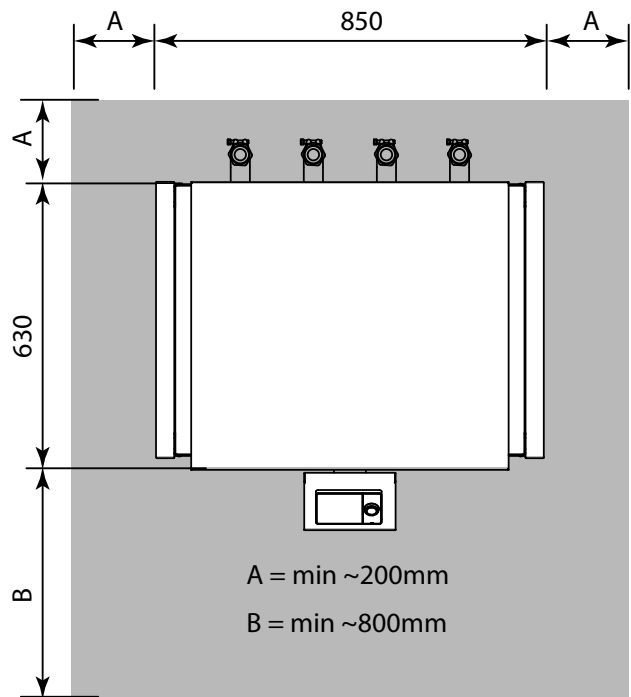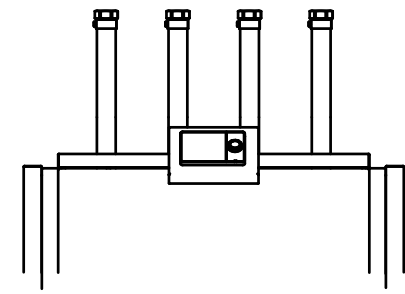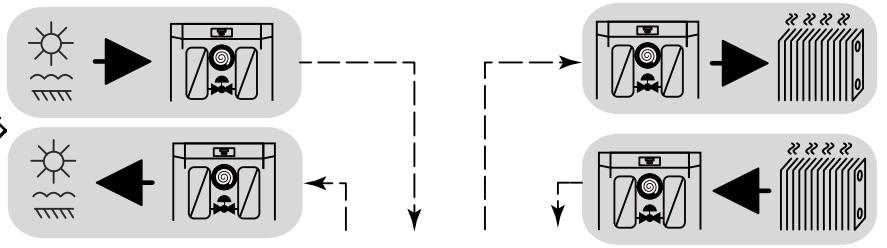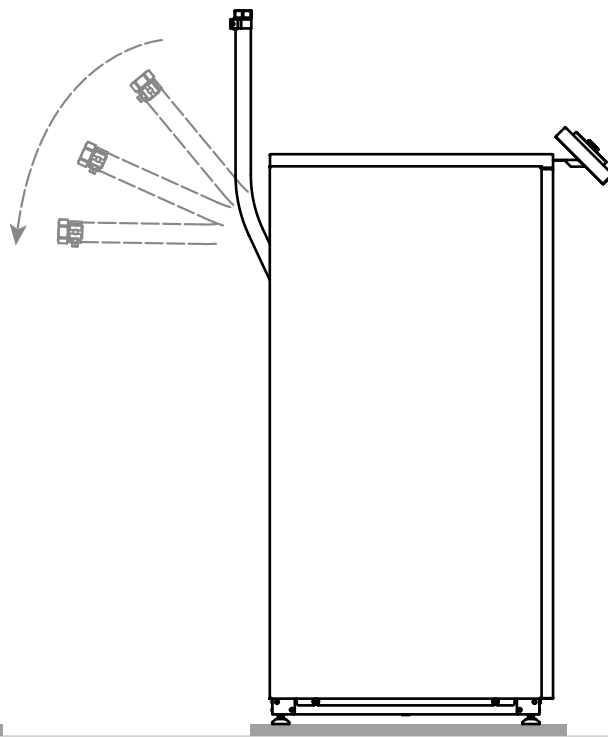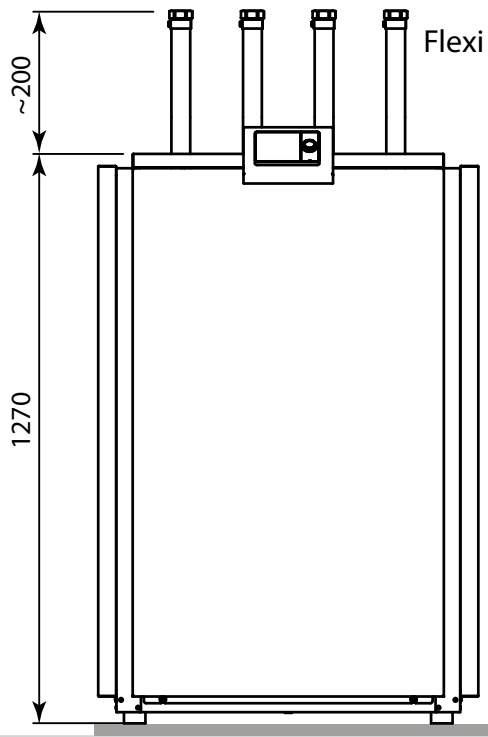


int. code: VN800

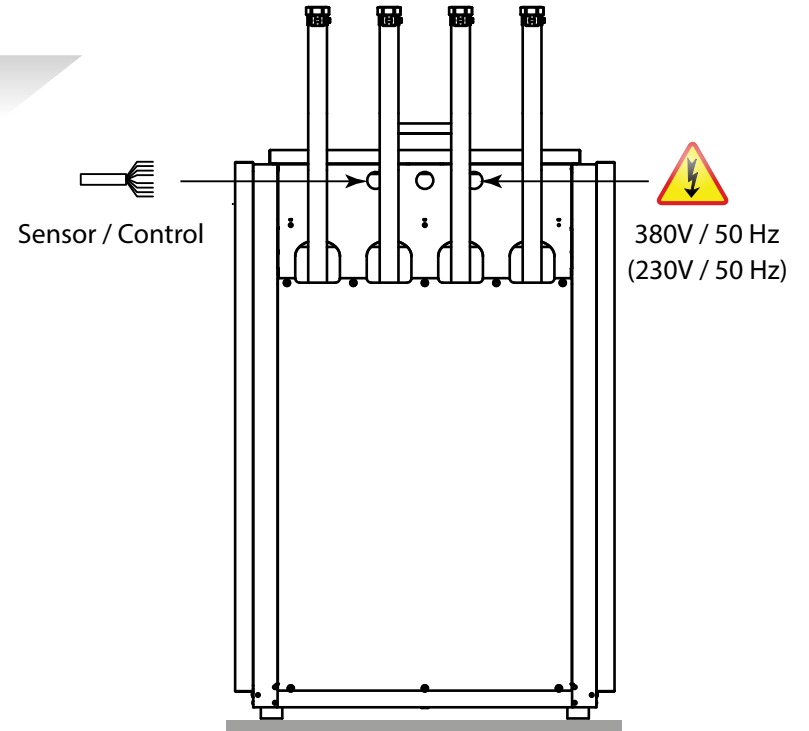



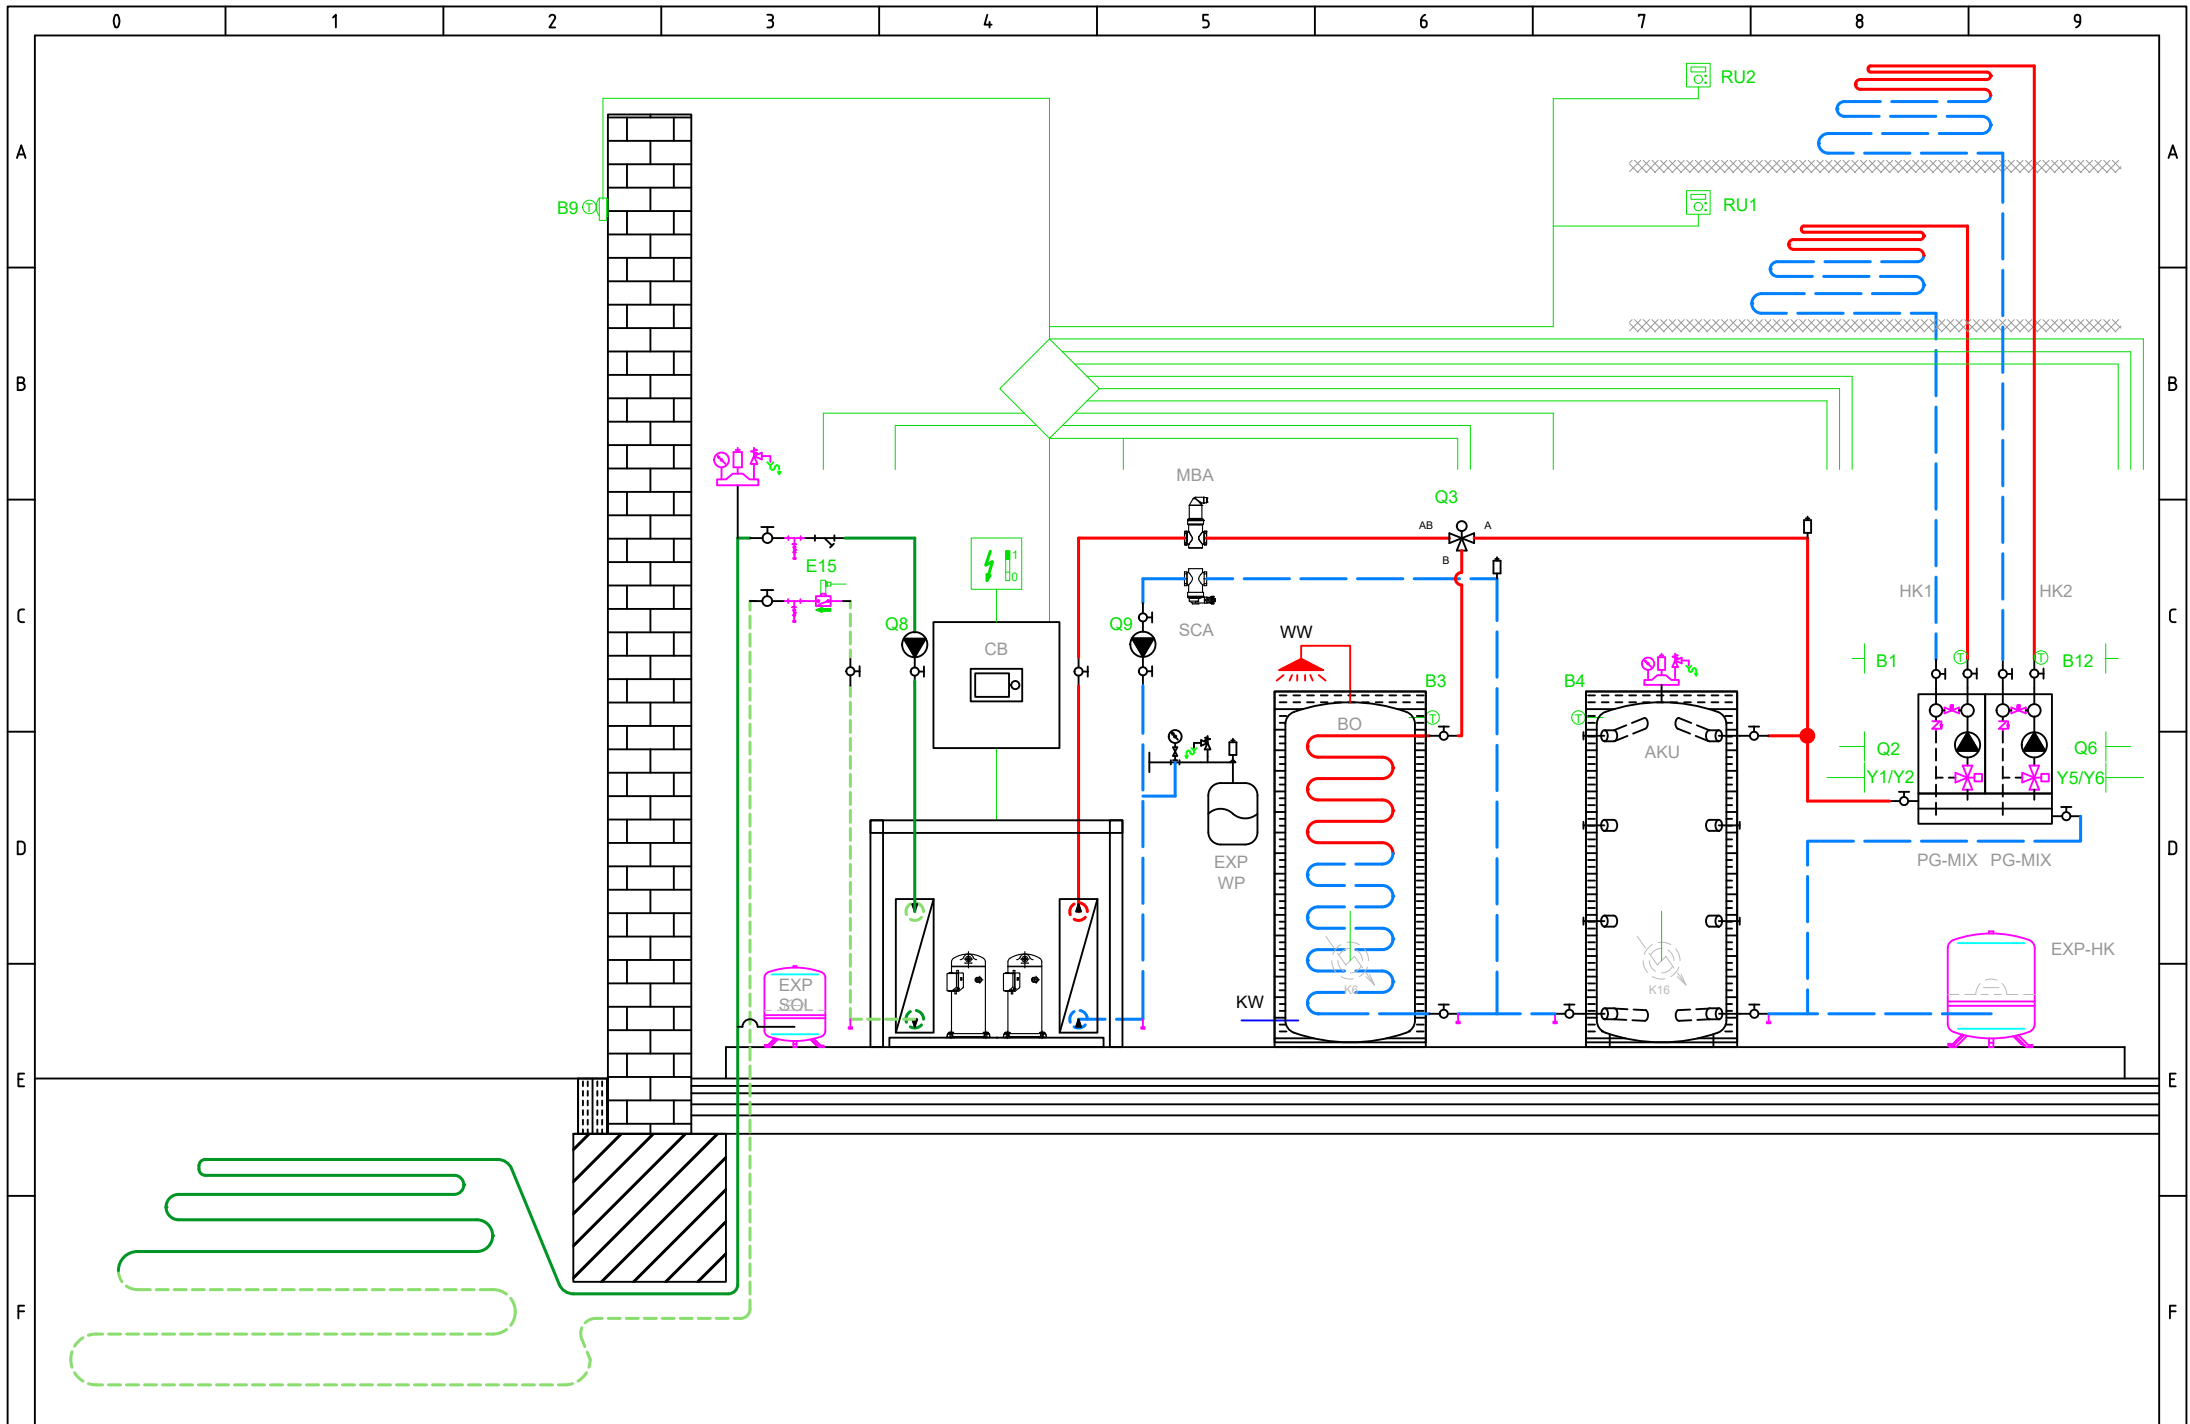

BASIC APPLICATION

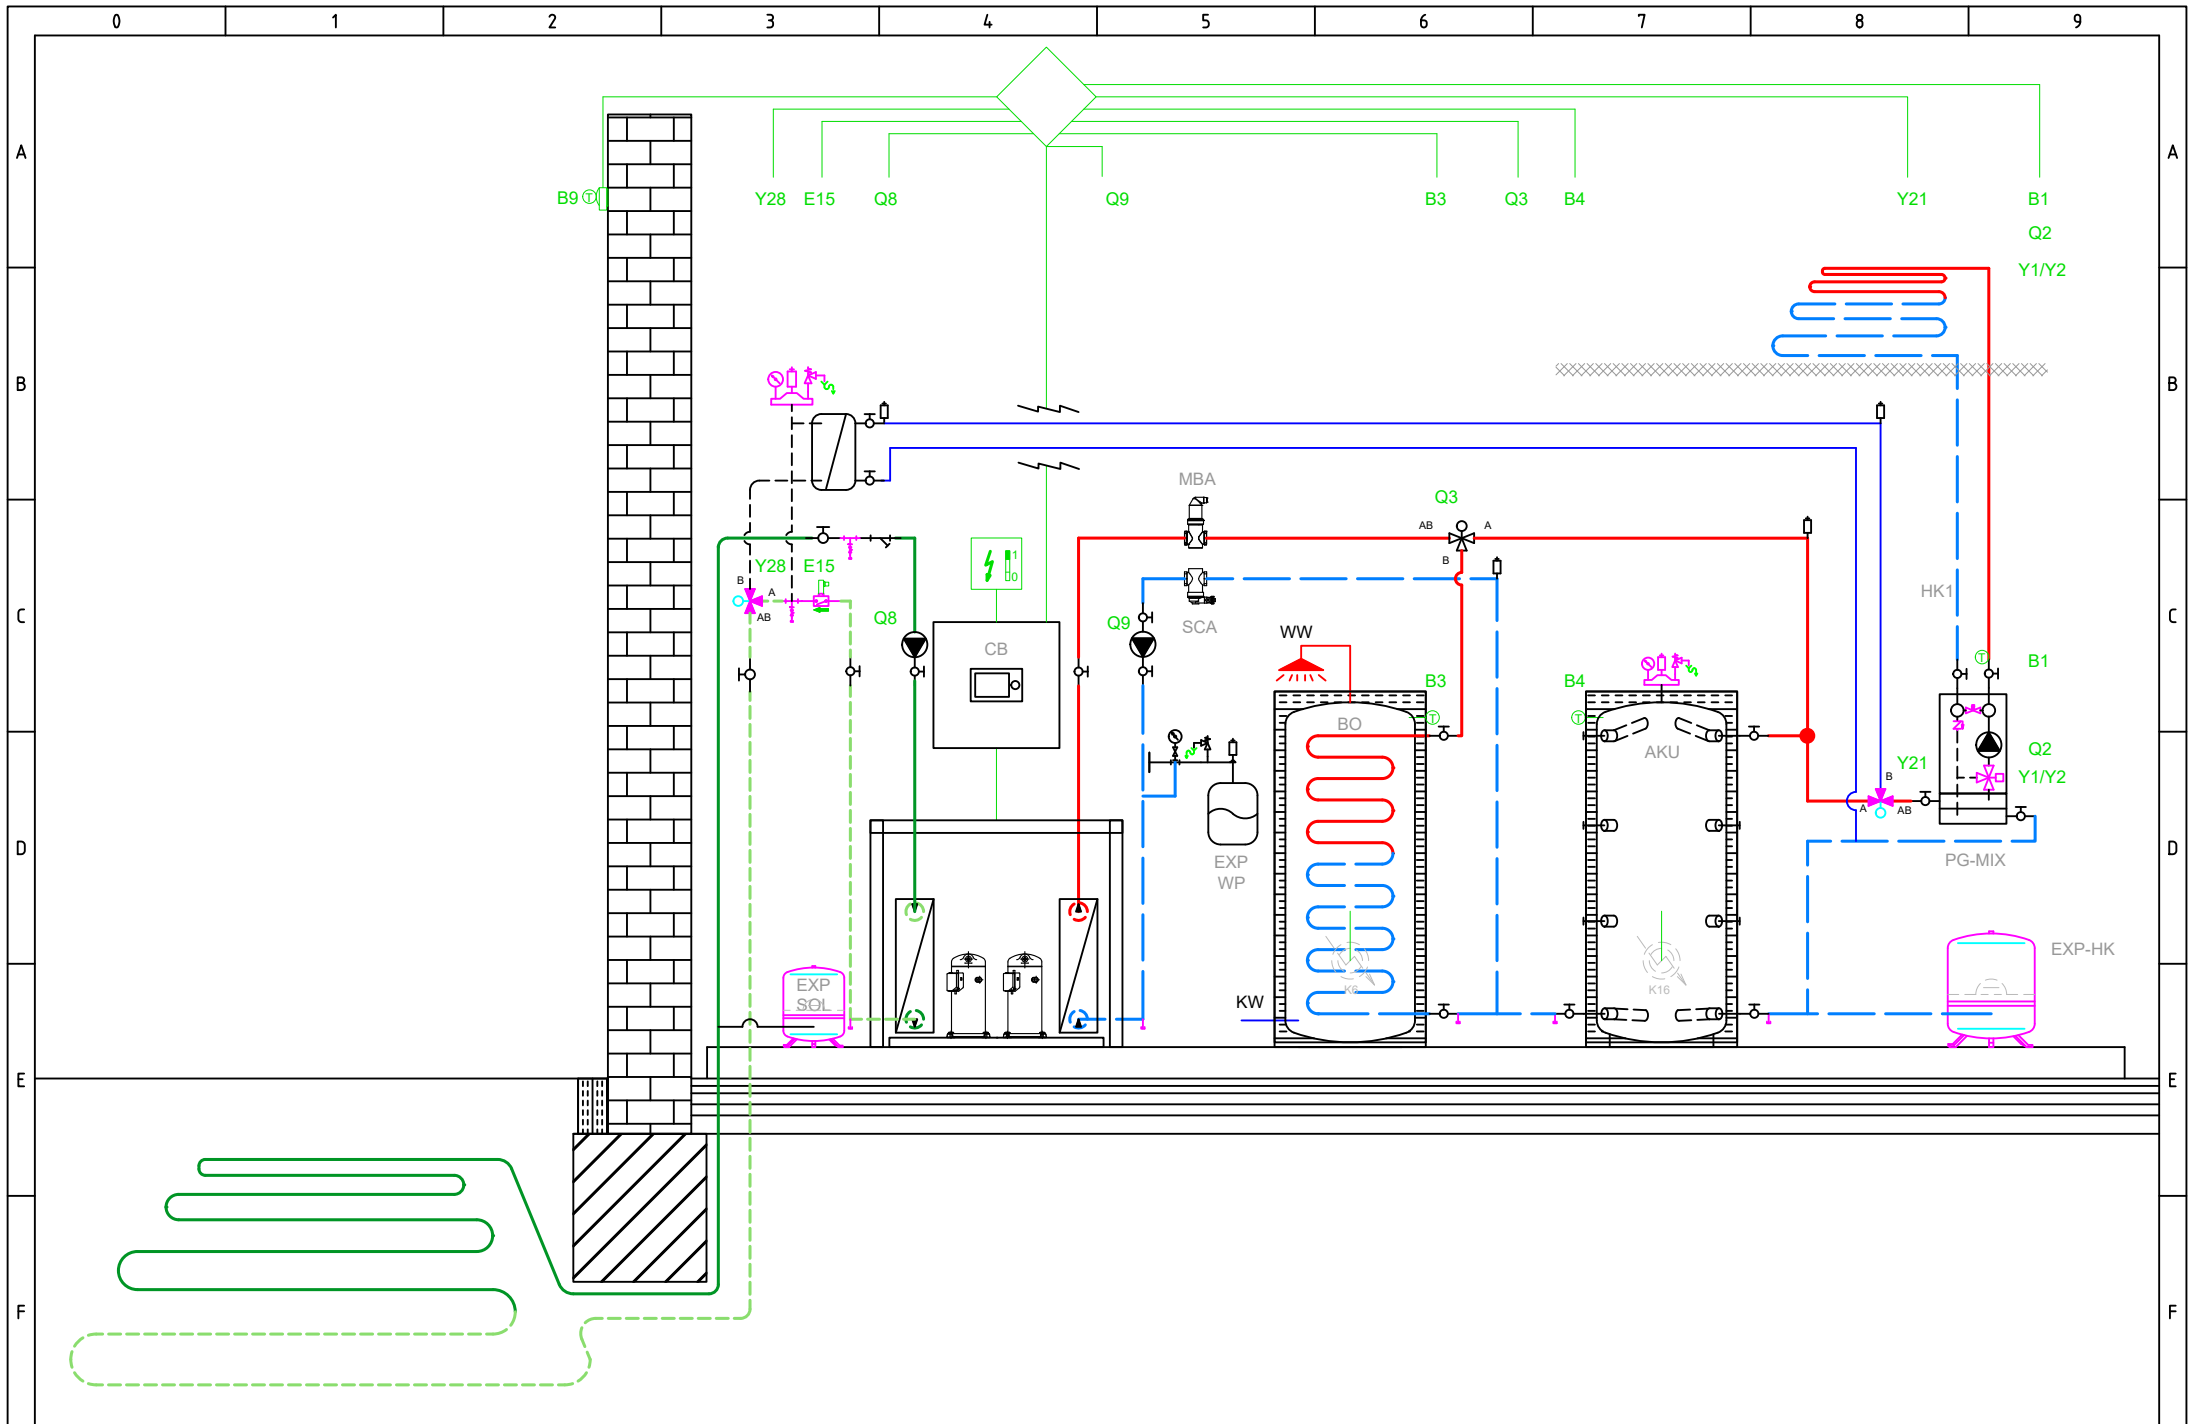

OPTIONAL APPLICATION

Total: max 6A  
1 x QX...: max 2A

Main power supply 230V / 50 Hz  
Ground  
Neutral conductor

- E9 Low-pressure switch E9
- E10 High-pressure switch E10
- E15 Flow switch source E15
- E24 Flow switch consumers E24
- E6 Electrical utility lock E6
- E12 Overload compressor 2 E12
- E21 Mains supervision E21
- E22 Mains supervision E22
- E23 Mains supervision E23
- E11 Overload compressor 1 E11
- K1 Compressor stage 1 K1

Q8 Source pump Q8

Q9 Condenser pump Q9


K10 Alarm output K10

K40 Crankcase heater K40

K81 Valve evaporator K81

K82 Valve EVI K82


K2 Compressor stage 2 K2

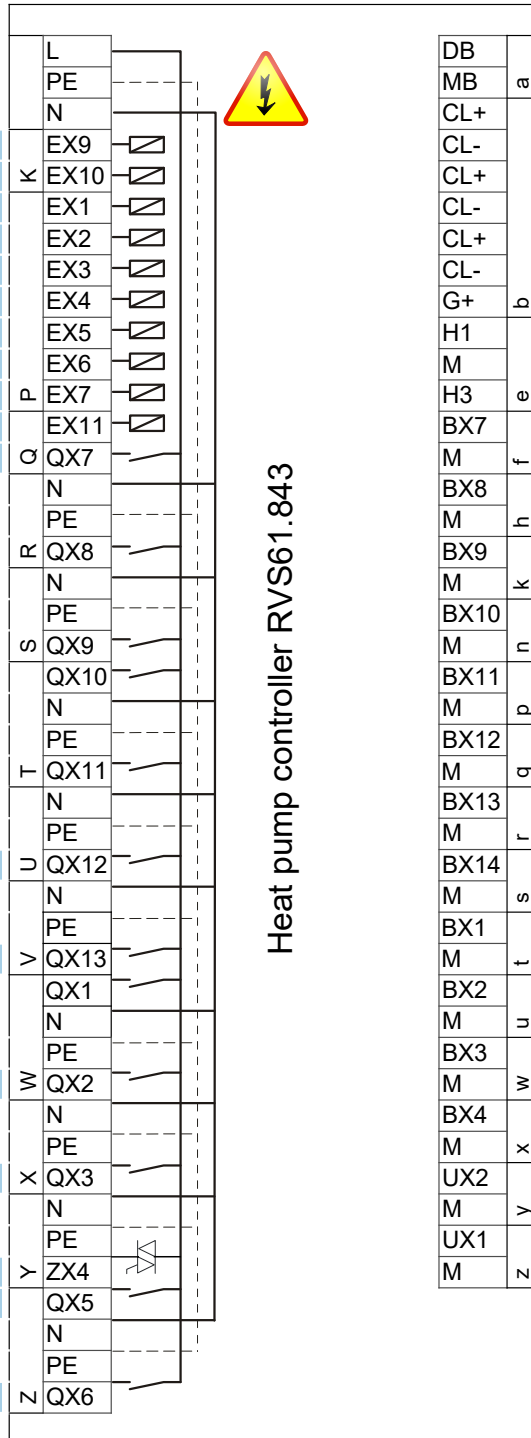

- DB LPB Bus data
- MB LPB Bus GND
- CL+ Room unit QAA...
- CL- Room unit QAA...
- CL+ Room unit QAA... 2.
- CL- Room unit QAA... 2.
- CL+ Room unit QAA... 3.
- CL- Room unit QAA... 3.
- G+ 12V supply → OUT
- H1
- M
- H3 Consumer request VK1
- BX7 B81 Hot-gas sensor K1 B81
- M
- BX8
- M
- BX9
- M B21 HP flow sensor B21
- BX10
- M
- BX11
- M
- BX12 B71 HP return sensor B71
- M
- BX13 B91 Source inlet sensor B91
- M
- BX14 B84 Source outl sens B92/B84
- M
- BX1
- M
- BX2
- M
- BX3 B83 Refrig sensor liquid B83
- M
- BX4 B82 Hot-gas sensor K2 B82
- M
- UX2 Condenser pump Q9
- M 0..10 V Signal
- UX1 Source pump Q8
- M 0..10 V Signal






- AVS75.390
- AVS75.391
- AVS75.370

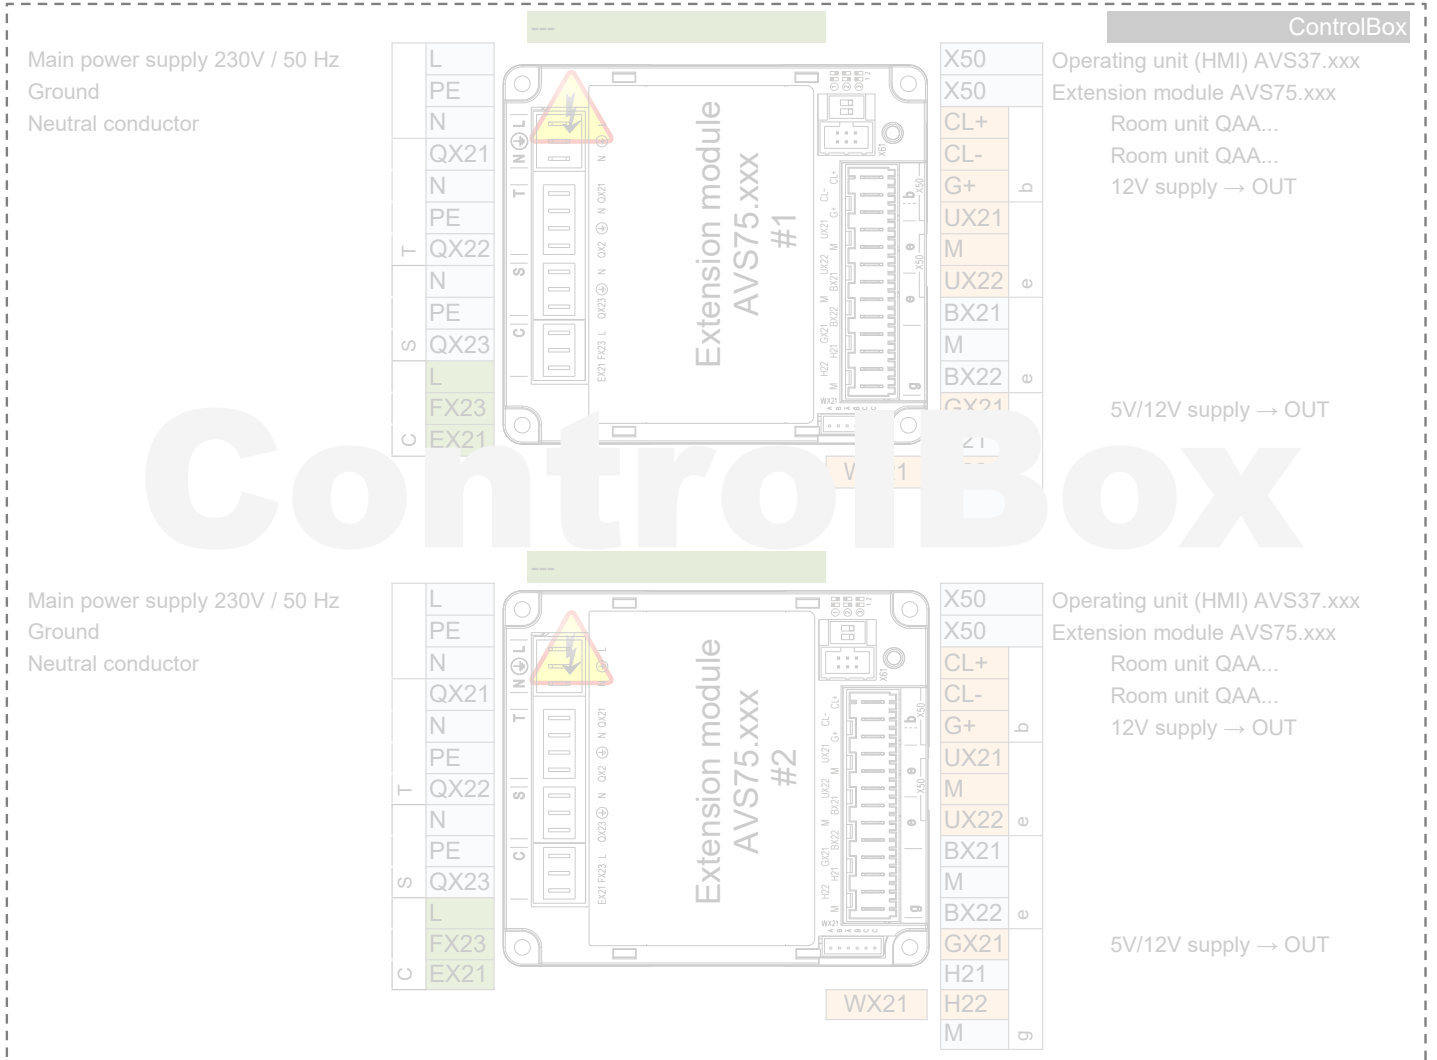

HEAT PUMP

EXTERNAL  
INTERNAL



K1

K2

K82

K81

K40

K10

Q8 UX1

Q9 UX2

E11  
KRW1  
F1K  
E11


E12  
KRW2  
F2K  
E12

E6

Q9.ERR  
F1S  
E24

Q8.ERR  
F1Z  
E15

E10  
E9



M-K1  
MV-EVI-K1  
Q1K

M-K1  
MV-EVI-K2  
Q2K



230V,50Hz  
max 6A

0...10V

230V,50Hz  
max 6A

0...10V

DO

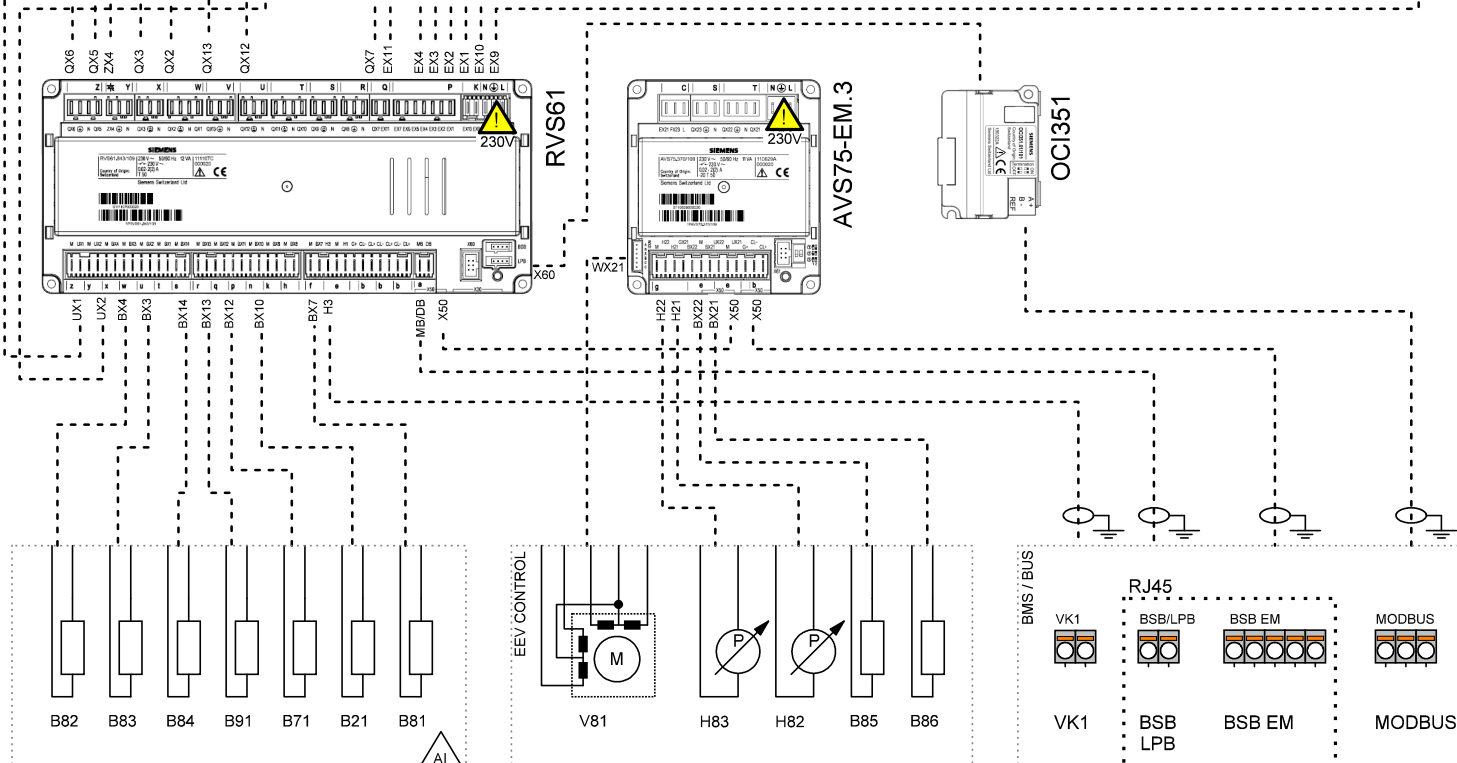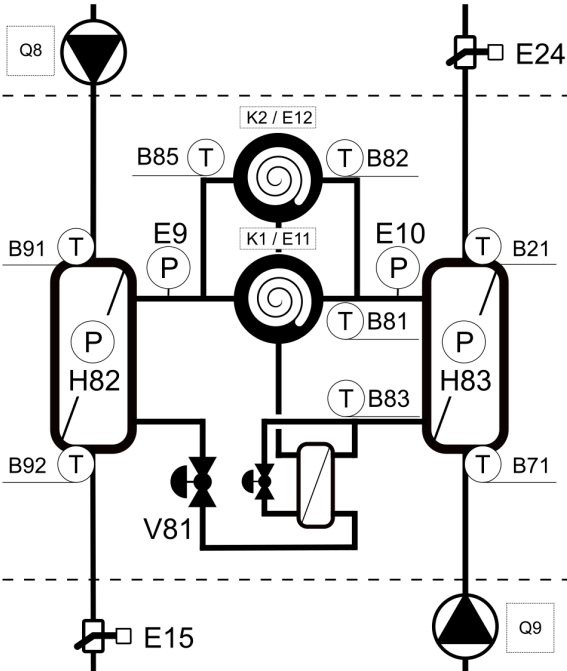

PWR SPLY: ..... 3~ 400V, 50 Hz  
CTRL: ..... 1~ 230V, 50 HZ

Company

Title  
TBW-TWW


Version / Note  
05/2024

Number

Created by

Date

Page  
1

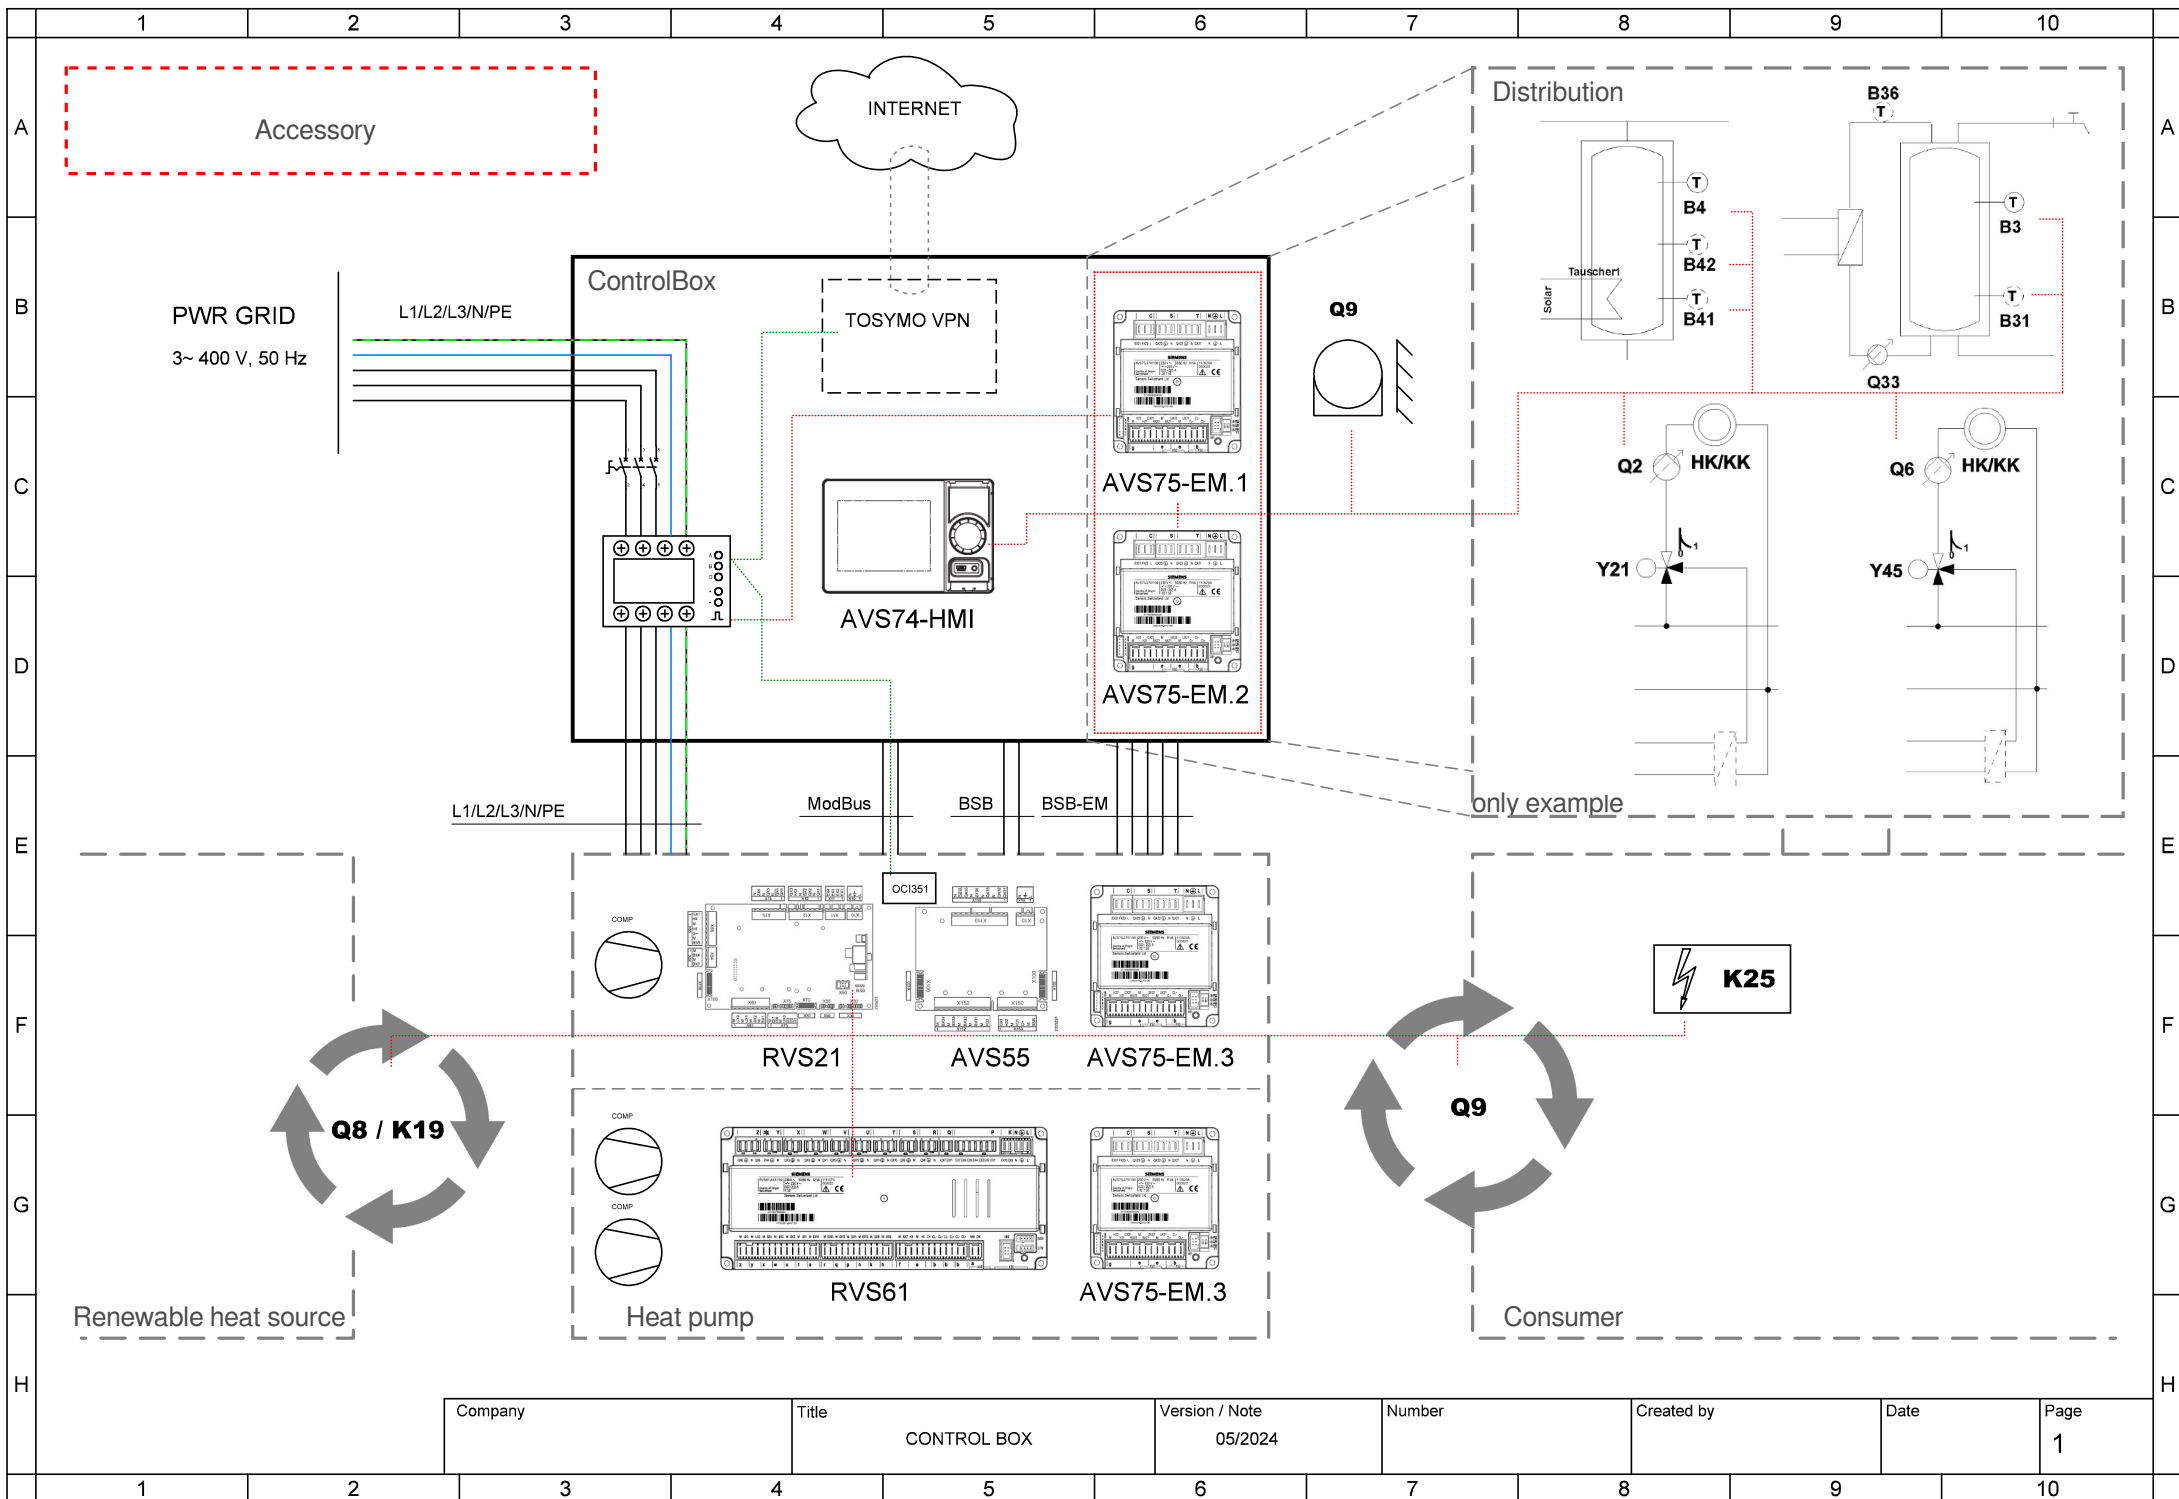

Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				1



Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				2




Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				3



Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				4


- AVS75.390
- AVS75.391
- AVS75.370

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Y1** Mixing valve Open  
  
**Y2** Mixing valve Close  
  
**Q2** Heat circuit pump HC1 Q2  
  
**L** Phase 230V  
**E61** Smart grid E61

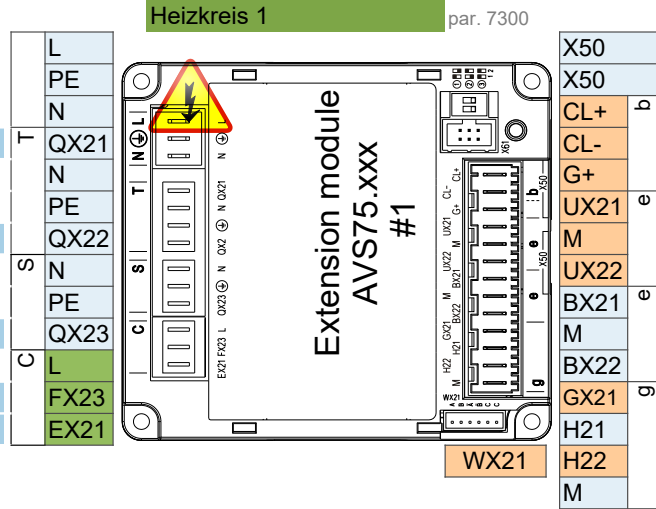


- Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B1** Flow sensor 1  
  
 Pulse count

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Q3** DHW ctrl elem Q3  
  
**K6** El imm heater DHW K6  
  
**Q6** Heat circuit pump HC2 Q6  
  
**L** Phase 230V  
**E62** Smart grid E62

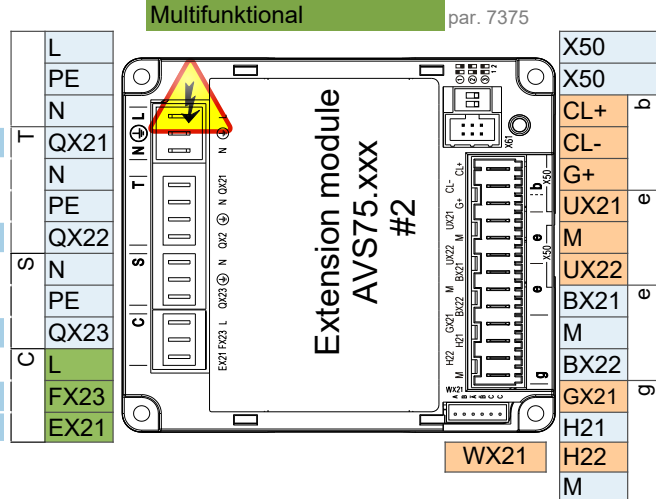

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B3** DHW sensor B3  
  
**B4** Buffer sensor B4

- Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor

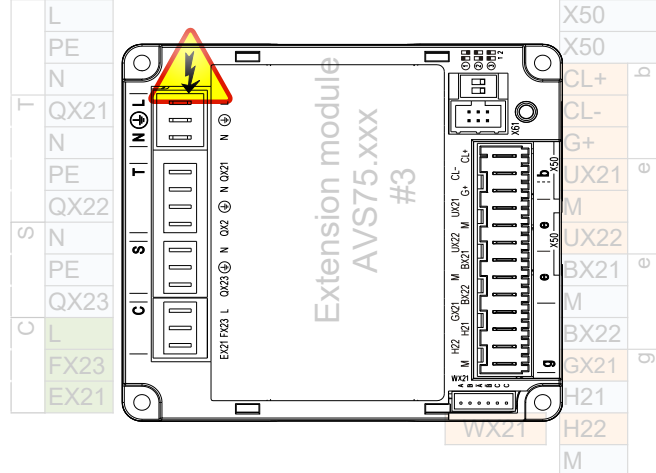

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...

Attention: Extension module 3 is inside the heat pump

## Control connection options

### 1 ControlBox

---

ControlBox, with two built-in extension modules, enables numerous options for application control on the consumer side behind the heat pump. For more, see the ControlBox schematic and the application diagrams sheet.

### 2 Fix flow temperature setpoint - On / Off dry (potential free) contact

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint = 45°C (editable by param. 1859)

Connection terminal - see wiring diagram

### 3 Analog 0..10V flow temperature setpoint control

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint: 0V = 16°C ~ 10V = 60°C ( editable in parameter set )

Connection terminal - see wiring diagram

### 4 ModBus RTU communication command

---

3 wire shielded cable min. 3 x 0.25mm<sup>2</sup>

For ModBus mapping table contact technical support

### 5 MQTT IoT communication protocol

---

For more information contact technical support