

## Basic performance data - WAMAK AWK 35 EVI

Heating - EN 14511		
Heating capacity [kW]	A7 / W35	38.0
	A2 / W35	32.3
	A-7 / W34	27.0
Electrical power input [kW]	A7 / W35	8.8
	A2 / W35	8.8
	A-7 / W34	8.6
Heating efficiency faktor [COP]	A7 / W35	4.31
	A2 / W35	3.67
	A-7 / W34	3.14
Seasonal space heating energy efficiency - SCOP EN 14825		
Average Climate / Low Temperature [35 °C]	SCOP	4.14
	$\eta$ [%]	165.8
	Label	A+++
	Qhe [ kWh ]	14911.3
	Pdesignh [ kW ]	30.6
	Tbivalent [ °C ]	-7
Cooling		
Cooling capacity - [kW]	A35 / W23-18	37.4
	A25 / W23-18	39.0
	A35 / W12-7	27.8
	A25 / W12-7	27.8
Seasonal space cooling energy efficiency - SEER EN 14825		
[ W 23 / 18 °C ]	SEER	4.39
	Qce [ kWh ]	16680.0
	$\eta_c$ [%]	175.8
Sound EN 12102		
Acoustic power - Lw	dB(A)	65.9
Acoustic pressure - Lp	1 m dB(A)	57.9
	5 m dB(A)	43.9
	10 m dB(A)	37.9
Mechanical and operational information		
Compressor type (3~ 400/50)	SCROLL / 1 /	On/Off
Refrigerant	R410A (GWP - 2088)	8.2 kg
Operating limit temperatures heating - (min / max ) [ °C ]		25 / <b>65</b>
Operating limit temperatures source - (min / max ) [ °C ]		<b>-22</b> / 40
Weight		540 kg

## Main technical data - WAMAK AWK 35 EVI

Enclosure type		AWK-VOV900		Heat energy rejection side data		
Basic dimensions	Height [mm]	1250		Operating limit temperatures heating	MAX [°C]	65
	Width [mm]	1380			MIN [°C]	25
	Length [mm]	1780		for more see operating limits diagram		
Weight [kg]	540		Condenser	Port size	2 "	
Colour	Inox			Type	BPHE	
Enclosure IP Class	IP44			Count	1	
				Material	AISI 316	
Refrigeration cycle				Maximal operating pressure - refrigerant [bar]	50	
Compressor	Type	Scroll		Maximal operating pressure - Water [bar]	6	
	Number of stages	1		Testing pressure [bar]	70	
	On/Off			Heat transfer medium	Water	
	Power factor Cosφ	0.55		Volume flow @ dT 5K (nom) - Water [m3/h]	6.56	
	Winding resistance	0.83 Ohm		Internal pressure drop - Water [kPa]	12	
Refrigerant		R410A		Temperature difference @ 35°C (nom)	5 K	
	Volme	8.2 kg		@ 55°C	8 K	
	GWP	2088		@ 65°C	10 K	
	Safety class	A1				
Refrigeration oil type	POE RL32-3MAF			Renewable energy extraction side data		
	Oil volume	3.38 L		Operating limit temperatures source	MIN [°C]	-22
Maximal pressure - refrigerant [bar]		50			MAX [°C]	40
	PED class	2		for more see operating limits diagram		
EVI - vapour injection with economizer				Evaporator	Type	Cu-coil /Al-fin
APS System of liquid subcooling					Count	1
Reversible operation (cooling)					Material	Cu/Al
Reverse defrosting with hot gas				Maximal operating pressure - refrigerant [bar]	29	
Plate exchanger protection HG-BYPASS				Heat transfer medium	Air	
Electrical connection data				Volume flow - Air [m3/h]	11650	
Line voltage [#~ V/Hz]	3~ 400/50		Internal pressure drop - Air [kPa]	0.027		
Current	nominal [A]	21.23		Temperature difference - Air	7 K	
	maximal [A]	32.50		Number of fans	1	
	starting [A]	49.7		Fan diameter [mm]	800	
Softstart	-					
Main safety	C32					
Control System						
Main controller	SIEMENS	RVS 21 AVS 55.199				
Extension module	AVS75.3xx	AVS75.3xx	AVS75.372			
Bus Clip-In		LPB OCI346	Modbus OCI352			
Online connection		Web server OZW672	ToSyMo			
Superheat controller	1 - EEV H/C					

\*\*\* with accessory

## WAMAK AWK 35 EVI

### ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	AWK 35 EVI
Air-to-water heat pump	yes
Brine-to-water heat pump	no
Water-to-water heat pump	no
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	low (35°C - 30°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	30.6	kW	Seasonal space heating energy efficiency	$\eta_s$	165.8	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	27.0	kW	Tj = -7 °C	COPd	3.14	-
Tj = +2 °C	Pdh	31.9	kW	Tj = +2 °C	COPd	4.0	-
Tj = +7 °C	Pdh	37.3	kW	Tj = +7 °C	COPd	5.1	-
Tj = +12 °C	Pdh	43.4	kW	Tj = +12 °C	COPd	6.7	-
Tj = bivalent temperature	Pdh	26.5	kW	Tj = bivalent temperature	COPd	3.0	-
Tj = operation limit temperature	Pdh	19.2	kW	Tj = operation limit temperature	COPd	2.2	-
Bivalent temperature	Tbiv	-7	°C	Tj = operation limit temperature	TOL	-22	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	65	°C
Off mode	Poff	0.040	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	13.7	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.050	kW	For air-to-water heat pumps: Rated air flow rate, outdoors			
Other items				For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Capacity control	fixed						
Sound power level							
indoors	Lwa	---	dB				
outdoors	Lwa	66	dB				
Annual energy consumption	Q <sub>HE</sub>	14911.3	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk

## WAMAK AWK 35 EVI

### ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	AWK 35 EVI
Air-to-water heat pump	yes
Brine-to-water heat pump	no
Water-to-water heat pump	no
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	middle (55°C - 47°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	32.5	kW	Seasonal space heating energy efficiency	$\eta_s$	130.2	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	28.4	kW	Tj = -7 °C	COPd	2.21	-
Tj = +2 °C	Pdh	32.7	kW	Tj = +2 °C	COPd	3.2	-
Tj = +7 °C	Pdh	38.0	kW	Tj = +7 °C	COPd	4.2	-
Tj = +12 °C	Pdh	44.0	kW	Tj = +12 °C	COPd	5.7	-
Tj = bivalent temperature	Pdh	28.2	kW	Tj = bivalent temperature	COPd	2.0	-
Tj = operation limit temperature	Pdh	21.2	kW	Tj = operation limit temperature	COPd	1.5	-
Bivalent temperature	Tbiv	-7	°C	Tj = operation limit temperature	TOL	-22	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	65	°C
Off mode	Poff	0.040	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	13.7	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.050	kW	For air-to-water heat pumps:			
Other items				Rated air flow rate, outdoors	-	11650	m <sup>3</sup> /h
Capacity control	fixed			For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Sound power level							
indoors	Lwa	---	dB				
outdoors	Lwa	66	dB				
Annual energy consumption	Q <sub>HE</sub>	20283.7	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk



**ENERG** Y IIA  
 енергия - ενεργεια IE IA



AWK 35 EVI



55 °C

35 °C



Speaker icon  
--- dB

House icon  
66 dB

■ 35	■ 32
■ 33	■ 31
■ 32	■ 30
kW	kW

2019

811/2013

AWK 35 EVI

ErP Data

	55 °C	35 °C
Energy class	<b>A++</b>	<b>A+++</b>
$\eta$ [%]	130.2	165.8
$P_{rated}$ [kW]	33	31
$Q_{HE}$ [kWh/y]	20284	14912
SCOP [-]	3.25	4.14
$T_{bivalent}$ [°C]	-7	-7

CONTROLLER



+ QAA55/75 class VII 3.5% ↓  
 - QAA55/75 class III 1.5% ↓

Heating performance data

Version: v2024.010-AW

Average Climate / Low Temperature [35°C]

ZHI35K1P-TFD\_R410A\_1\_AW

Operating conditions		Qh	P	COP
1	A7 / W30-35	38.0	8.8	4.31
2	A2 / W35	32.3	8.8	3.67
3	A-22 / W35	19.2	8.8	2.18
A	A-7 / W34	27.0	8.6	3.14
B	A2 / W30	31.9	7.9	4.04
C	A7 / W27	37.3	7.3	5.11
D	A12 / W24	43.4	6.5	6.68
E	A-10 / W35	26.5	8.8	3.02
F	A-7 / W34	27.0	8.6	3.14

SCOP DATA EN 14825:2018	
Average Climate / Low Temperature [35°C]	
SCOPon	4.24
SCOPnet	4.28
SCOP	4.14
η [%]	165.76
Label	A+++
Qh [ kWh ]	14911.26
Pdesignh [ kW ]	30.6
Tbivalent [ °C ]	-7.00

Average Climate / Medium Temperature [55°C]

Operating conditions		Qh	P	COP
1	A7 / W47-55	39.2	14.2	2.77
2	A2 / W55	33.8	14.0	2.41
3	A-22 / W55	21.2	13.0	1.51
A	A-7 / W52	28.4	12.9	2.21
B	A2 / W42	32.7	10.3	3.19
C	A7 / W36	38.0	9.0	4.22
D	A12 / W30	44.0	7.7	5.73
E	A-10 / W55	28.2	13.9	2.04
F	A-7 / W55	28.8	13.9	2.07

SCOP DATA EN 14825:2018	
Average Climate / Medium Temperature [55°C]	
SCOPon	3.31
SCOPnet	3.34
SCOP	3.25
η [%]	130.20
Label	A++
Qh [ kWh ]	20283.74
Pdesignh [ kW ]	32.5
Tbivalent [ °C ]	-7.00

Cooling performance data

Low temperature cooling W 12 / 7°C

Operating conditions		Qc	P	EER
A	A35 / W12-7	27.8	10.6	2.63
B	A30 / W12-7	28.6	9.4	3.03
C	A25 / W12-7	29.1	8.4	3.46
D	A20 / W12-7	29.5	7.5	3.93

SEER DATA EN 14825:2018 [ W 12 / 7°C ]	
SEERon	3.38
SEER	3.30
Qc [ kWh ]	6220.00
η [%]	132.11


Radiant cooling W 23 / 18°C

Operating conditions		Qc	P	EER
A	A35 / W23-18	37.4	10.6	3.54
B	A30 / W23-18	38.3	8.7	4.06
C	A25 / W23-18	39.0	7.6	4.63
D	A20 / W23-18	39.6	6.7	5.27

SEER DATA EN 14825:2018 [ W 23 / 18°C ]	
SEERon	4.52
SEER	4.39
Qc [ kWh ]	4641.25
η [%]	175.76


Performance lines - heating

- Qh-nom-35    Qh-min-35    Qh-max-65    Qh-nom-45    Qh-nom-55
- Qh-nom-65    Pratedh-35    Pratedh-55

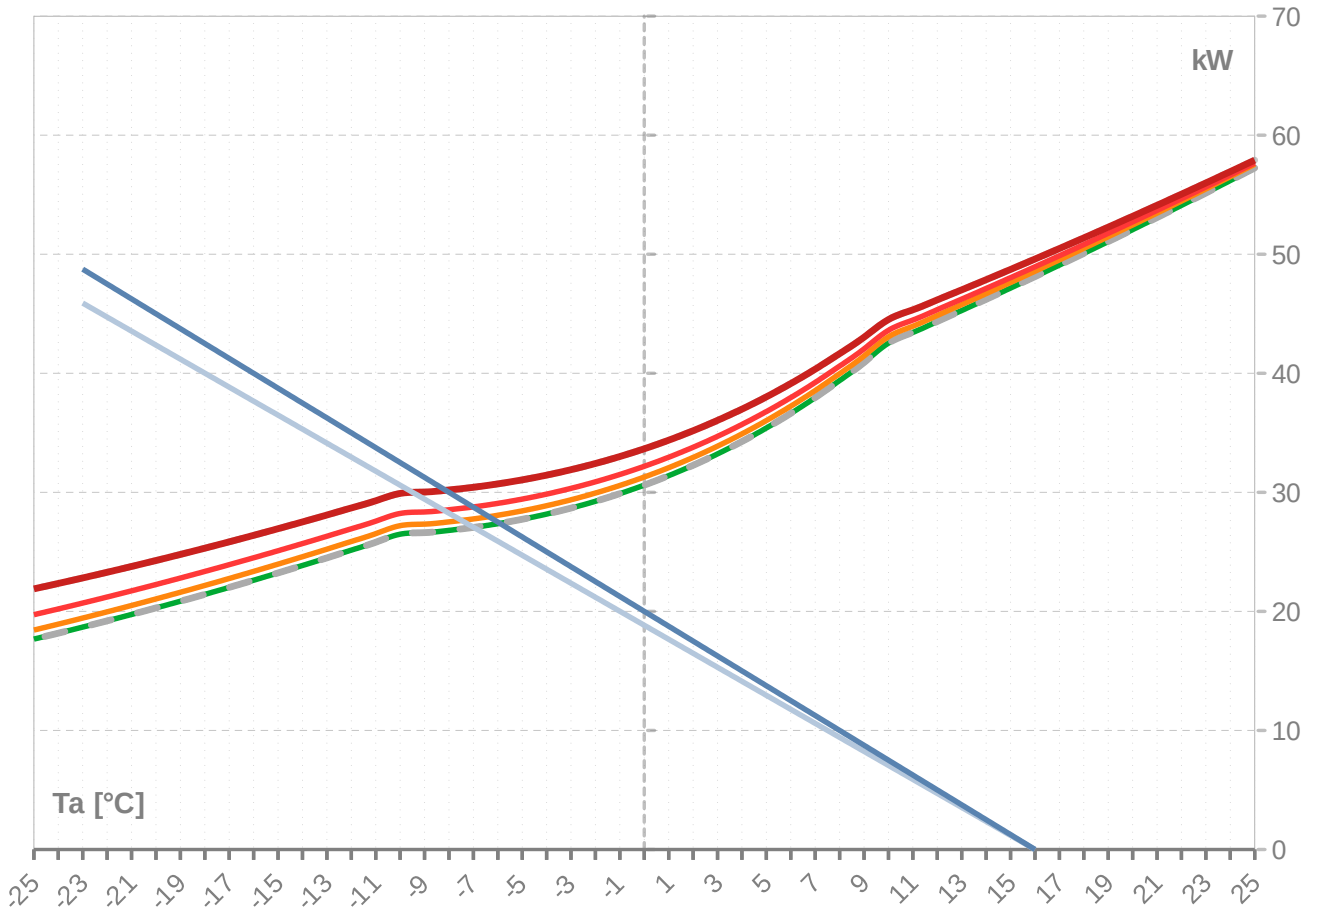

Performance lines - cooling

- Pratedc    Qc-12/7    Qc-23/18

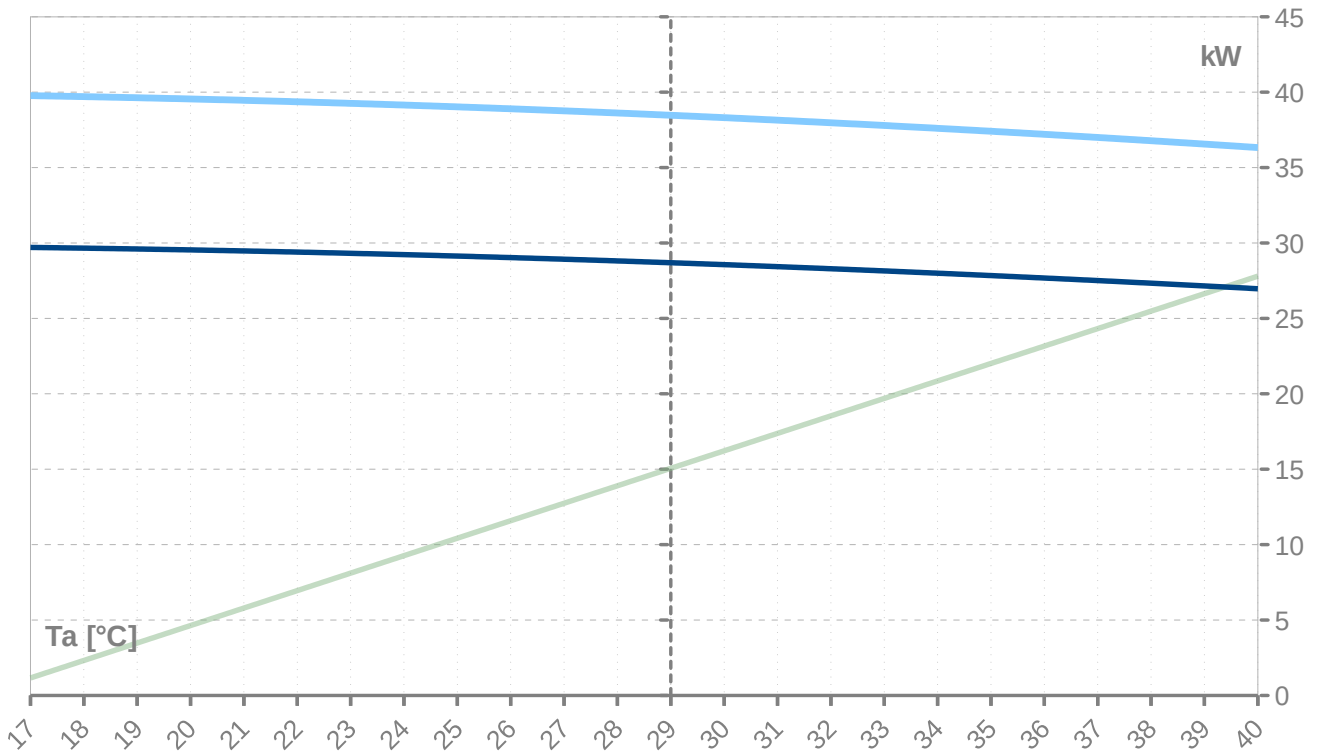

Th [°C]		35 °C								
Ta [°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin-min [kW]	Pin-max [kW]	COP kW / kW	I nom [A]	I min [A]	I max [A]
25	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
24	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
23	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
22	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
21	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
20	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
19	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
18	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
17	<b>49.1</b>	49.1		<b>8.6</b>	8.6		<b>5.72</b>	20.9	20.9	
16	<b>48.1</b>	48.1	48.1	<b>8.6</b>	8.6	8.6	<b>5.58</b>	20.9	20.9	20.9
15	<b>47.2</b>	47.2	47.2	<b>8.6</b>	8.6	8.6	<b>5.45</b>	21.0	21.0	21.0
14	<b>46.2</b>	46.2	46.2	<b>8.7</b>	8.7	8.7	<b>5.33</b>	21.0	21.0	21.0
13	<b>45.3</b>	45.3	45.3	<b>8.7</b>	8.7	8.7	<b>5.20</b>	21.0	21.0	21.0
12	<b>44.4</b>	44.4	44.4	<b>8.7</b>	8.7	8.7	<b>5.08</b>	21.1	21.1	21.1
11	<b>43.4</b>	43.4	43.4	<b>8.7</b>	8.7	8.7	<b>4.97</b>	21.1	21.1	21.1
10	<b>42.5</b>	42.5	42.5	<b>8.8</b>	8.8	8.8	<b>4.85</b>	21.1	21.1	21.1
9	<b>40.9</b>	40.9	40.9	<b>8.8</b>	8.8	8.8	<b>4.66</b>	21.2	21.2	21.2
8	<b>39.4</b>	39.4	39.4	<b>8.8</b>	8.8	8.8	<b>4.48</b>	21.2	21.2	21.2
7	<b>38.0</b>	38.0	38.0	<b>8.8</b>	8.8	8.8	<b>4.31</b>	21.2	21.2	21.2
6	<b>36.6</b>	36.6	36.6	<b>8.8</b>	8.8	8.8	<b>4.16</b>	21.2	21.2	21.2
5	<b>35.4</b>	35.4	35.4	<b>8.8</b>	8.8	8.8	<b>4.02</b>	21.2	21.2	21.2
4	<b>34.3</b>	34.3	34.3	<b>8.8</b>	8.8	8.8	<b>3.89</b>	21.2	21.2	21.2
3	<b>33.2</b>	33.2	33.2	<b>8.8</b>	8.8	8.8	<b>3.77</b>	21.2	21.2	21.2
2	<b>32.3</b>	32.3	32.3	<b>8.8</b>	8.8	8.8	<b>3.67</b>	21.2	21.2	21.2
1	<b>31.4</b>	31.4	31.4	<b>8.8</b>	8.8	8.8	<b>3.57</b>	21.2	21.2	21.2
0	<b>30.6</b>	30.6	30.6	<b>8.8</b>	8.8	8.8	<b>3.48</b>	21.2	21.2	21.2
-1	<b>29.9</b>	29.9	29.9	<b>8.8</b>	8.8	8.8	<b>3.40</b>	21.2	21.2	21.2
-2	<b>29.2</b>	29.2	29.2	<b>8.8</b>	8.8	8.8	<b>3.33</b>	21.2	21.2	21.2
-3	<b>28.7</b>	28.7	28.7	<b>8.8</b>	8.8	8.8	<b>3.27</b>	21.2	21.2	21.2
-4	<b>28.2</b>	28.2	28.2	<b>8.8</b>	8.8	8.8	<b>3.21</b>	21.2	21.2	21.2
-5	<b>27.7</b>	27.7	27.7	<b>8.8</b>	8.8	8.8	<b>3.16</b>	21.2	21.2	21.2
-6	<b>27.4</b>	27.4	27.4	<b>8.8</b>	8.8	8.8	<b>3.12</b>	21.2	21.2	21.2
-7	<b>27.1</b>	27.1	27.1	<b>8.8</b>	8.8	8.8	<b>3.09</b>	21.2	21.2	21.2
-8	<b>26.8</b>	26.8	26.8	<b>8.8</b>	8.8	8.8	<b>3.06</b>	21.2	21.2	21.2
-9	<b>26.6</b>	26.6	26.6	<b>8.8</b>	8.8	8.8	<b>3.04</b>	21.2	21.2	21.2
-10	<b>26.5</b>	26.5	26.5	<b>8.8</b>	8.8	8.8	<b>3.02</b>	21.2	21.2	21.2
-11	<b>25.8</b>	25.8	25.8	<b>8.8</b>	8.8	8.8	<b>2.95</b>	21.2	21.2	21.2
-12	<b>25.1</b>	25.1	25.1	<b>8.8</b>	8.8	8.8	<b>2.87</b>	21.2	21.2	21.2
-13	<b>24.5</b>	24.5	24.5	<b>8.8</b>	8.8	8.8	<b>2.80</b>	21.1	21.1	21.1
-14	<b>23.9</b>	23.9	23.9	<b>8.8</b>	8.8	8.8	<b>2.73</b>	21.1	21.1	21.1
-15	<b>23.2</b>	23.2	23.2	<b>8.8</b>	8.8	8.8	<b>2.65</b>	21.1	21.1	21.1
-16	<b>22.6</b>	22.6	22.6	<b>8.8</b>	8.8	8.8	<b>2.58</b>	21.1	21.1	21.1
-17	<b>22.0</b>	22.0	22.0	<b>8.8</b>	8.8	8.8	<b>2.51</b>	21.1	21.1	21.1
-18	<b>21.4</b>	21.4	21.4	<b>8.8</b>	8.8	8.8	<b>2.44</b>	21.1	21.1	21.1
-19	<b>20.9</b>	20.9	20.9	<b>8.8</b>	8.8	8.8	<b>2.38</b>	21.1	21.1	21.1
-20	<b>20.3</b>	20.3	20.3	<b>8.8</b>	8.8	8.8	<b>2.31</b>	21.1	21.1	21.1
-21	<b>19.7</b>	19.7	19.7	<b>8.8</b>	8.8	8.8	<b>2.24</b>	21.0	21.0	21.0
-22	<b>19.2</b>	19.2	19.2	<b>8.8</b>	8.8	8.8	<b>2.18</b>	21.0	21.0	21.0
-23	<b>18.7</b>	18.7	18.7	<b>8.8</b>	8.8	8.8	<b>2.12</b>	21.0	21.0	21.0
-24	<b>18.2</b>	18.2	18.2	<b>8.9</b>	8.9	8.9	<b>2.05</b>	21.0	21.0	21.0
-25	<b>17.7</b>	17.7	17.7	<b>8.9</b>	8.9	8.9	<b>1.99</b>	21.0	21.0	21.0

\* attention: operating limits not reflected in performance table

Th [°C]		45 °C								
Ta [°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin-min [kW]	Pin-max [kW]	COP kW / kW	I nom [A]	I min [A]	I max [A]
25	57.6	57.6	57.6	11.0	11.0	11.0	5.22	22.8	22.8	22.8
24	56.5	56.5	56.5	11.1	11.1	11.1	5.11	22.8	22.8	22.8
23	55.5	55.5	55.5	11.1	11.1	11.1	5.01	22.8	22.8	22.8
22	54.5	54.5	54.5	11.1	11.1	11.1	4.90	22.9	22.9	22.9
21	53.5	53.5	53.5	11.1	11.1	11.1	4.80	22.9	22.9	22.9
20	52.5	52.5	52.5	11.1	11.1	11.1	4.71	22.9	22.9	22.9
19	51.5	51.5	51.5	11.2	11.2	11.2	4.61	22.9	22.9	22.9
18	50.5	50.5	50.5	11.2	11.2	11.2	4.52	22.9	22.9	22.9
17	49.5	49.5	49.5	11.2	11.2	11.2	4.43	22.9	22.9	22.9
16	48.6	48.6	48.6	11.2	11.2	11.2	4.34	22.9	22.9	22.9
15	47.6	47.6	47.6	11.2	11.2	11.2	4.26	22.9	22.9	22.9
14	46.7	46.7	46.7	11.2	11.2	11.2	4.17	22.9	22.9	22.9
13	45.8	45.8	45.8	11.2	11.2	11.2	4.09	22.9	22.9	22.9
12	44.9	44.9	44.9	11.2	11.2	11.2	4.01	22.9	22.9	22.9
11	44.0	44.0	44.0	11.2	11.2	11.2	3.93	22.9	22.9	22.9
10	43.1	43.1	43.1	11.2	11.2	11.2	3.86	22.9	22.9	22.9
9	41.5	41.5	41.5	11.2	11.2	11.2	3.72	22.9	22.9	22.9
8	40.0	40.0	40.0	11.1	11.1	11.1	3.59	22.9	22.9	22.9
7	38.6	38.6	38.6	11.1	11.1	11.1	3.47	22.8	22.8	22.8
6	37.2	37.2	37.2	11.1	11.1	11.1	3.36	22.8	22.8	22.8
5	36.0	36.0	36.0	11.1	11.1	11.1	3.26	22.8	22.8	22.8
4	34.9	34.9	34.9	11.0	11.0	11.0	3.16	22.8	22.8	22.8
3	33.9	33.9	33.9	11.0	11.0	11.0	3.07	22.7	22.7	22.7
2	32.9	32.9	32.9	11.0	11.0	11.0	2.99	22.7	22.7	22.7
1	32.1	32.1	32.1	11.0	11.0	11.0	2.92	22.7	22.7	22.7
0	31.3	31.3	31.3	11.0	11.0	11.0	2.85	22.7	22.7	22.7
-1	30.6	30.6	30.6	11.0	11.0	11.0	2.79	22.6	22.6	22.6
-2	29.9	29.9	29.9	10.9	10.9	10.9	2.74	22.6	22.6	22.6
-3	29.4	29.4	29.4	10.9	10.9	10.9	2.69	22.6	22.6	22.6
-4	28.9	28.9	28.9	10.9	10.9	10.9	2.64	22.6	22.6	22.6
-5	28.4	28.4	28.4	10.9	10.9	10.9	2.61	22.6	22.6	22.6
-6	28.1	28.1	28.1	10.9	10.9	10.9	2.57	22.6	22.6	22.6
-7	27.8	27.8	27.8	10.9	10.9	10.9	2.55	22.5	22.5	22.5
-8	27.5	27.5	27.5	10.9	10.9	10.9	2.52	22.5	22.5	22.5
-9	27.3	27.3	27.3	10.9	10.9	10.9	2.51	22.5	22.5	22.5
-10	27.2	27.2	27.2	10.9	10.9	10.9	2.50	22.5	22.5	22.5
-11	26.5	26.5	26.5	10.9	10.9	10.9	2.44	22.5	22.5	22.5
-12	25.9	25.9	25.9	10.9	10.9	10.9	2.38	22.5	22.5	22.5
-13	25.2	25.2	25.2	10.9	10.9	10.9	2.32	22.5	22.5	22.5
-14	24.6	24.6	24.6	10.9	10.9	10.9	2.26	22.4	22.4	22.4
-15	24.0	24.0	24.0	10.9	10.9	10.9	2.20	22.4	22.4	22.4
-16	23.4	23.4	23.4	10.9	10.9	10.9	2.14	22.4	22.4	22.4
-17	22.8	22.8	22.8	10.9	10.9	10.9	2.09	22.4	22.4	22.4
-18	22.2	22.2	22.2	10.9	10.9	10.9	2.03	22.3	22.3	22.3
-19	21.6	21.6	21.6	10.9	10.9	10.9	1.98	22.3	22.3	22.3
-20	21.0	21.0	21.0	10.9	10.9	10.9	1.92	22.3	22.3	22.3
-21	20.5	20.5	20.5	11.0	11.0	11.0	1.87	22.3	22.3	22.3
-22	20.0	20.0	20.0	11.0	11.0	11.0	1.82	22.3	22.3	22.3
-23	19.4	19.4	19.4	11.0	11.0	11.0	1.76	22.3	22.3	22.3
-24	18.9	18.9	18.9	11.0	11.0	11.0	1.71	22.3	22.3	22.3
-25	18.4	18.4	18.4	11.1	11.1	11.1	1.66	22.2	22.2	22.2

\* attention: operating limits not reflected in performance table

Th [°C]		55 °C								
Ta [°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin-min [kW]	Pin-max [kW]	COP kW / kW	I nom [A]	I min [A]	I max [A]
25	57.7	57.7	57.7	14.6	14.6	14.6	3.95	26.0	26.0	26.0
24	56.7	56.7	56.7	14.6	14.6	14.6	3.88	26.0	26.0	26.0
23	55.7	55.7	55.7	14.6	14.6	14.6	3.82	26.0	26.0	26.0
22	54.7	54.7	54.7	14.6	14.6	14.6	3.75	26.0	26.0	26.0
21	53.7	53.7	53.7	14.6	14.6	14.6	3.69	26.0	26.0	26.0
20	52.7	52.7	52.7	14.6	14.6	14.6	3.62	25.9	25.9	25.9
19	51.8	51.8	51.8	14.5	14.5	14.5	3.56	25.9	25.9	25.9
18	50.8	50.8	50.8	14.5	14.5	14.5	3.50	25.9	25.9	25.9
17	49.9	49.9	49.9	14.5	14.5	14.5	3.44	25.9	25.9	25.9
16	48.9	48.9	48.9	14.5	14.5	14.5	3.38	25.9	25.9	25.9
15	48.0	48.0	48.0	14.5	14.5	14.5	3.32	25.8	25.8	25.8
14	47.1	47.1	47.1	14.4	14.4	14.4	3.26	25.8	25.8	25.8
13	46.2	46.2	46.2	14.4	14.4	14.4	3.21	25.8	25.8	25.8
12	45.3	45.3	45.3	14.4	14.4	14.4	3.15	25.8	25.8	25.8
11	44.5	44.5	44.5	14.4	14.4	14.4	3.10	25.7	25.7	25.7
10	43.6	43.6	43.6	14.3	14.3	14.3	3.04	25.7	25.7	25.7
9	42.1	42.1	42.1	14.3	14.3	14.3	2.94	25.7	25.7	25.7
8	40.6	40.6	40.6	14.2	14.2	14.2	2.85	25.6	25.6	25.6
7	39.2	39.2	39.2	14.2	14.2	14.2	2.77	25.5	25.5	25.5
6	38.0	38.0	38.0	14.1	14.1	14.1	2.69	25.5	25.5	25.5
5	36.8	36.8	36.8	14.1	14.1	14.1	2.61	25.4	25.4	25.4
4	35.7	35.7	35.7	14.1	14.1	14.1	2.54	25.4	25.4	25.4
3	34.7	34.7	34.7	14.0	14.0	14.0	2.47	25.4	25.4	25.4
2	33.8	33.8	33.8	14.0	14.0	14.0	2.41	25.3	25.3	25.3
1	32.9	32.9	32.9	14.0	14.0	14.0	2.36	25.3	25.3	25.3
0	32.2	32.2	32.2	13.9	13.9	13.9	2.31	25.2	25.2	25.2
-1	31.5	31.5	31.5	13.9	13.9	13.9	2.26	25.2	25.2	25.2
-2	30.9	30.9	30.9	13.9	13.9	13.9	2.22	25.2	25.2	25.2
-3	30.3	30.3	30.3	13.9	13.9	13.9	2.18	25.2	25.2	25.2
-4	29.8	29.8	29.8	13.9	13.9	13.9	2.15	25.1	25.1	25.1
-5	29.4	29.4	29.4	13.9	13.9	13.9	2.12	25.1	25.1	25.1
-6	29.1	29.1	29.1	13.9	13.9	13.9	2.09	25.1	25.1	25.1
-7	28.8	28.8	28.8	13.9	13.9	13.9	2.07	25.1	25.1	25.1
-8	28.5	28.5	28.5	13.9	13.9	13.9	2.06	25.1	25.1	25.1
-9	28.3	28.3	28.3	13.9	13.9	13.9	2.04	25.1	25.1	25.1
-10	28.2	28.2	28.2	13.9	13.9	13.9	2.04	25.1	25.1	25.1
-11	27.6	27.6	27.6	13.9	13.9	13.9	1.99	25.0	25.0	25.0
-12	26.9	26.9	26.9	13.9	13.9	13.9	1.94	25.0	25.0	25.0
-13	26.3	26.3	26.3	13.9	13.9	13.9	1.90	25.0	25.0	25.0
-14	25.7	25.7	25.7	13.9	13.9	13.9	1.85	25.0	25.0	25.0
-15	25.1	25.1	25.1	13.9	13.9	13.9	1.81	24.9	24.9	24.9
-16	24.5	24.5	24.5	13.9	13.9	13.9	1.76	24.9	24.9	24.9
-17	23.9	23.9	23.9	13.9	13.9	13.9	1.72	24.9	24.9	24.9
-18	23.4	23.4	23.4	13.9	13.9	13.9	1.68	24.9	24.9	24.9
-19	22.8	22.8	22.8	13.9	13.9	13.9	1.64	24.9	24.9	24.9
-20	22.3	22.3	22.3	14.0	14.0	14.0	1.59	24.8	24.8	24.8
-21	21.7	21.7	21.7	14.0	14.0	14.0	1.55	24.8	24.8	24.8
-22	21.2	21.2	21.2	14.0	14.0	14.0	1.51	24.8	24.8	24.8
-23	20.7	20.7	20.7	14.1	14.1	14.1	1.47	24.8	24.8	24.8
-24	20.2	20.2	20.2	14.1	14.1	14.1	1.43	24.8	24.8	24.8
-25	19.7	19.7	19.7	14.2	14.2	14.2	1.39	24.8	24.8	24.8

\* attention: operating limits not reflected in performance table

Th [°C]		T-Max @ 65 °C								
Ta [°C]	Qh nom [kW]	Qh min [kW]	Qh max [kW]	Pin nom [kW]	Pin-min [kW]	Pin-max [kW]	COP kW / kW	I nom [A]	I min [A]	I max [A]
25	57.9	57.9	57.9	19.2	19.2	19.2	3.02	31.4	31.4	31.4
24	56.9	56.9	56.9	19.2	19.2	19.2	2.97	31.4	31.4	31.4
23	56.0	56.0	56.0	19.1	19.1	19.1	2.93	31.4	31.4	31.4
22	55.0	55.0	55.0	19.1	19.1	19.1	2.88	31.3	31.3	31.3
21	54.1	54.1	54.1	19.1	19.1	19.1	2.84	31.3	31.3	31.3
20	53.2	53.2	53.2	19.0	19.0	19.0	2.80	31.3	31.3	31.3
19	52.3	52.3	52.3	19.0	19.0	19.0	2.75	31.2	31.2	31.2
18	51.4	51.4	51.4	18.9	18.9	18.9	2.71	31.2	31.2	31.2
17	50.5	50.5	50.5	18.9	18.9	18.9	2.67	31.2	31.2	31.2
16	49.6	49.6	49.6	18.9	18.9	18.9	2.63	31.1	31.1	31.1
15	48.7	48.7	48.7	18.8	18.8	18.8	2.59	31.1	31.1	31.1
14	47.9	47.9	47.9	18.8	18.8	18.8	2.55	31.0	31.0	31.0
13	47.0	47.0	47.0	18.7	18.7	18.7	2.51	31.0	31.0	31.0
12	46.2	46.2	46.2	18.7	18.7	18.7	2.47	31.0	31.0	31.0
11	45.3	45.3	45.3	18.6	18.6	18.6	2.43	30.9	30.9	30.9
10	44.5	44.5	44.5	18.6	18.6	18.6	2.39	30.9	30.9	30.9
9	43.0	43.0	43.0	18.5	18.5	18.5	2.32	30.8	30.8	30.8
8	41.7	41.7	41.7	18.4	18.4	18.4	2.26	30.7	30.7	30.7
7	40.4	40.4	40.4	18.4	18.4	18.4	2.20	30.7	30.7	30.7
6	39.1	39.1	39.1	18.3	18.3	18.3	2.14	30.6	30.6	30.6
5	38.0	38.0	38.0	18.3	18.3	18.3	2.08	30.5	30.5	30.5
4	37.0	37.0	37.0	18.2	18.2	18.2	2.03	30.5	30.5	30.5
3	36.0	36.0	36.0	18.2	18.2	18.2	1.98	30.4	30.4	30.4
2	35.2	35.2	35.2	18.1	18.1	18.1	1.94	30.4	30.4	30.4
1	34.4	34.4	34.4	18.1	18.1	18.1	1.90	30.3	30.3	30.3
0	33.7	33.7	33.7	18.1	18.1	18.1	1.86	30.3	30.3	30.3
-1	33.0	33.0	33.0	18.1	18.1	18.1	1.83	30.3	30.3	30.3
-2	32.4	32.4	32.4	18.0	18.0	18.0	1.80	30.2	30.2	30.2
-3	31.9	31.9	31.9	18.0	18.0	18.0	1.77	30.2	30.2	30.2
-4	31.4	31.4	31.4	18.0	18.0	18.0	1.74	30.2	30.2	30.2
-5	31.0	31.0	31.0	18.0	18.0	18.0	1.72	30.2	30.2	30.2
-6	30.7	30.7	30.7	18.0	18.0	18.0	1.71	30.2	30.2	30.2
-7	30.4	30.4	30.4	18.0	18.0	18.0	1.69	30.2	30.2	30.2
-8	30.2	30.2	30.2	18.0	18.0	18.0	1.68	30.1	30.1	30.1
-9	30.0	30.0	30.0	18.0	18.0	18.0	1.67	30.1	30.1	30.1
-10	29.9	29.9	29.9	18.0	18.0	18.0	1.66	30.1	30.1	30.1
-11	29.3	29.3	29.3	18.0	18.0	18.0	1.63	30.1	30.1	30.1
-12	28.7	28.7	28.7	18.0	18.0	18.0	1.59	30.1	30.1	30.1
-13	28.1	28.1	28.1	18.0	18.0	18.0	1.56	30.1	30.1	30.1
-14	27.5	27.5	27.5	18.0	18.0	18.0	1.53	30.1	30.1	30.1
-15	26.9	26.9	26.9	18.0	18.0	18.0	1.49	30.0	30.0	30.0
-16										
-17										
-18										
-19										
-20										
-21										
-22										
-23										
-24										
-25										

\* attention: operating limits not reflected in performance table

Tc [°C]		W 12 / 7 °C								
Ta [°C]	Qc nom [kW]	Qc min [kW]	Qc max [kW]	Pin [kW]	Pin min [kW]	Pin max [kW]	EER kW / kW	I nom [A]	I min [A]	I max [A]
40	<b>27.0</b>	27.0	27.0	<b>11.9</b>	11.9	11.9	<b>2.26</b>	23.4	23.4	23.4
39	<b>27.2</b>	27.2	27.2	<b>11.6</b>	11.6	11.6	<b>2.34</b>	23.2	23.2	23.2
38	<b>27.3</b>	27.3	27.3	<b>11.4</b>	11.4	11.4	<b>2.41</b>	23.0	23.0	23.0
37	<b>27.5</b>	27.5	27.5	<b>11.1</b>	11.1	11.1	<b>2.48</b>	22.8	22.8	22.8
36	<b>27.7</b>	27.7	27.7	<b>10.8</b>	10.8	10.8	<b>2.56</b>	22.6	22.6	22.6
35	<b>27.8</b>	27.8	27.8	<b>10.6</b>	10.6	10.6	<b>2.63</b>	22.5	22.5	22.5
34	<b>28.0</b>	28.0	28.0	<b>10.3</b>	10.3	10.3	<b>2.71</b>	22.3	22.3	22.3
33	<b>28.1</b>	28.1	28.1	<b>10.1</b>	10.1	10.1	<b>2.79</b>	22.1	22.1	22.1
32	<b>28.3</b>	28.3	28.3	<b>9.9</b>	9.9	9.9	<b>2.87</b>	22.0	22.0	22.0
31	<b>28.4</b>	28.4	28.4	<b>9.7</b>	9.7	9.7	<b>2.95</b>	21.8	21.8	21.8
30	<b>28.6</b>	28.6	28.6	<b>9.4</b>	9.4	9.4	<b>3.03</b>	21.7	21.7	21.7
29	<b>28.7</b>	28.7	28.7	<b>9.2</b>	9.2	9.2	<b>3.11</b>	21.5	21.5	21.5
28	<b>28.8</b>	28.8	28.8	<b>9.0</b>	9.0	9.0	<b>3.20</b>	21.4	21.4	21.4
27	<b>28.9</b>	28.9	28.9	<b>8.8</b>	8.8	8.8	<b>3.28</b>	21.2	21.2	21.2
26	<b>29.0</b>	29.0	29.0	<b>8.6</b>	8.6	8.6	<b>3.37</b>	21.1	21.1	21.1
25	<b>29.1</b>	29.1	29.1	<b>8.4</b>	8.4	8.4	<b>3.46</b>	20.9	20.9	20.9
24	<b>29.2</b>	29.2	29.2	<b>8.2</b>	8.2	8.2	<b>3.55</b>	20.7	20.7	20.7
23	<b>29.3</b>	29.3	29.3	<b>8.0</b>	8.0	8.0	<b>3.64</b>	20.6	20.6	20.6
22	<b>29.4</b>	29.4	29.4	<b>7.9</b>	7.9	7.9	<b>3.74</b>	20.4	20.4	20.4
21	<b>29.5</b>	29.5	29.5	<b>7.7</b>	7.7	7.7	<b>3.83</b>	20.2	20.2	20.2
20	<b>29.5</b>	29.5	29.5	<b>7.5</b>	7.5	7.5	<b>3.93</b>	20.0	20.0	20.0
19	<b>29.6</b>	29.6	29.6	<b>7.3</b>	7.3	7.3	<b>4.04</b>	19.8	19.8	19.8
18	<b>29.7</b>	29.7	29.7	<b>7.2</b>	7.2	7.2	<b>4.14</b>	19.6	19.6	19.6
17	<b>29.7</b>	29.7	29.7	<b>7.0</b>	7.0	7.0	<b>4.25</b>	19.4	19.4	19.4

Tc [°C]		W 23 / 18 °C								
Ta [°C]	Qc [kW]	Qh-min [kW]	Qh-max [kW]	Pin [kW]	Pin-min [kW]	Pin-max [kW]	EER kW / kW	I [A]	I-min [A]	I-max [A]
40	<b>36.3</b>	36.3	36.3	<b>11.9</b>	11.9	11.9	<b>3.05</b>	23.6	23.6	23.6
39	<b>36.6</b>	36.6	36.6	<b>11.6</b>	11.6	11.6	<b>3.14</b>	23.4	23.4	23.4
38	<b>36.8</b>	36.8	36.8	<b>11.4</b>	11.4	11.4	<b>3.24</b>	23.1	23.1	23.1
37	<b>37.0</b>	37.0	37.0	<b>11.1</b>	11.1	11.1	<b>3.34</b>	22.9	22.9	22.9
36	<b>37.2</b>	37.2	37.2	<b>10.8</b>	10.8	10.8	<b>3.44</b>	22.7	22.7	22.7
35	<b>37.4</b>	37.4	37.4	<b>10.6</b>	10.6	10.6	<b>3.54</b>	22.5	22.5	22.5
34	<b>37.6</b>	37.6	37.6	<b>10.3</b>	10.3	10.3	<b>3.64</b>	22.3	22.3	22.3
33	<b>37.8</b>	37.8	37.8	<b>10.1</b>	10.1	10.1	<b>3.74</b>	22.1	22.1	22.1
32	<b>38.0</b>	38.0	38.0	<b>9.9</b>	9.9	9.9	<b>3.85</b>	21.9	21.9	21.9
31	<b>38.1</b>	38.1	38.1	<b>9.7</b>	9.7	9.7	<b>3.95</b>	21.7	21.7	21.7
30	<b>38.3</b>	38.3	38.3	<b>9.4</b>	9.4	9.4	<b>4.06</b>	21.6	21.6	21.6
29	<b>38.5</b>	38.5	38.5	<b>9.2</b>	9.2	9.2	<b>4.17</b>	21.4	21.4	21.4
28	<b>38.6</b>	38.6	38.6	<b>9.0</b>	9.0	9.0	<b>4.28</b>	21.2	21.2	21.2
27	<b>38.8</b>	38.8	38.8	<b>8.8</b>	8.8	8.8	<b>4.40</b>	21.0	21.0	21.0
26	<b>38.9</b>	38.9	38.9	<b>8.6</b>	8.6	8.6	<b>4.51</b>	20.8	20.8	20.8
25	<b>39.0</b>	39.0	39.0	<b>8.4</b>	8.4	8.4	<b>4.63</b>	20.6	20.6	20.6
24	<b>39.1</b>	39.1	39.1	<b>8.2</b>	8.2	8.2	<b>4.75</b>	20.4	20.4	20.4
23	<b>39.3</b>	39.3	39.3	<b>8.0</b>	8.0	8.0	<b>4.88</b>	20.2	20.2	20.2
22	<b>39.4</b>	39.4	39.4	<b>7.9</b>	7.9	7.9	<b>5.00</b>	20.0	20.0	20.0
21	<b>39.5</b>	39.5	39.5	<b>7.7</b>	7.7	7.7	<b>5.13</b>	19.8	19.8	19.8
20	<b>39.6</b>	39.6	39.6	<b>7.5</b>	7.5	7.5	<b>5.27</b>	19.5	19.5	19.5
19	<b>39.6</b>	39.6	39.6	<b>7.3</b>	7.3	7.3	<b>5.40</b>	19.3	19.3	19.3
18	<b>39.7</b>	39.7	39.7	<b>7.2</b>	7.2	7.2	<b>5.55</b>	19.0	19.0	19.0
17	<b>39.8</b>	39.8	39.8	<b>7.0</b>	7.0	7.0	<b>5.69</b>	18.8	18.8	18.8


\* attention: operating limits not reflected in performance table

LEGENDE:


Ts-IN: Temperature renewable source - inlet [°C]  
Th-OU: Temperature heating - outlet (flow) [°C]  
Tc-OU: Temperature cooling - outlet (flow) [°C]  
Qh nom: Heating capacity nominal  
Qh min: Heating capacity minimal  
Qh max: Heating capacity maximal  
Pin nom: Power input at nominal heating capacity  
Pin min: Power input at minimal heating capacity  
Pin max: Power input at maximal heating capacity  
COP nom: coefficient of performance at nominal heating capacity  
Qc nom: cooling / heat extraction capacity at nominal heating capacity  
Qc min: cooling / heat extraction at minimal heating capacity  
Qc max: cooling / heat extraction at maximal heating capacity  
I nom: Current at nominal heating capacity  
EER: energy efficiency ratio at nominal cooling capacity





# Operating limits



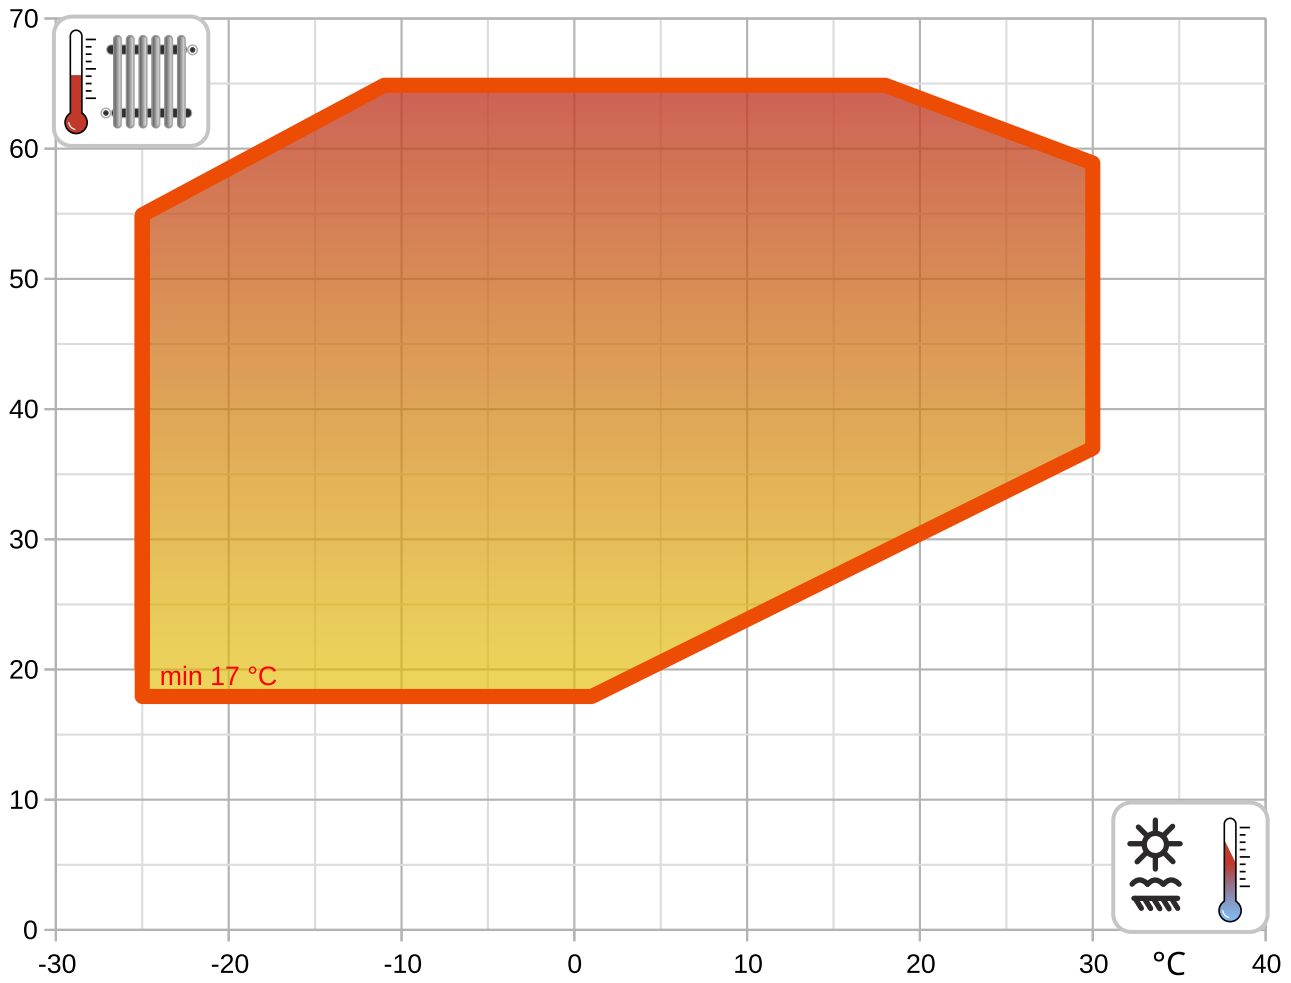

°C


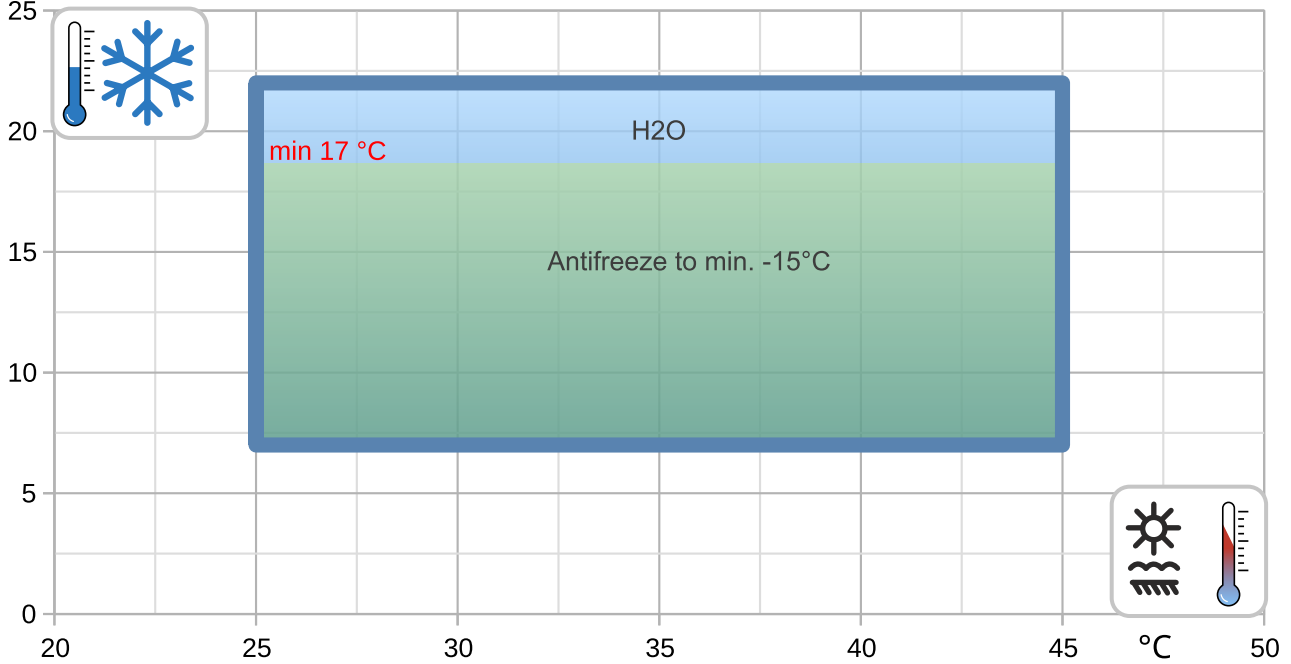


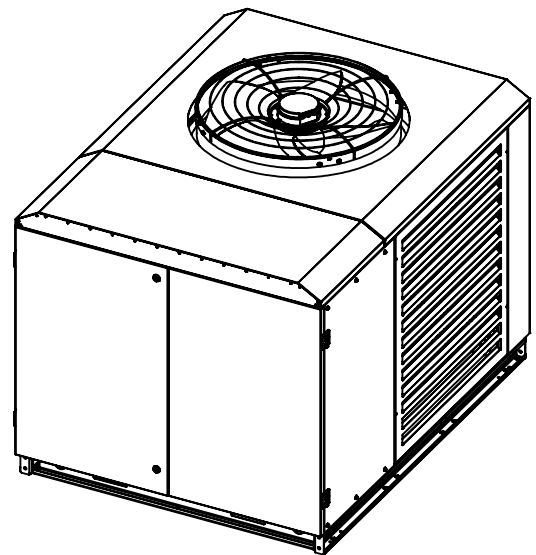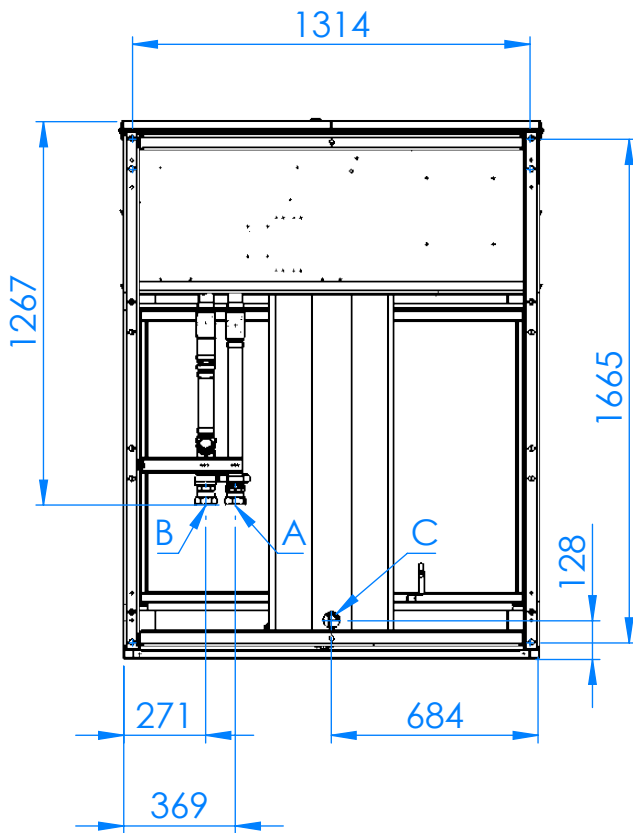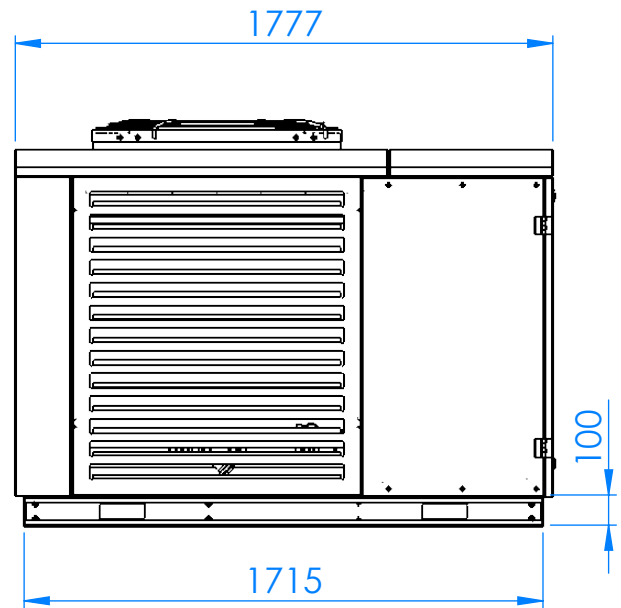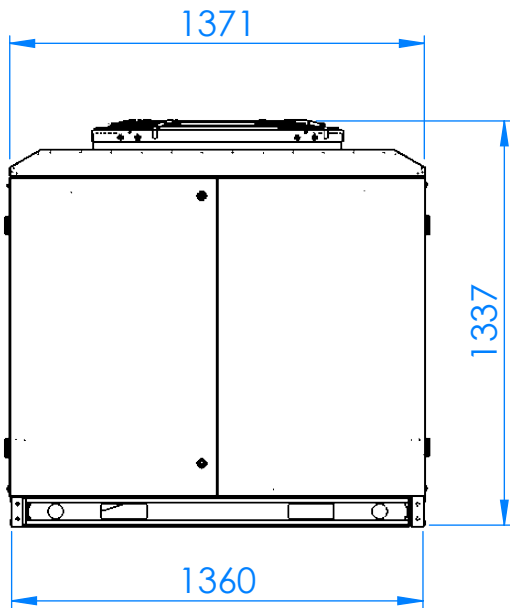°C







- A -  → 
- B -  ← 
- C - Condens

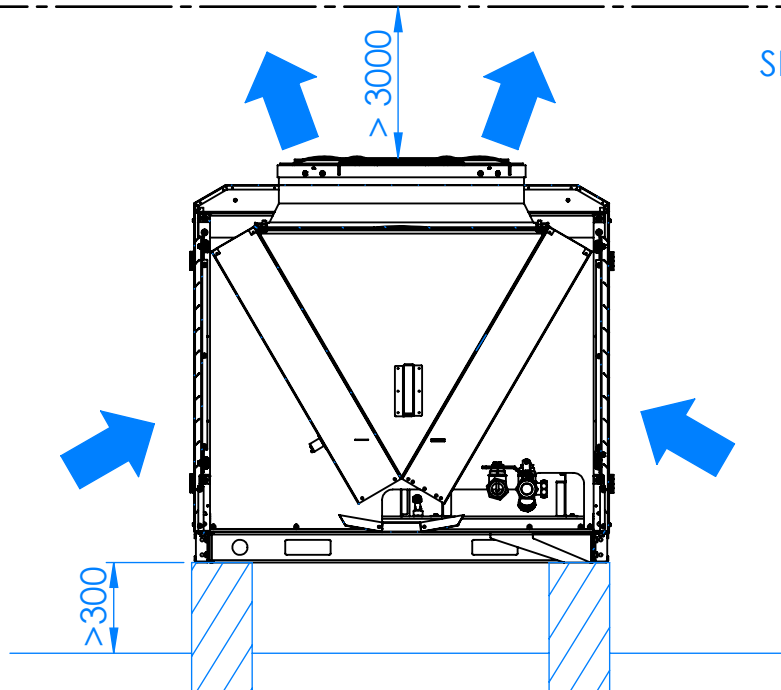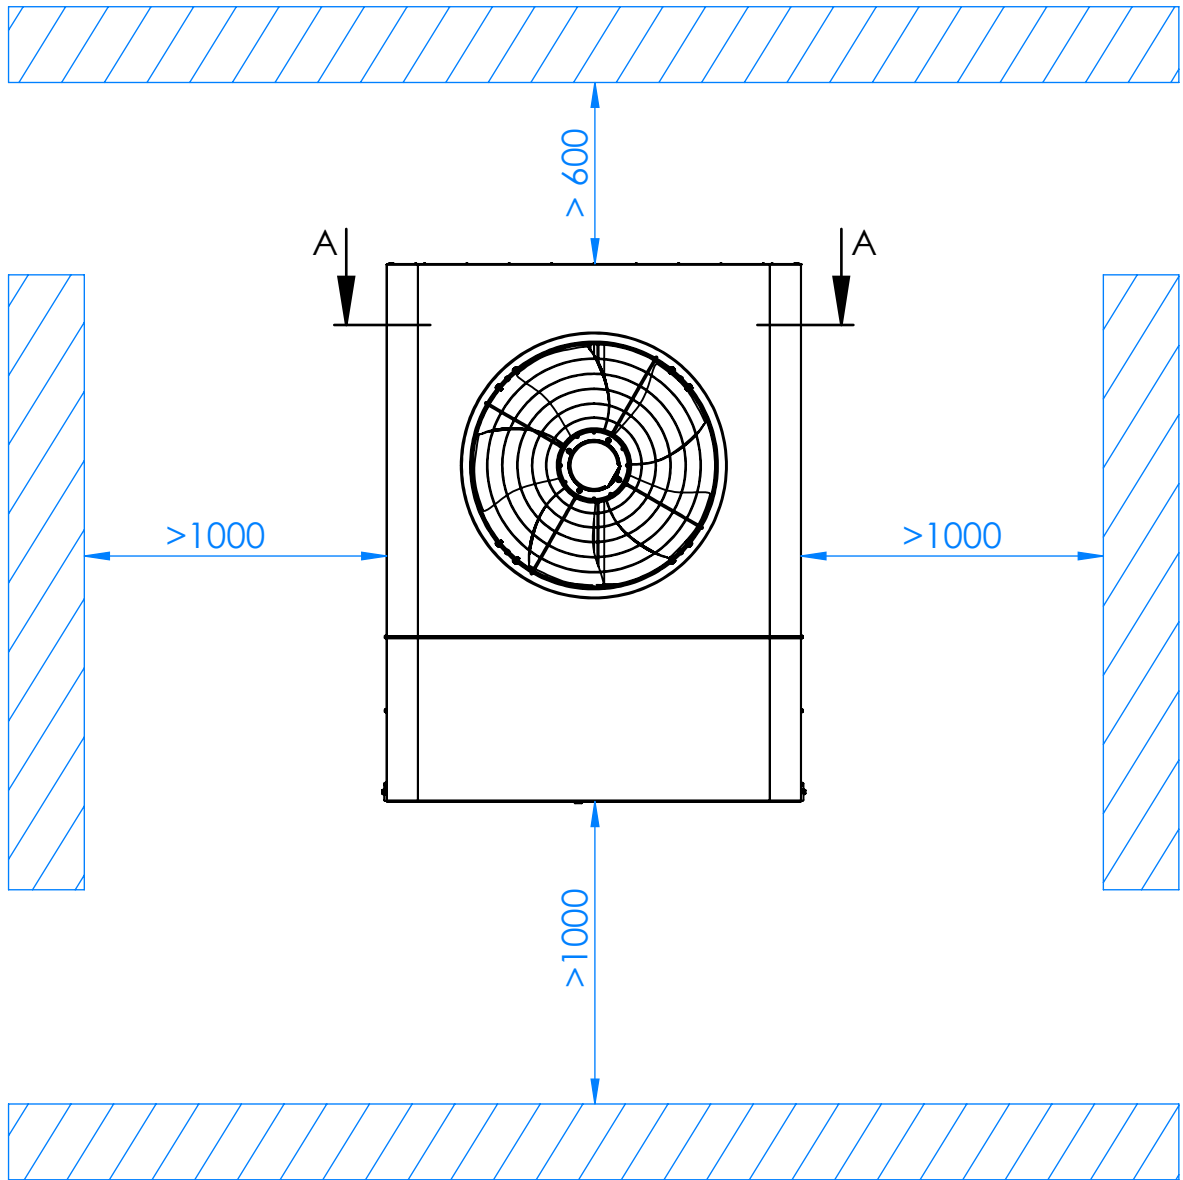



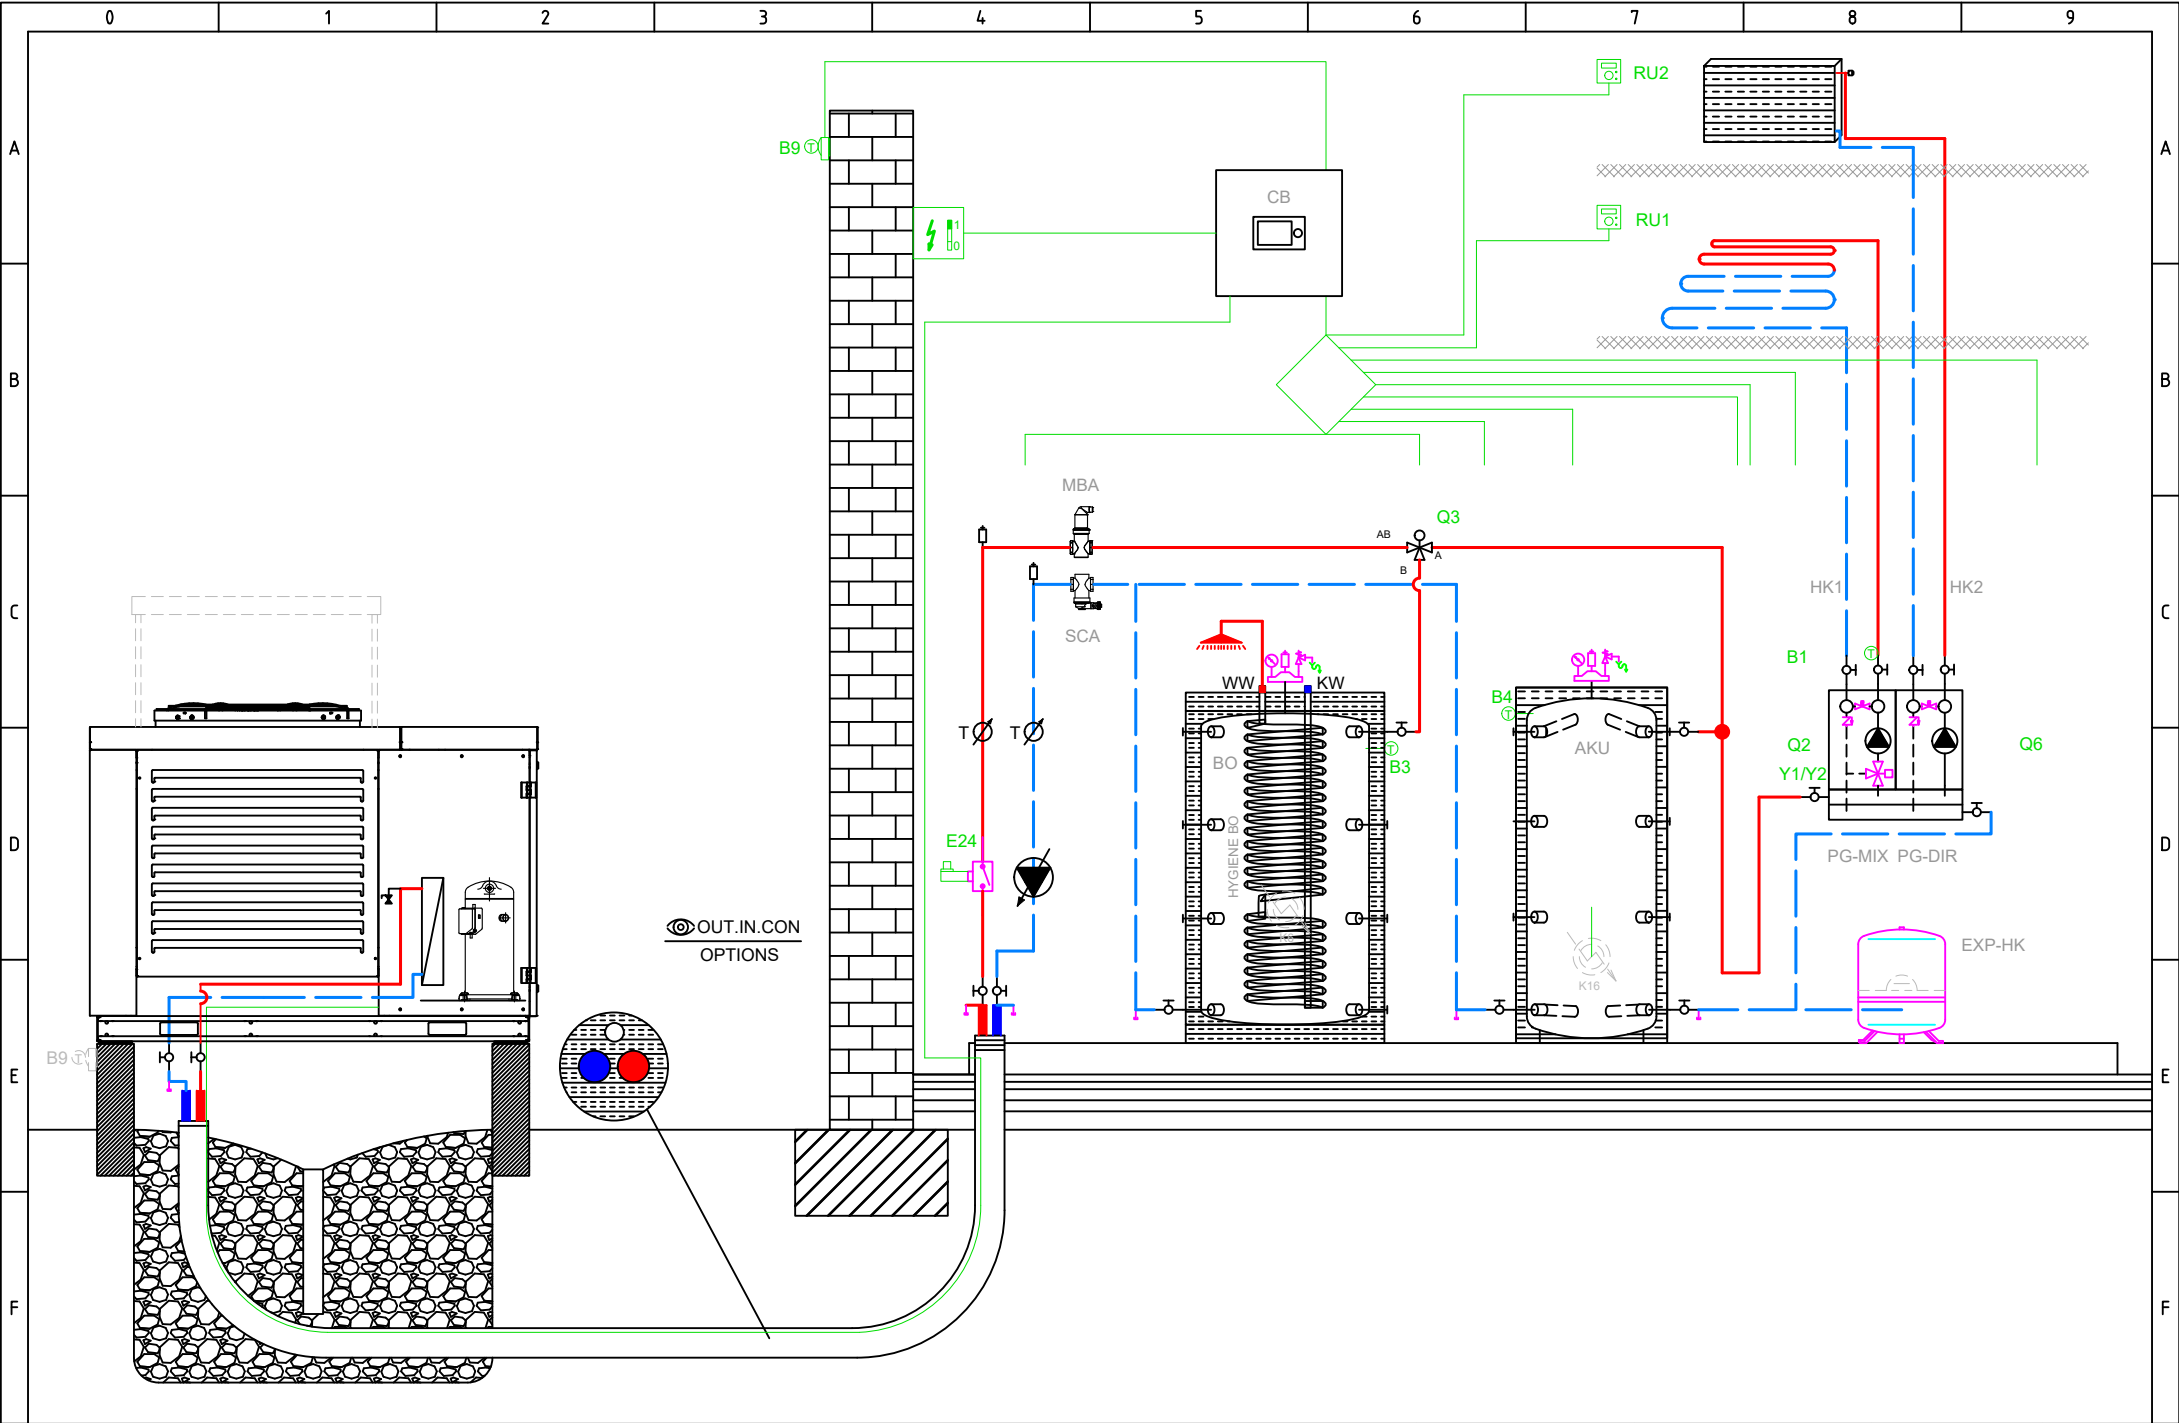

BASIC APPLICATION

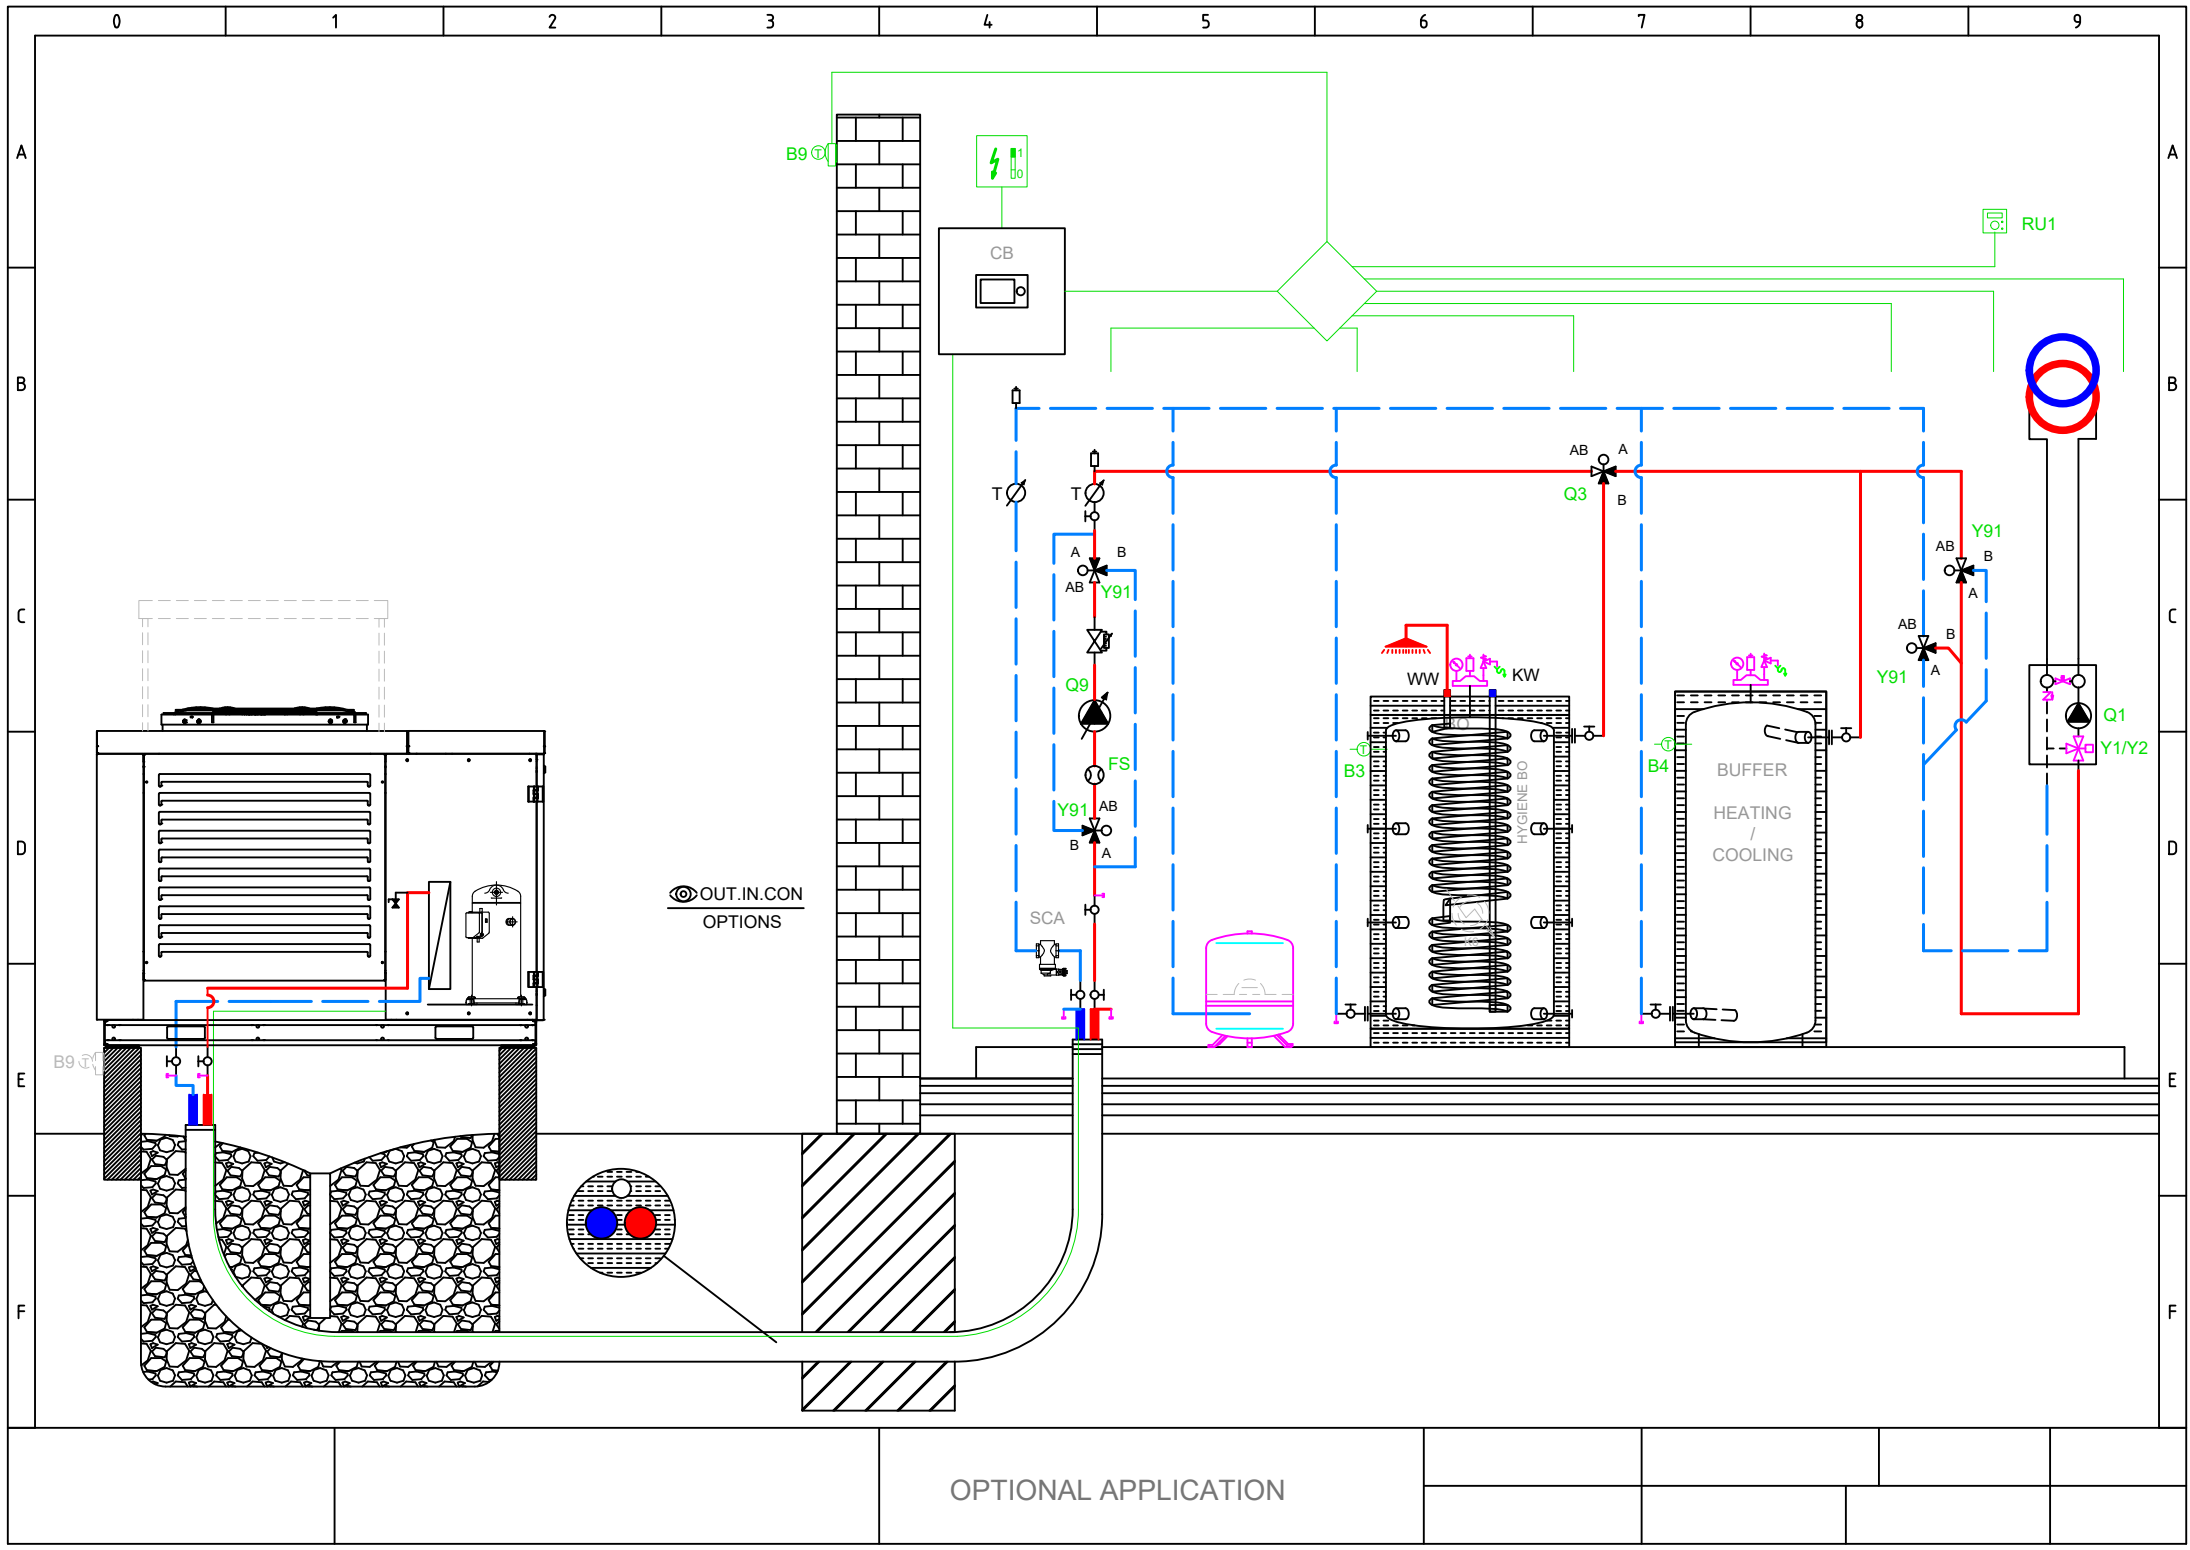

Main power supply 230V / 50 Hz  
Ground  
Neutral conductor

- E10 High-pressure switch E10
- E11 Overload compressor 1 E11
- E14 Overload source E14
- E24 Flow switch consumers E24
- K82 Valve EVI K82

K40 Crankcase heater K40


- L Phase 230V
- K1 Compressor stage 1 K1
- Y22 Process revers valve Y22

Q9 Condenser pump Q9

X10	1	L
X10	1	PE
X10	1	N
X11	1	EX1
X11	1	EX2
X11	1	EX3
X11	1	EX4
X12	1	QX1
X12	1	N
X12	1	QX2
X12	1	QX2i
X12	1	N
X12	1	FX3
X12	1	QX3
X15	1	QX4
X15	1	QX4i
X15	1	N
X15	1	QX5
X15	1	N
X15	1	ZX6
X15	1	N
X86	1	GX1
X86	1	H3
X86	1	M
X86	1	H1
X86	1	G+
X86	1	M
X86	1	BSB



Total: max 6A  
1 x QX...: max 2A

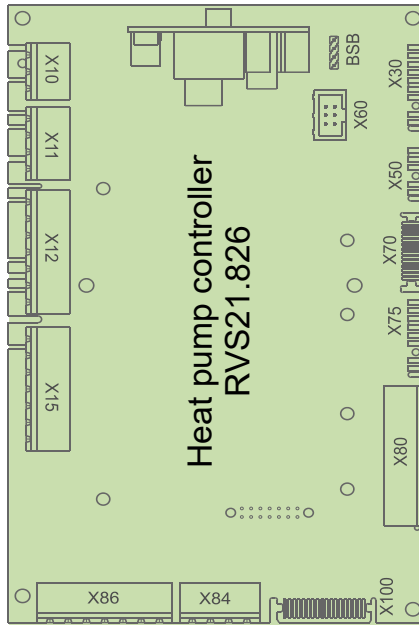

BSB
X30
X60
X50
X70

- BSB Connection service tool (OCI700)
- X30 Operating unit (HMI) AVS37.xxx
- X60 Modbus clip-in OCI351.01
- X50 Extension module AVS75.xxx
- X70 LPB clip-in

D1
D2
D3
UX3
M
DI6
DI7
M

- D1 Digital output 1 Heating
- D2 Digital output 2 Cooling
- D3 Digital output 3 HP On/Off

- DI6 Digital input 6 Defrosting
- DI7 Digital input 7 Alarm

BX1
M
BX2
M
UX1
M
UX2
M

- B91 Source inlet sensor B91
- B84 Source outl sens B92/B84
- K19 Fan K19
- 0..10 V Signal
- Q9 Condenser pump Q9
- PWM Signal

BX3
M
BX4
M


- B71 HP return sensor B71
- B9 Outside sensor B9

Main power supply 230V / 50 Hz  
Ground  
Neutral conductor

K10 Alarm output K10

V81 EEV evaporator V81



X10	1	L
X10	1	PE
X10	1	N
X110	1	QX31
X110	1	QX32
X110	1	N
X110	1	QX33
X110	1	N
X110	1	ZX34
X110	1	N
X115	1	QX35
X115	1	QX35i
X115	1	N

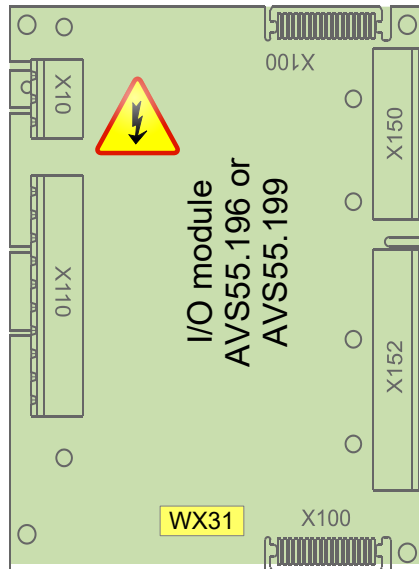


BSB
M
G+
H31
M
H32
GX1
H33
M
BX31
M
BX32
M
BX33
M
BX34
M

- 5 V/12 V for active sensors
- Flow measurement 10V
- Low pressure 0..10V
- 5 V/12 V for active sensors
- High pressure 0..10V
- B21 HP flow sensor B21
- B81 Hot-gas sensor B81
- B85 Suction gas sensor B85
- B83 Refrig sensor liquid B83


- AVS75.390
- AVS75.391
- AVS75.370

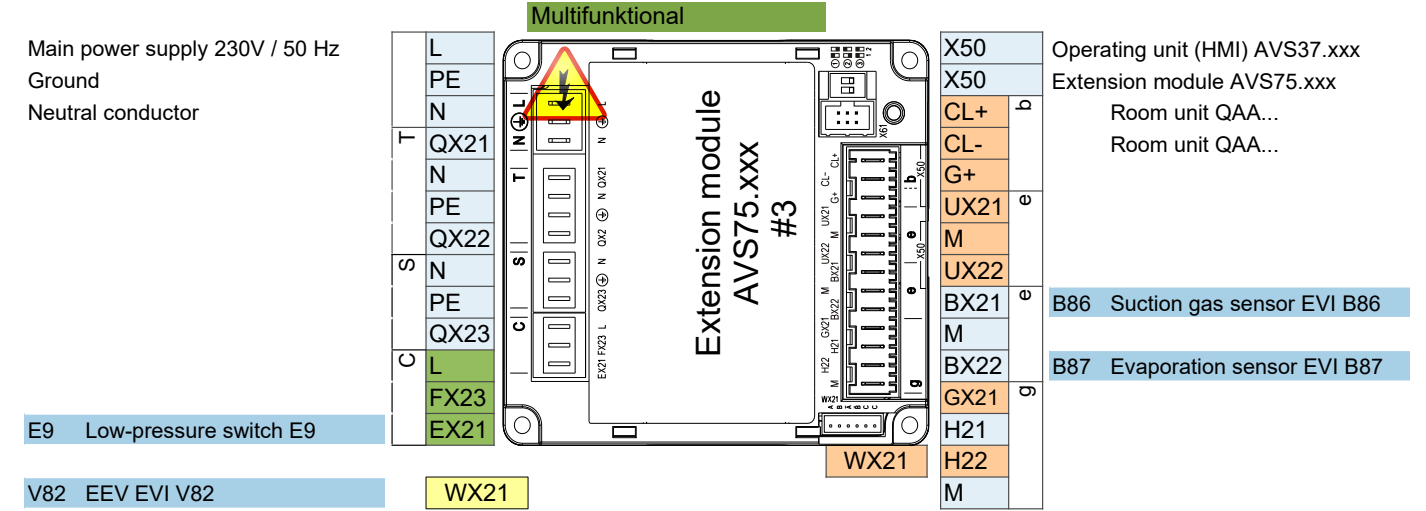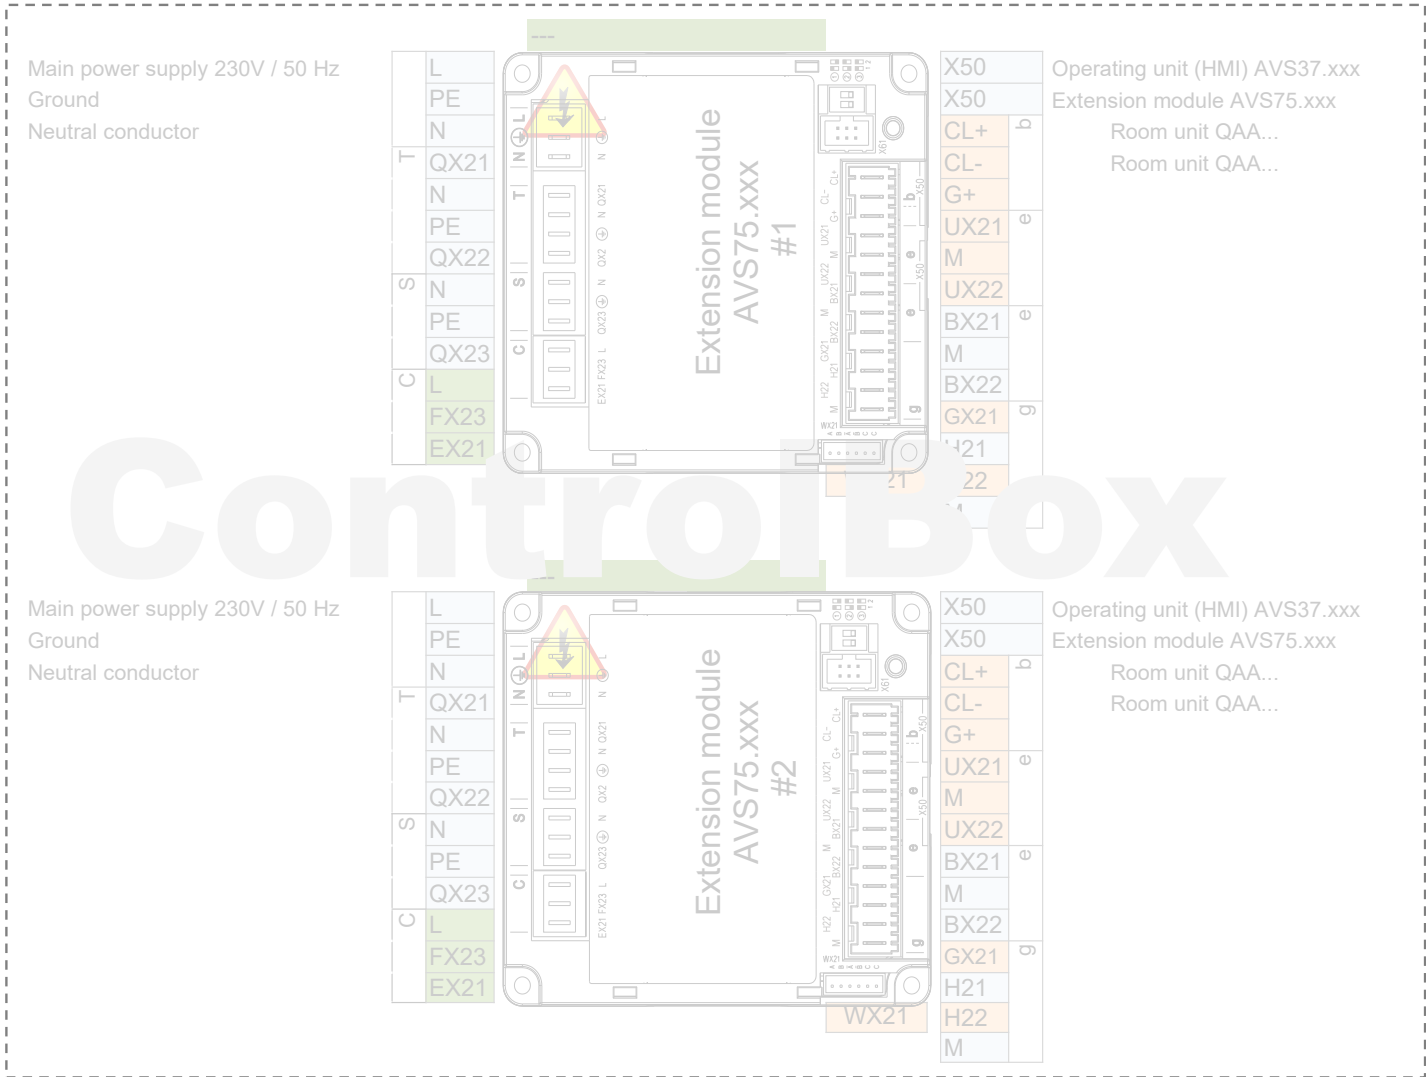

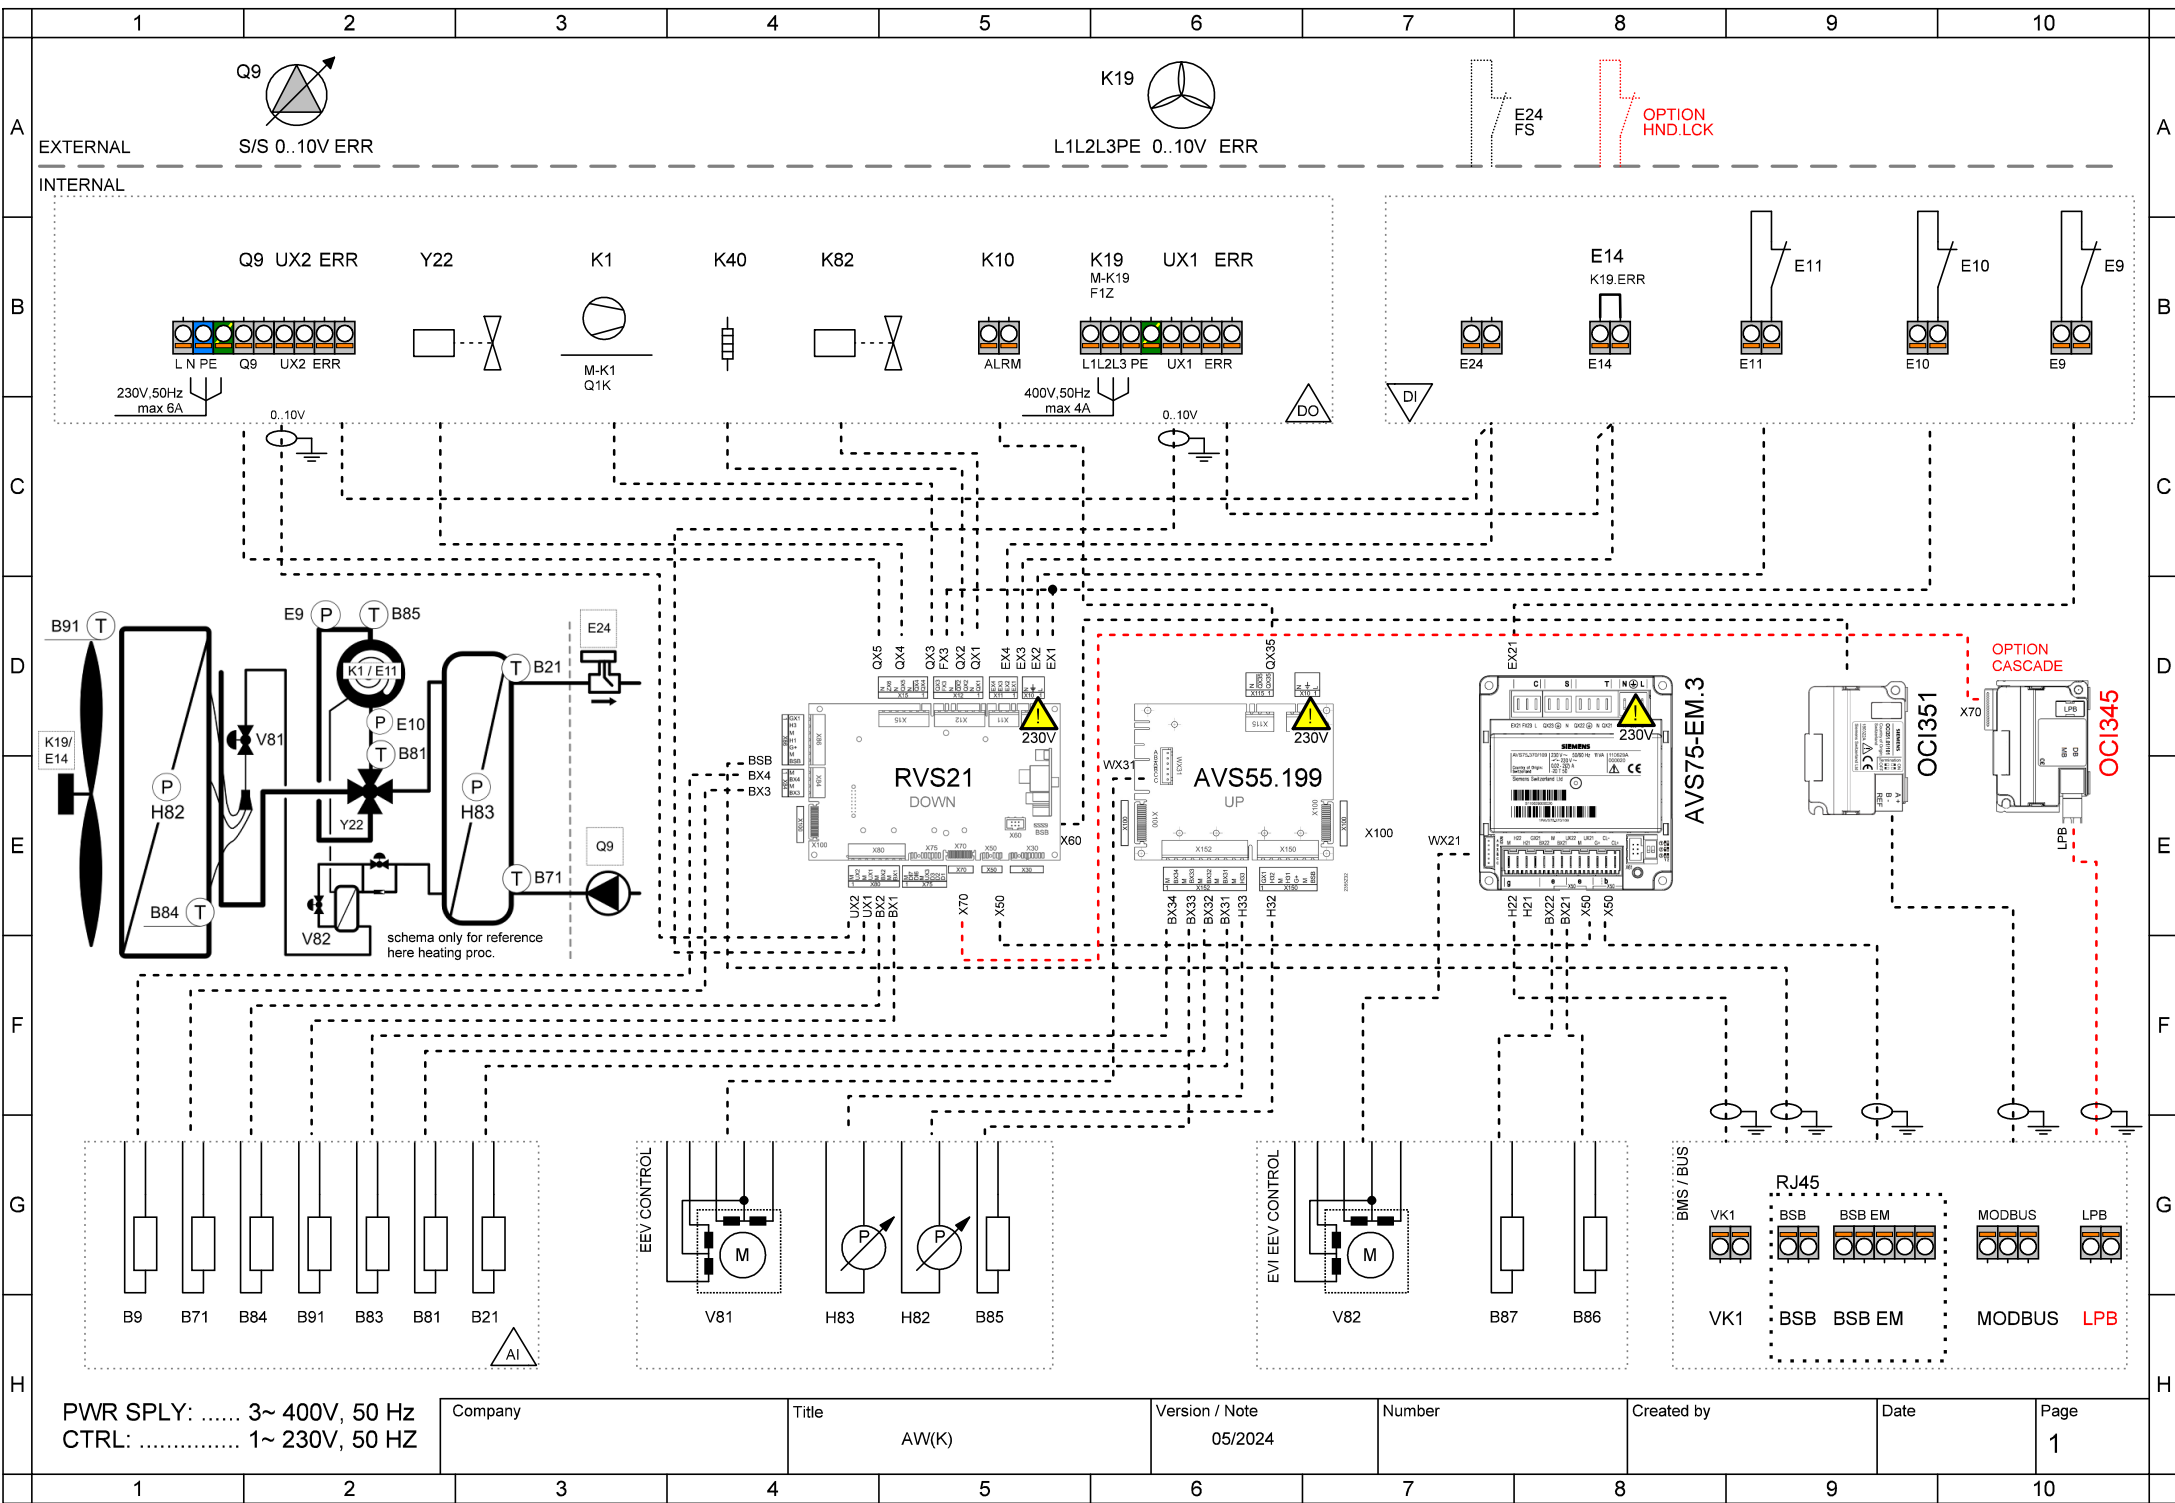

PWR SPLY: ..... 3~ 400V, 50 Hz  
 CTRL: ..... 1~ 230V, 50 HZ

Company	Title	Version / Note	Number	Created by	Date	Page
	AW(K)	05/2024				1

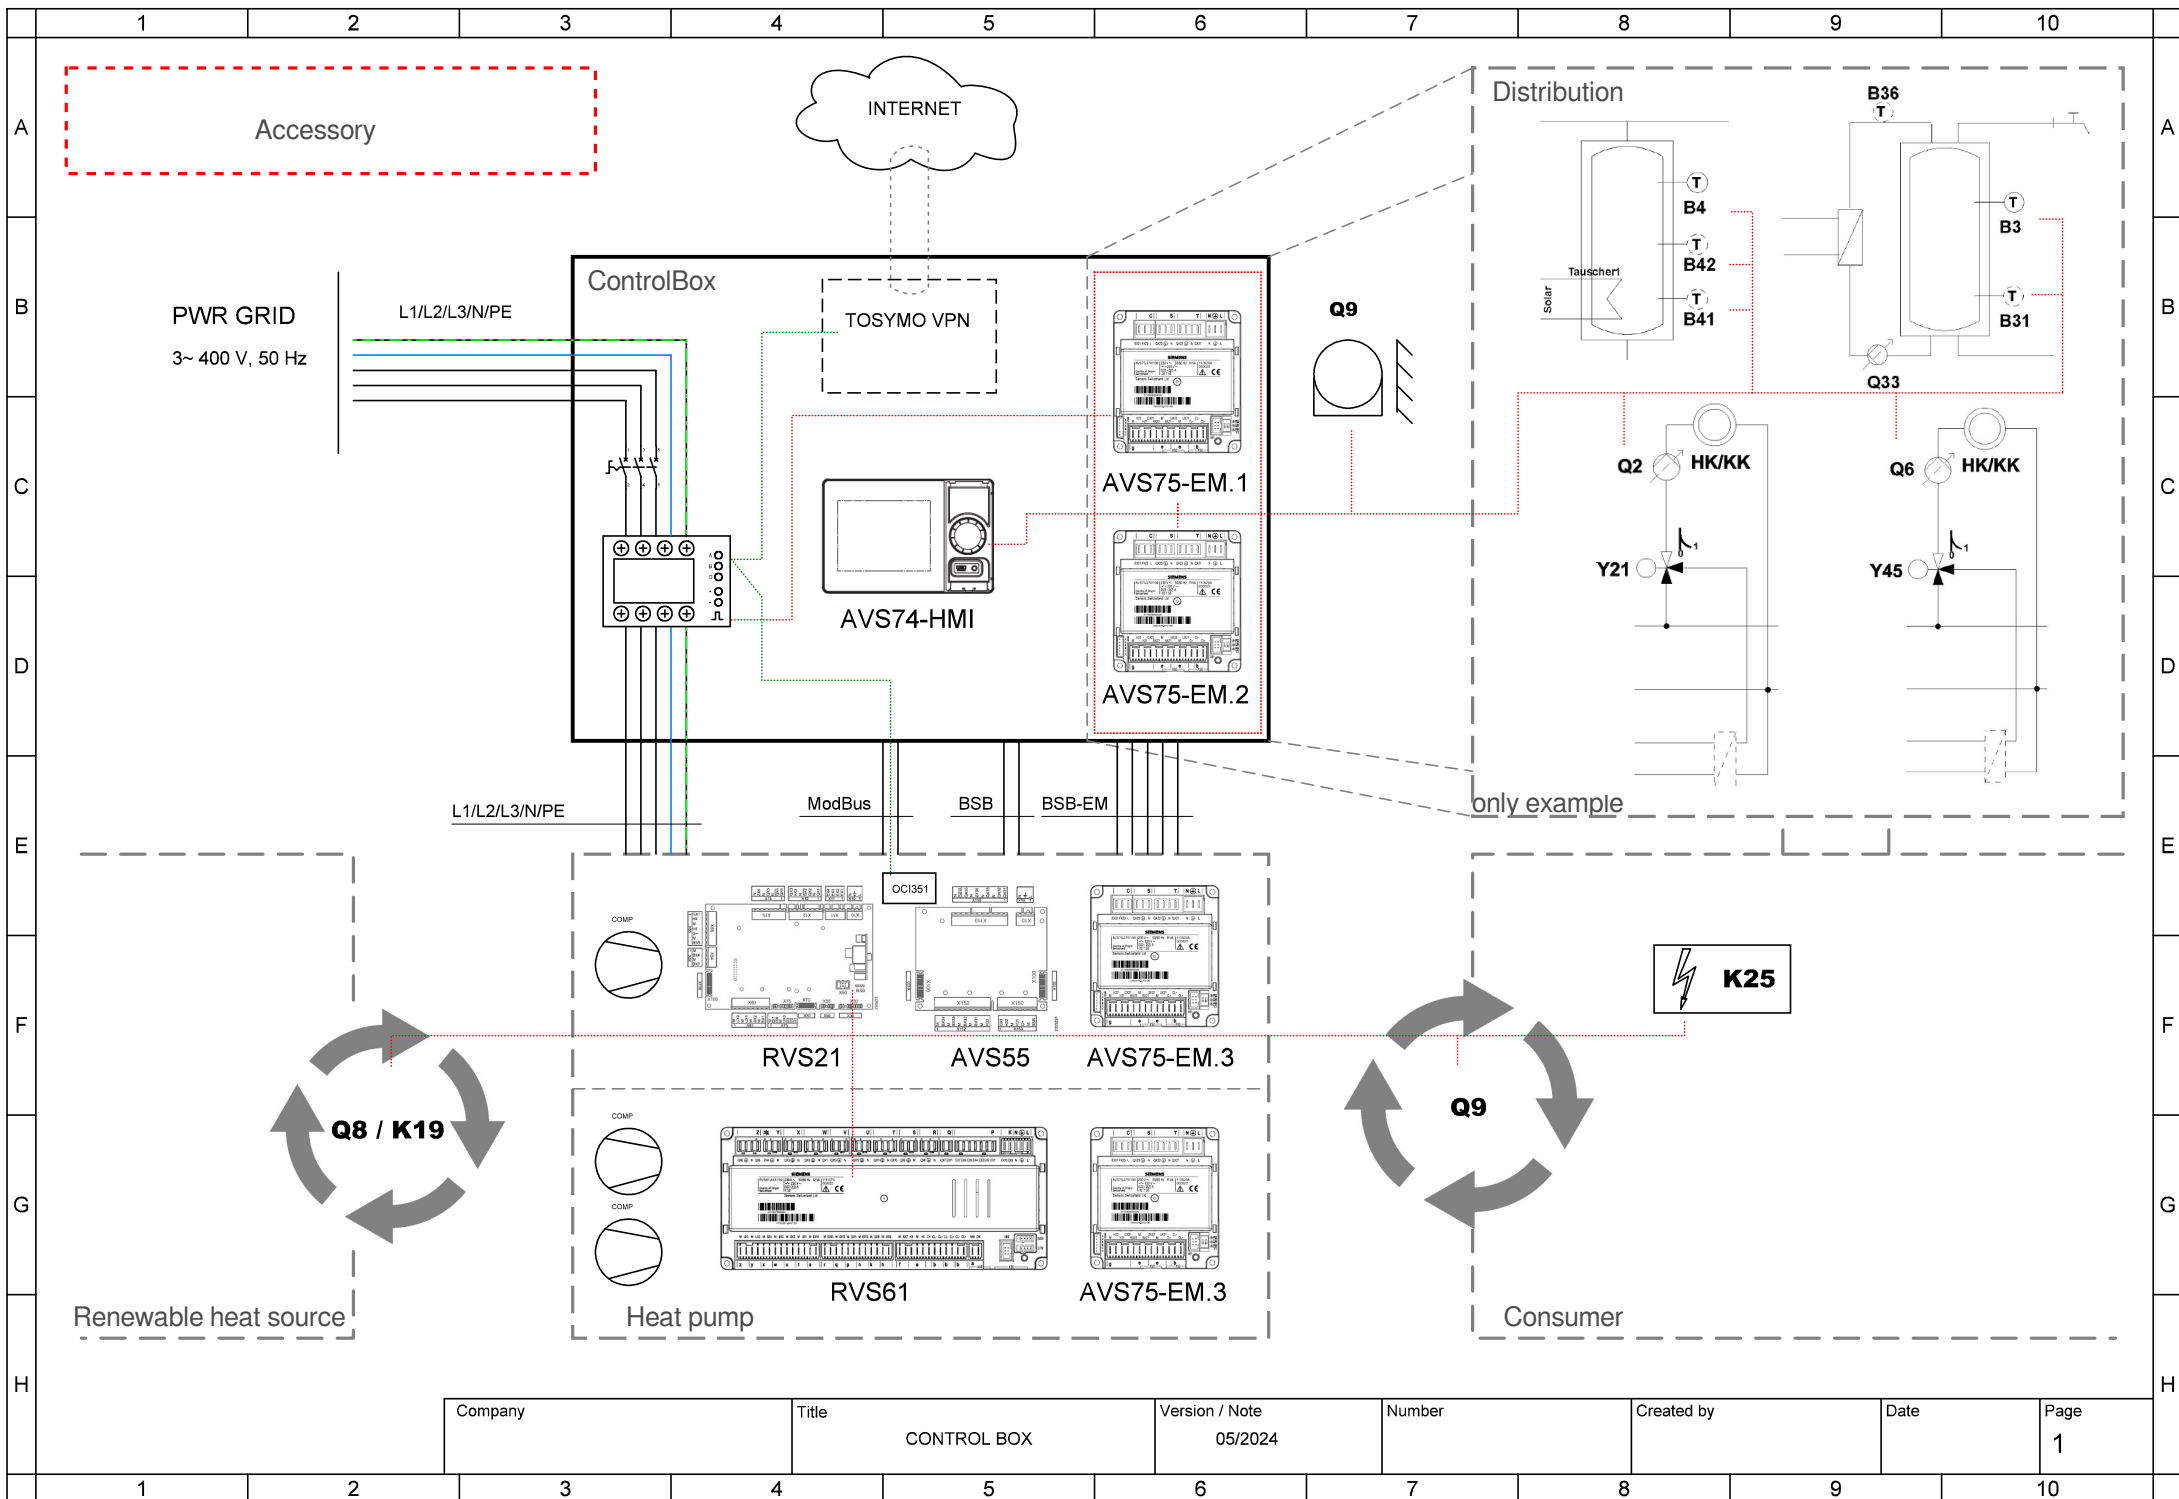

Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				1



Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				2




Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				3



Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				4


- AVS75.390
- AVS75.391
- AVS75.370

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Y1** Mixing valve Open  
  
**Y2** Mixing valve Close  
  
**Q2** Heat circuit pump HC1 Q2  
  
**L** Phase 230V  
**E61** Smart grid E61

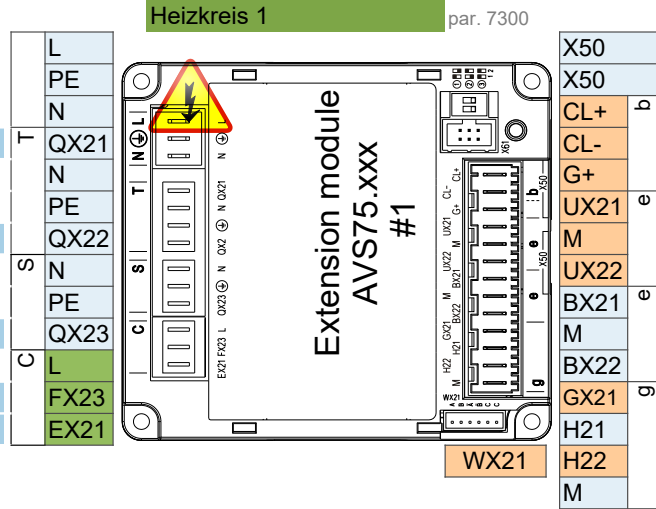


- Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B1** Flow sensor 1  
  
 Pulse count

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Q3** DHW ctrl elem Q3  
  
**K6** El imm heater DHW K6  
  
**Q6** Heat circuit pump HC2 Q6  
  
**L** Phase 230V  
**E62** Smart grid E62

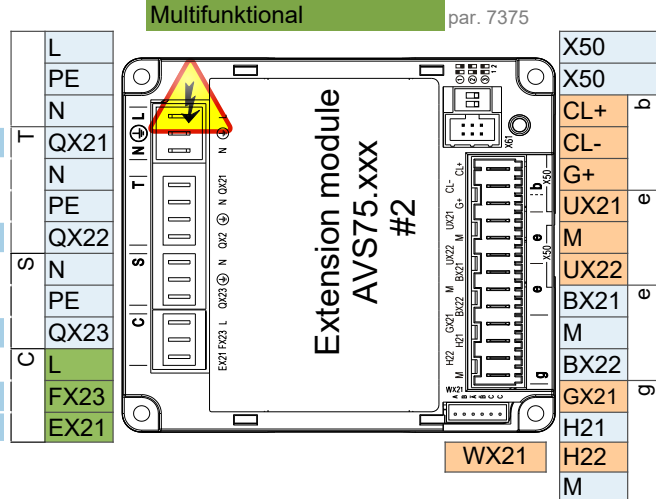

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B3** DHW sensor B3  
  
**B4** Buffer sensor B4

- Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor

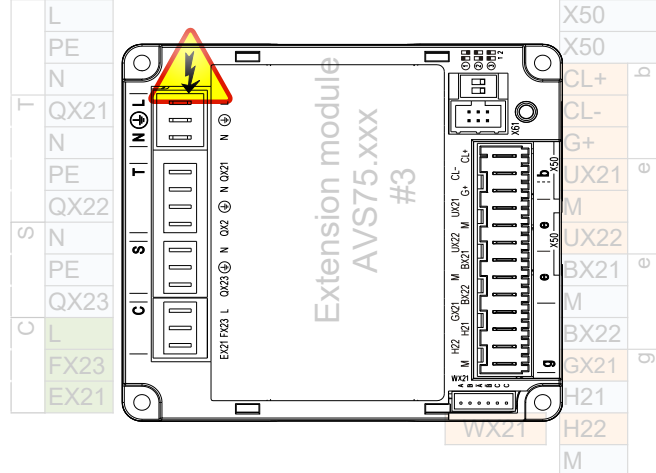

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...

Attention: Extension module 3 is inside the heat pump

## Control connection options

### 1 ControlBox

---

ControlBox, with two built-in extension modules, enables numerous options for application control on the consumer side behind the heat pump. For more, see the ControlBox schematic and the application diagrams sheet.

### 2 Fix flow temperature setpoint - On / Off dry (potential free) contact

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint = 45°C (editable by param. 1859)

Connection terminal - see wiring diagram

### 3 Analog 0..10V flow temperature setpoint control

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint: 0V = 16°C ~ 10V = 60°C ( editable in parameter set )

Connection terminal - see wiring diagram

### 4 ModBus RTU communication command

---

3 wire shielded cable min. 3 x 0.25mm<sup>2</sup>

For ModBus mapping table contact technical support

### 5 MQTT IoT communication protocol

---

For more information contact technical support