

## Basic performance data - WAMAK TWW 110 WHR HeavyDuty 2L1

Heating - EN 14511		
Heating capacity [kW]	W10 / W35 (max)	60.7 ( 30.4 / 60.7 )
	W10 / W35 (min)	30.4 ( 30.4 / 60.7 )
	W10 / W34	61.1 ( 30.5 / 61.1 )
Electrical power input [kW]	W10 / W35 (max)	10.3 ( 5.1 / 10.3 )
	W10 / W35 (min)	5.1 ( 5.1 / 10.3 )
	W10 / W34	10.1 ( 5.0 / 10.1 )
Heating efficiency faktor [COP]	W10 / W35 (max)	5.89
	W10 / W35 (min)	6.00
	W10 / W34	6.04
Seasonal space heating energy efficiency - SCOP EN 14825		
Average Climate / Low Temperature [35°C]	SCOP	6.66
	$\eta$ [ % ]	266.5
	Label	A+++
	Qhe [ kWh ]	18475.0
	Pdesignh [ kW ]	60.7
	Tbivalent [ °C ]	-7
Cooling		
Cooling capacity - [kW]	A35 / W23-18	46.0
	A25 / W23-18	51.7
	A35 / W12-7	29.9
	A25 / W12-7	29.9
Seasonal space cooling energy efficiency - SEER EN 14825		
[ W 23 / 18°C ]	SEER	5.30
	Qce [ kWh ]	17940.0
	$\eta_c$ [ % ]	212.1
Sound EN 12102		
Acoustic power - Lw	dB(A)	61.6
Acoustic pressure - Lp	1 m dB(A)	53.6
	5 m dB(A)	39.6
	10 m dB(A)	33.6
Mechanical and operational information		
Compressor type (3~ 400/50)	SCROLL / 2 /	On/Off
Refrigerant	R513A (GWP - 631)	11.2 kg
Operating limit temperatures heating - (min / max ) [°C]		45 / 85
Operating limit temperatures source - (min / max ) [°C]		-10 / 50
Weight		620 kg

## Main technical data - WAMAK TWW 110 WHR HeavyDuty 2L1

Enclosure type		HD2L1		Heat energy rejection side data		
Basic dimensions	Height [mm]	2000		Operating limit temperatures heating	MAX [°C]	85
	Width [mm]	820			MIN [°C]	45
	Length [mm]	1200		for more see operating limits diagram		
Weight [kg]	620		Condenser	Port size	VIC 2.1/2 "	
Colour	Gray			Type	BPHE	
Enclosure IP Class	IP20			Count	1	
Refrigeration cycle				Material	AISI 316	
Compressor	Type	Scroll		Maximal operating pressure - refrigerant [bar]		32
	Number of stages	2		Maximal operating pressure - Water [bar]		6
	On/Off			Testing pressure [bar]		70
	Power factor Cosφ	0.63		Heat transfer medium		Water
	Winding resistance	1.23 Ohm		Volume flow @ dT 5K (nom) - Water [m3/h]		7.28 ~ 14.55
Refrigerant		R513A		Internal pressure drop - Water [kPa]		20
	Volme	11.2 kg		Temperature difference	@ 35°C (nom)	5 K
	GWP	631			@ 55°C	8 K
	Safety class	A1			@ 65°C	10 K
Refrigeration oil type	POE RL32-3MAF		Renewable energy extraction side data			
	Oil volume	2 x 3.25 L		Operating limit temperatures source	MIN [°C]	-10
Maximal pressure - refrigerant [bar]	32		for more see operating limits diagram			
	PED class	2		Evaporator	MAX [°C]	50
EVI - vapour injection with economizer			Port size		VIC 2.1/2 "	
Electrical connection data			Type		BPHE	
Line voltage [#~ V/Hz]	3~ 400/50		Count	1		
Current	nominal [A]	34.44		Material	AISI 316	
	maximal [A]	44.60		Maximal operating pressure - refrigerant [bar]		20
	starting [A]	12.9		Heat transfer medium		Water
Softstart	-		Maximal operating pressure - Water [bar]		6	
Main safety	C80		Volume flow - Water [m3/h]		6.84 ~ 13.69	
Control System			Internal pressure drop - Water [kPa]		20	
Main controller	SIEMENS	RVS 61		Temperature difference - Water		4 K
Extension module	AVS75.3xx	AVS75.3xx	AVS75.372			
Bus Clip-In			Modbus OCI352			
Online connection	Web server OZW672		ToSyMo			
Superheat controller			SEC61			

\*\*\* with accessory

# WAMAK TWW 110 WHR HeavyDuty 2L1

## ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	TWW 110 WHR HeavyDuty 2L1
Air-to-water heat pump	no
Brine-to-water heat pump	no
Water-to-water heat pump	yes
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	low (35°C - 30°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	60.7	kW	Seasonal space heating energy efficiency	$\eta_s$	266.5	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	61.1	kW	Tj = -7 °C	COPd	6.04	-
Tj = +2 °C	Pdh	62.6	kW	Tj = +2 °C	COPd	6.6	-
Tj = +7 °C	Pdh	63.6	kW	Tj = +7 °C	COPd	7.3	-
Tj = +12 °C	Pdh	64.6	kW	Tj = +12 °C	COPd	7.8	-
Tj = bivalent temperature	Pdh	60.7	kW	Tj = bivalent temperature	COPd	5.9	-
Tj = operation limit temperature	Pdh	---	kW	Tj = operation limit temperature	COPd	---	-
Bivalent temperature	Tbiv	-7	°C	Tj = operation limit temperature	TOL	---	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	85	°C
Off mode	Poff	0.040	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	11.5	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.050	kW	For air-to-water heat pumps:			
Other items				Rated air flow rate, outdoors	-	---	m <sup>3</sup> /h
Capacity control	multi-stage			For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Sound power level							
indoors	Lwa	62	dB				
outdoors	Lwa	---	dB				
Annual energy consumption	Q <sub>HE</sub>	18475.0	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk

# WAMAK TWW 110 WHR HeavyDuty 2L1

## ErP (EU) No 811/2013: Technical parameters for heat pump space heaters

Model	TWW 110 WHR HeavyDuty 2L1
Air-to-water heat pump	no
Brine-to-water heat pump	no
Water-to-water heat pump	yes
Low-temperature heat pump	no
Equipped with a supplementary heater	no
Heat pump combination heater	no
Temperature application	middle (55°C - 47°C)
Climate conditions	average

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output at Tdesignh	Prated	53.0	kW	Seasonal space heating energy efficiency	$\eta_s$	201.0	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	55.4	kW	Tj = -7 °C	COPd	3.97	-
Tj = +2 °C	Pdh	59.8	kW	Tj = +2 °C	COPd	5.3	-
Tj = +7 °C	Pdh	61.9	kW	Tj = +7 °C	COPd	6.2	-
Tj = +12 °C	Pdh	63.6	kW	Tj = +12 °C	COPd	6.9	-
Tj = bivalent temperature	Pdh	53.0	kW	Tj = bivalent temperature	COPd	3.5	-
Tj = operation limit temperature	Pdh	---	kW	Tj = operation limit temperature	COPd	---	-
Bivalent temperature	Tbiv	-7	°C	Tj = operation limit temperature	TOL	---	°C
Power consumption in modes other than active mode				Heating water operating limit temperature	WTOL	85	°C
Off mode	Poff	0.040	kW	Supplementary heater			
Thermostat-off mode	Pto	0.010	kW	Rated heat output	Psup	11.5	kW
Standby mode	Psb	0.010	kW	Type of energy input	electricity		
Crankcase heater mode	Pck	0.050	kW	For air-to-water heat pumps: Rated air flow rate, outdoors			
Other items				For water- or brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger			
Capacity control	multi-stage			-			
Sound power level				6.84 ~ 13.69 m3/h			
indoors	Lwa	62	dB				
outdoors	Lwa	---	dB				
Annual energy consumption	QHE	21444.7	kWh				

**Contact details:** WAMAK, s.r.o., Orovnicna 252, 96652, Orovnicna, Slovakia, info@wamak.sk



**ENERG** Y IJA  
 енергия - ενεργεια IE IA



TWW 110 WHR  
 HeavyDuty 2L1



55 °C

35 °C



A+++

A+++



62 dB



--- dB

■ 56  
 ■ 53  
 ■ 52  
 kW

■ 62  
 ■ 61  
 ■ 58  
 kW



2019

811/2013

TWW 110 WHR  
 HeavyDuty 2L1

**ErP Data**

	55 °C	35 °C
Energy class	A+++	A+++
$\eta$ [%]	201.0	266.5
$P_{rated}$ [kW]	53	61
$Q_{HE}$ [kWh/y]	21445	18475
SCOP [-]	5.03	6.66
$T_{bivalent}$ [°C]	-7	-7

CONTROLLER



+ QAA55/75  
 - QAA55/75

class VII  
 class III

3.5% ↓  
 1.5% ↓

Heating performance data		Heat recovery		
Operating conditions		Qh	P	COP
W45 / W80		113.2	25.3	4.47
W30 / W70		84.1	20.8	4.04
W25 / W60		93.6	17.2	5.45

**Normative data: water - water application**

**Source - Water [10°C] / Low Temperature [35°C]**

Operating conditions		Qh	P	COP
1	W10 / W30-35	60.7	10.3	5.89
2	W10 / W30-35 ( MIN )	30.4	5.1	6.00
A	W10 / Wxx-34	61.1	10.1	6.04
B	W10 / Wxx-30	62.6	9.4	6.65
C	W10 / Wxx-27	63.6	8.9	7.26
D	W10 / Wxx-24	64.6	8.4	7.79
E	W10 / Wxx-35	60.7	10.3	5.89
F	W10 / Wxx-35	60.7	10.3	5.89

SCOP DATA EN 14825:2018	
<b>Source - Water [10°C] / Low Temperature [35°C]</b>	
SCOPon	6.79
SCOPnet	6.79
SCOP	6.66
η [ % ]	266.54
Label	A+++
Qh [ kWh ]	18475
Pdesignh [ kW ]	60.7
Tbivalent [ °C ]	-7.00

**Source - Water [10°C] / Medium Temperature [55°C]**

Operating conditions		Qh	P	COP
1	W10 / W47-55	53.0	15.1	3.50
2	W10 / W47-55 ( MIN )	26.5	7.4	3.56
A	W10 / Wxx-52	55.4	14.0	3.97
B	W10 / Wxx-42	59.8	11.3	5.29
C	W10 / Wxx-36	61.9	10.2	6.16
D	W10 / Wxx-30	63.6	9.4	6.87
E	W10 / Wxx-55	53.0	15.1	3.50
F	W10 / Wxx-55	53.0	15.1	3.50

SCOP DATA EN 14825:2018	
<b>Source - Water [10°C] / Medium Temperature [55°C]</b>	
SCOPon	5.11
SCOPnet	5.11
SCOP	5.03
η [ % ]	201.01
Label	A+++
Qh [ kWh ]	21445
Pdesignh [ kW ]	53.0
Tbivalent [ °C ]	-7.00

**Low temperature cooling W 12 / 7°C**


Operating conditions				Qc	P	EER	SEER DATA EN 14825:2018 [ W 12 / 7°C ]	
A	W30-35 / W12-7	32.2	10.9	2.95	SEERon	3.64		
B	W26-xx / W12-7	33.9	10.1	3.35	SEER	3.56		
C	W22-xx / W12-7	35.5	9.4	3.77	Qc [ kWh ]	17940		
D	W18-xx / W12-7	36.3	9.1	4.00	η [ % ]	142.41		

**Radiant cooling W 23 / 18°C**

Operating conditions				Qc	P	EER	SEER DATA EN 14825:2018 [ W 23 / 18°C ]	
A	W50-xx / W23-18	36.2	16.4	2.21	SEERon	5.48		
B	W40-xx / W23-18	42.9	13.3	3.23	SEER	5.30		
C	W30-35 / W23-18	48.9	10.9	4.49	Qc [ kWh ]	17940		
D	W26-xx / W23-18	51.2	10.1	5.06	η [ % ]	212.07		


Performance lines - heating

- Qh-nom-35
- Qh-nom-55
- Qh-nom-60
- Qh-nom-70
- Qh-nom-80
- - - Qh-min-70

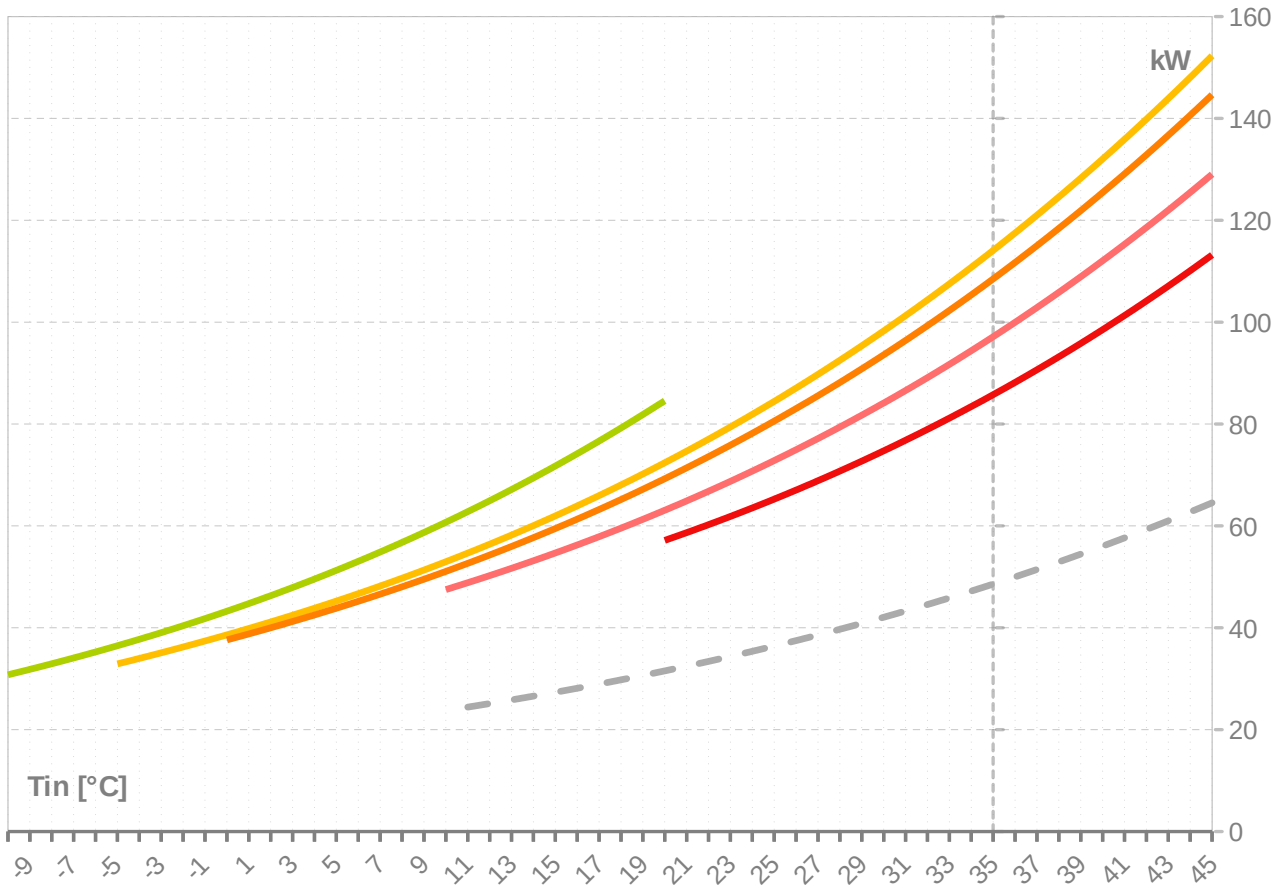

Performance lines - cooling

- Qc-nom-12-7
- Qc-nom-23-18

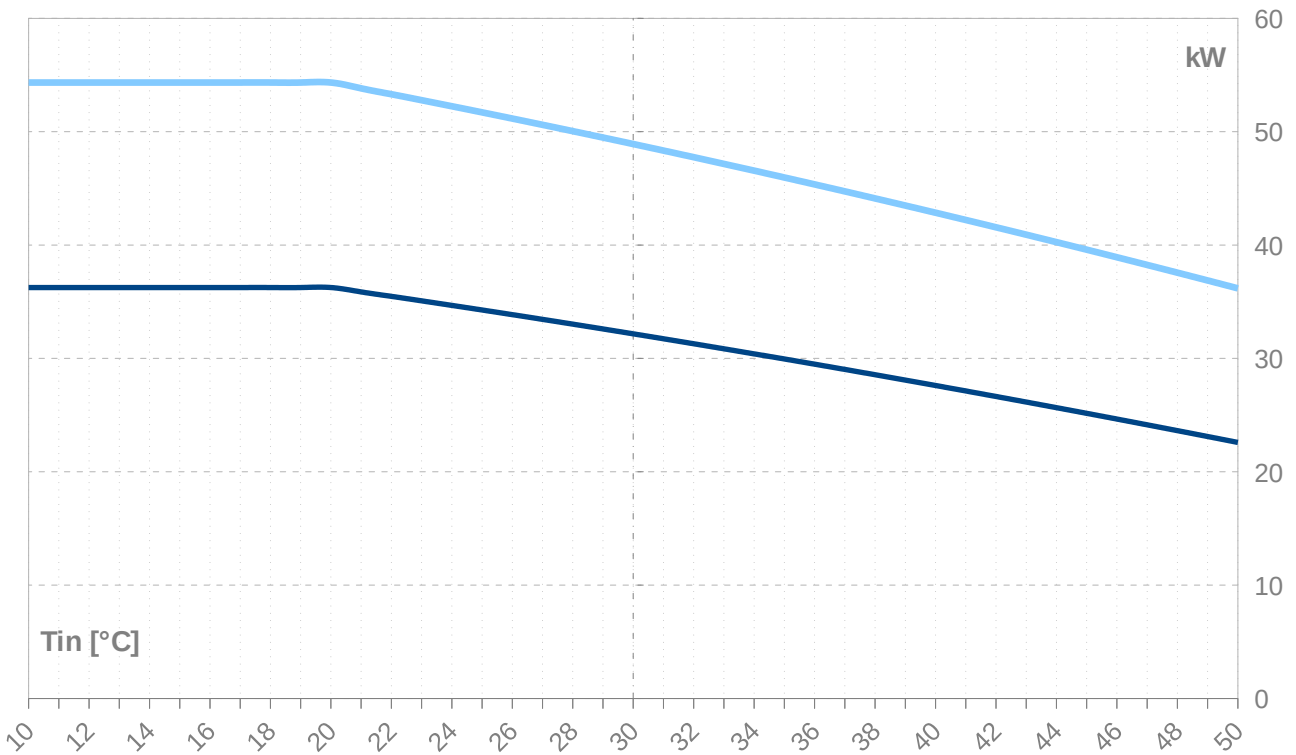

# WAMAK TWW 110 WHR HeavyDuty 2L1

Th -OU	55										
[°C]	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kw / kw	[kW]	[kW]	[kW]	[A]
45	<b>152.3</b>	76.1	152.3	<b>16.3</b>	8.0	16.3	<b>9.32</b>	137.1	68.6	137.1	29.3
44	<b>148.0</b>	74.0	148.0	<b>16.3</b>	8.0	16.3	<b>9.09</b>	132.9	66.5	132.9	29.3
43	<b>143.9</b>	71.9	143.9	<b>16.2</b>	8.0	16.2	<b>8.86</b>	128.8	64.4	128.8	29.2
42	<b>139.8</b>	69.9	139.8	<b>16.2</b>	8.0	16.2	<b>8.64</b>	124.8	62.4	124.8	29.1
41	<b>135.9</b>	67.9	135.9	<b>16.1</b>	7.9	16.1	<b>8.42</b>	120.9	60.5	120.9	29.1
40	<b>132.0</b>	66.0	132.0	<b>16.1</b>	7.9	16.1	<b>8.21</b>	117.1	58.6	117.1	29.0
39	<b>128.3</b>	64.1	128.3	<b>16.0</b>	7.9	16.0	<b>8.00</b>	113.4	56.7	113.4	29.0
38	<b>124.6</b>	62.3	124.6	<b>16.0</b>	7.9	16.0	<b>7.79</b>	109.8	54.9	109.8	28.9
37	<b>121.0</b>	60.5	121.0	<b>15.9</b>	7.8	15.9	<b>7.59</b>	106.2	53.1	106.2	28.8
36	<b>117.5</b>	58.7	117.5	<b>15.9</b>	7.8	15.9	<b>7.39</b>	102.8	51.4	102.8	28.8
35	<b>114.1</b>	57.0	114.1	<b>15.9</b>	7.8	15.9	<b>7.20</b>	99.4	49.7	99.4	28.7
34	<b>110.8</b>	55.4	110.8	<b>15.8</b>	7.8	15.8	<b>7.00</b>	96.1	48.0	96.1	28.7
33	<b>107.5</b>	53.8	107.5	<b>15.8</b>	7.8	15.8	<b>6.82</b>	92.9	46.4	92.9	28.6
32	<b>104.4</b>	52.2	104.4	<b>15.7</b>	7.7	15.7	<b>6.63</b>	89.8	44.9	89.8	28.6
31	<b>101.3</b>	50.6	101.3	<b>15.7</b>	7.7	15.7	<b>6.45</b>	86.7	43.4	86.7	28.5
30	<b>98.3</b>	49.1	98.3	<b>15.7</b>	7.7	15.7	<b>6.28</b>	83.8	41.9	83.8	28.5
29	<b>95.4</b>	47.7	95.4	<b>15.6</b>	7.7	15.6	<b>6.11</b>	80.9	40.4	80.9	28.5
28	<b>92.5</b>	46.3	92.5	<b>15.6</b>	7.7	15.6	<b>5.94</b>	78.1	39.0	78.1	28.4
27	<b>89.8</b>	44.9	89.8	<b>15.5</b>	7.6	15.5	<b>5.77</b>	75.3	37.7	75.3	28.4
26	<b>87.1</b>	43.5	87.1	<b>15.5</b>	7.6	15.5	<b>5.61</b>	72.7	36.3	72.7	28.3
25	<b>84.4</b>	42.2	84.4	<b>15.5</b>	7.6	15.5	<b>5.45</b>	70.1	35.0	70.1	28.3
24	<b>81.9</b>	40.9	81.9	<b>15.4</b>	7.6	15.4	<b>5.30</b>	67.6	33.8	67.6	28.3
23	<b>79.4</b>	39.7	79.4	<b>15.4</b>	7.6	15.4	<b>5.15</b>	65.1	32.6	65.1	28.2
22	<b>77.0</b>	38.5	77.0	<b>15.4</b>	7.6	15.4	<b>5.00</b>	62.7	31.4	62.7	28.2
21	<b>74.7</b>	37.3	74.7	<b>15.4</b>	7.6	15.4	<b>4.86</b>	60.4	30.2	60.4	28.2
20	<b>72.4</b>	36.2	72.4	<b>15.3</b>	7.5	15.3	<b>4.72</b>	58.2	29.1	58.2	28.1
19	<b>70.2</b>	35.1	70.2	<b>15.3</b>	7.5	15.3	<b>4.58</b>	56.0	28.0	56.0	28.1
18	<b>68.0</b>	34.0	68.0	<b>15.3</b>	7.5	15.3	<b>4.45</b>	53.9	26.9	53.9	28.1
17	<b>65.9</b>	33.0	65.9	<b>15.3</b>	7.5	15.3	<b>4.32</b>	51.8	25.9	51.8	28.0
16	<b>63.9</b>	32.0	63.9	<b>15.2</b>	7.5	15.2	<b>4.19</b>	49.8	24.9	49.8	28.0
15	<b>62.0</b>	31.0	62.0	<b>15.2</b>	7.5	15.2	<b>4.07</b>	47.8	23.9	47.8	28.0
14	<b>60.0</b>	30.0	60.0	<b>15.2</b>	7.5	15.2	<b>3.95</b>	45.9	23.0	45.9	28.0
13	<b>58.2</b>	29.1	58.2	<b>15.2</b>	7.5	15.2	<b>3.83</b>	44.1	22.1	44.1	27.9
12	<b>56.4</b>	28.2	56.4	<b>15.2</b>	7.5	15.2	<b>3.72</b>	42.3	21.2	42.3	27.9
11	<b>54.7</b>	27.3	54.7	<b>15.2</b>	7.4	15.2	<b>3.61</b>	40.6	20.3	40.6	27.9
10	<b>53.0</b>	26.5	53.0	<b>15.1</b>	7.4	15.1	<b>3.50</b>	38.9	19.5	38.9	27.9
9	<b>51.3</b>	25.7	51.3	<b>15.1</b>	7.4	15.1	<b>3.39</b>	37.3	18.6	37.3	27.9
8	<b>49.7</b>	24.9	49.7	<b>15.1</b>	7.4	15.1	<b>3.29</b>	35.7	17.9	35.7	27.9
7	<b>48.2</b>	24.1	48.2	<b>15.1</b>	7.4	15.1	<b>3.19</b>	34.2	17.1	34.2	27.9
6	<b>46.7</b>	23.3	46.7	<b>15.1</b>	7.4	15.1	<b>3.09</b>	32.7	16.3	32.7	27.8
5	<b>45.2</b>	22.6	45.2	<b>15.1</b>	7.4	15.1	<b>3.00</b>	31.3	15.6	31.3	27.8
4	<b>43.8</b>	21.9	43.8	<b>15.1</b>	7.4	15.1	<b>2.91</b>	29.9	14.9	29.9	27.8
3	<b>42.5</b>	21.2	42.5	<b>15.1</b>	7.4	15.1	<b>2.82</b>	28.5	14.2	28.5	27.8
2	<b>41.1</b>	20.6	41.1	<b>15.1</b>	7.4	15.1	<b>2.73</b>	27.2	13.6	27.2	27.8
1	<b>39.9</b>	19.9	39.9	<b>15.1</b>	7.4	15.1	<b>2.65</b>	25.9	12.9	25.9	27.8
0	<b>38.6</b>	19.3	38.6	<b>15.1</b>	7.4	15.1	<b>2.57</b>	24.6	12.3	24.6	27.8
-1	<b>37.4</b>	18.7	37.4	<b>15.0</b>	7.4	15.0	<b>2.48</b>	23.4	11.7	23.4	27.8
-2	<b>36.2</b>	18.1	36.2	<b>15.0</b>	7.4	15.0	<b>2.41</b>	22.3	11.1	22.3	27.8
-3	<b>35.1</b>	17.5	35.1	<b>15.0</b>	7.4	15.0	<b>2.33</b>	21.1	10.6	21.1	27.8
-4	<b>34.0</b>	17.0	34.0	<b>15.1</b>	7.4	15.1	<b>2.26</b>	20.0	10.0	20.0	27.8
-5	<b>32.9</b>	16.4	32.9	<b>15.1</b>	7.4	15.1	<b>2.19</b>	18.9	9.5	18.9	27.8

-- attention: operating limits not reflected in performance table

ZR144KRE-TFD\_R513A\_2\_WHR

**WAMAK TWW 110 WHR HeavyDuty 2L1**

Th -OU	60										
[°C]	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kw / kw	[kW]	[kW]	[kW]	[A]
45	<b>144.6</b>	72.3	144.6	<b>17.7</b>	8.7	17.7	<b>8.16</b>	128.2	64.1	128.2	31.0
44	<b>140.6</b>	70.3	140.6	<b>17.7</b>	8.7	17.7	<b>7.95</b>	124.2	62.1	124.2	31.0
43	<b>136.7</b>	68.3	136.7	<b>17.6</b>	8.7	17.6	<b>7.75</b>	120.3	60.2	120.3	30.9
42	<b>132.8</b>	66.4	132.8	<b>17.6</b>	8.6	17.6	<b>7.55</b>	116.5	58.3	116.5	30.8
41	<b>129.1</b>	64.6	129.1	<b>17.6</b>	8.6	17.6	<b>7.36</b>	112.8	56.4	112.8	30.8
40	<b>125.5</b>	62.7	125.5	<b>17.5</b>	8.6	17.5	<b>7.16</b>	109.2	54.6	109.2	30.7
39	<b>121.9</b>	60.9	121.9	<b>17.5</b>	8.6	17.5	<b>6.98</b>	105.7	52.8	105.7	30.7
38	<b>118.4</b>	59.2	118.4	<b>17.4</b>	8.6	17.4	<b>6.79</b>	102.2	51.1	102.2	30.7
37	<b>115.0</b>	57.5	115.0	<b>17.4</b>	8.6	17.4	<b>6.61</b>	98.9	49.4	98.9	30.6
36	<b>111.7</b>	55.9	111.7	<b>17.4</b>	8.5	17.4	<b>6.44</b>	95.6	47.8	95.6	30.6
35	<b>108.5</b>	54.2	108.5	<b>17.3</b>	8.5	17.3	<b>6.26</b>	92.4	46.2	92.4	30.5
34	<b>105.4</b>	52.7	105.4	<b>17.3</b>	8.5	17.3	<b>6.09</b>	89.3	44.7	89.3	30.5
33	<b>102.3</b>	51.1	102.3	<b>17.3</b>	8.5	17.3	<b>5.93</b>	86.3	43.1	86.3	30.4
32	<b>99.3</b>	49.7	99.3	<b>17.2</b>	8.5	17.2	<b>5.77</b>	83.3	41.7	83.3	30.4
31	<b>96.4</b>	48.2	96.4	<b>17.2</b>	8.5	17.2	<b>5.61</b>	80.5	40.2	80.5	30.4
30	<b>93.6</b>	46.8	93.6	<b>17.2</b>	8.4	17.2	<b>5.45</b>	77.7	38.8	77.7	30.3
29	<b>90.8</b>	45.4	90.8	<b>17.1</b>	8.4	17.1	<b>5.30</b>	74.9	37.5	74.9	30.3
28	<b>88.2</b>	44.1	88.2	<b>17.1</b>	8.4	17.1	<b>5.15</b>	72.3	36.1	72.3	30.3
27	<b>85.6</b>	42.8	85.6	<b>17.1</b>	8.4	17.1	<b>5.01</b>	69.7	34.9	69.7	30.2
26	<b>83.0</b>	41.5	83.0	<b>17.1</b>	8.4	17.1	<b>4.87</b>	67.2	33.6	67.2	30.2
25	<b>80.6</b>	40.3	80.6	<b>17.0</b>	8.4	17.0	<b>4.73</b>	64.8	32.4	64.8	30.2
24	<b>78.2</b>	39.1	78.2	<b>17.0</b>	8.4	17.0	<b>4.60</b>	62.4	31.2	62.4	30.1
23	<b>75.8</b>	37.9	75.8	<b>17.0</b>	8.3	17.0	<b>4.47</b>	60.1	30.0	60.1	30.1
22	<b>73.6</b>	36.8	73.6	<b>17.0</b>	8.3	17.0	<b>4.34</b>	57.9	28.9	57.9	30.1
21	<b>71.4</b>	35.7	71.4	<b>16.9</b>	8.3	16.9	<b>4.21</b>	55.7	27.8	55.7	30.1
20	<b>69.3</b>	34.6	69.3	<b>16.9</b>	8.3	16.9	<b>4.09</b>	53.6	26.8	53.6	30.0
19	<b>67.2</b>	33.6	67.2	<b>16.9</b>	8.3	16.9	<b>3.97</b>	51.5	25.7	51.5	30.0
18	<b>65.2</b>	32.6	65.2	<b>16.9</b>	8.3	16.9	<b>3.86</b>	49.5	24.8	49.5	30.0
17	<b>63.2</b>	31.6	63.2	<b>16.9</b>	8.3	16.9	<b>3.75</b>	47.6	23.8	47.6	30.0
16	<b>61.3</b>	30.7	61.3	<b>16.9</b>	8.3	16.9	<b>3.64</b>	45.7	22.8	45.7	30.0
15	<b>59.5</b>	29.7	59.5	<b>16.8</b>	8.3	16.8	<b>3.53</b>	43.9	21.9	43.9	30.0
14	<b>57.7</b>	28.8	57.7	<b>16.8</b>	8.3	16.8	<b>3.43</b>	42.1	21.0	42.1	29.9
13	<b>56.0</b>	28.0	56.0	<b>16.8</b>	8.3	16.8	<b>3.33</b>	40.4	20.2	40.4	29.9
12	<b>54.3</b>	27.1	54.3	<b>16.8</b>	8.3	16.8	<b>3.23</b>	38.7	19.3	38.7	29.9
11	<b>52.6</b>	26.3	52.6	<b>16.8</b>	8.3	16.8	<b>3.13</b>	37.1	18.5	37.1	29.9
10	<b>51.1</b>	25.5	51.1	<b>16.8</b>	8.3	16.8	<b>3.04</b>	35.5	17.7	35.5	29.9
9	<b>49.5</b>	24.8	49.5	<b>16.8</b>	8.3	16.8	<b>2.95</b>	34.0	17.0	34.0	29.9
8	<b>48.0</b>	24.0	48.0	<b>16.8</b>	8.2	16.8	<b>2.86</b>	32.5	16.2	32.5	29.9
7	<b>46.6</b>	23.3	46.6	<b>16.8</b>	8.2	16.8	<b>2.78</b>	31.0	15.5	31.0	29.9
6	<b>45.2</b>	22.6	45.2	<b>16.8</b>	8.2	16.8	<b>2.69</b>	29.6	14.8	29.6	29.9
5	<b>43.8</b>	21.9	43.8	<b>16.8</b>	8.2	16.8	<b>2.61</b>	28.3	14.1	28.3	29.9
4	<b>42.5</b>	21.3	42.5	<b>16.8</b>	8.2	16.8	<b>2.54</b>	27.0	13.5	27.0	29.9
3	<b>41.2</b>	20.6	41.2	<b>16.8</b>	8.2	16.8	<b>2.46</b>	25.7	12.8	25.7	29.9
2	<b>40.0</b>	20.0	40.0	<b>16.8</b>	8.2	16.8	<b>2.39</b>	24.4	12.2	24.4	29.9
1	<b>38.8</b>	19.4	38.8	<b>16.8</b>	8.2	16.8	<b>2.31</b>	23.2	11.6	23.2	29.9
0	<b>37.6</b>	18.8	37.6	<b>16.8</b>	8.2	16.8	<b>2.24</b>	22.1	11.0	22.1	29.9
-1											
-2											
-3											
-4											
-5											

-- attention: operating limits not reflected in performance table

**WAMAK TWW 110 WHR HeavyDuty 2L1**

Th -OU	70											
	°C	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom
°C	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW / kW]	[kW]	[kW]	[kW]	[kW]	[A]
45	<b>129.0</b>	64.5	129.0	<b>21.0</b>	10.3	21.0	<b>6.13</b>	109.5	54.8	109.5	35.3	
44	<b>125.5</b>	62.7	125.5	<b>21.0</b>	10.3	21.0	<b>5.97</b>	106.0	53.0	106.0	35.2	
43	<b>122.0</b>	61.0	122.0	<b>21.0</b>	10.3	21.0	<b>5.81</b>	102.5	51.3	102.5	35.2	
42	<b>118.6</b>	59.3	118.6	<b>21.0</b>	10.3	21.0	<b>5.65</b>	99.1	49.6	99.1	35.2	
41	<b>115.3</b>	57.6	115.3	<b>21.0</b>	10.3	21.0	<b>5.50</b>	95.8	47.9	95.8	35.2	
40	<b>112.1</b>	56.0	112.1	<b>20.9</b>	10.3	20.9	<b>5.35</b>	92.6	46.3	92.6	35.1	
39	<b>108.9</b>	54.5	108.9	<b>20.9</b>	10.3	20.9	<b>5.20</b>	89.5	44.7	89.5	35.1	
38	<b>105.9</b>	52.9	105.9	<b>20.9</b>	10.3	20.9	<b>5.06</b>	86.4	43.2	86.4	35.1	
37	<b>102.9</b>	51.4	102.9	<b>20.9</b>	10.3	20.9	<b>4.92</b>	83.5	41.7	83.5	35.1	
36	<b>100.0</b>	50.0	100.0	<b>20.9</b>	10.3	20.9	<b>4.79</b>	80.6	40.3	80.6	35.1	
35	<b>97.1</b>	48.6	97.1	<b>20.9</b>	10.3	20.9	<b>4.65</b>	77.8	38.9	77.8	35.0	
34	<b>94.4</b>	47.2	94.4	<b>20.9</b>	10.3	20.9	<b>4.52</b>	75.0	37.5	75.0	35.0	
33	<b>91.7</b>	45.9	91.7	<b>20.9</b>	10.2	20.9	<b>4.40</b>	72.4	36.2	72.4	35.0	
32	<b>89.1</b>	44.6	89.1	<b>20.8</b>	10.2	20.8	<b>4.28</b>	69.8	34.9	69.8	35.0	
31	<b>86.6</b>	43.3	86.6	<b>20.8</b>	10.2	20.8	<b>4.16</b>	67.3	33.6	67.3	35.0	
30	<b>84.1</b>	42.1	84.1	<b>20.8</b>	10.2	20.8	<b>4.04</b>	64.8	32.4	64.8	35.0	
29	<b>81.7</b>	40.9	81.7	<b>20.8</b>	10.2	20.8	<b>3.93</b>	62.4	31.2	62.4	35.0	
28	<b>79.4</b>	39.7	79.4	<b>20.8</b>	10.2	20.8	<b>3.82</b>	60.1	30.1	60.1	35.0	
27	<b>77.1</b>	38.6	77.1	<b>20.8</b>	10.2	20.8	<b>3.71</b>	57.9	28.9	57.9	34.9	
26	<b>74.9</b>	37.5	74.9	<b>20.8</b>	10.2	20.8	<b>3.60</b>	55.7	27.8	55.7	34.9	
25	<b>72.8</b>	36.4	72.8	<b>20.8</b>	10.2	20.8	<b>3.50</b>	53.5	26.8	53.5	34.9	
24	<b>70.7</b>	35.4	70.7	<b>20.8</b>	10.2	20.8	<b>3.40</b>	51.5	25.7	51.5	34.9	
23	<b>68.7</b>	34.4	68.7	<b>20.8</b>	10.2	20.8	<b>3.31</b>	49.5	24.7	49.5	34.9	
22	<b>66.8</b>	33.4	66.8	<b>20.8</b>	10.2	20.8	<b>3.21</b>	47.5	23.8	47.5	34.9	
21	<b>64.9</b>	32.4	64.9	<b>20.8</b>	10.2	20.8	<b>3.12</b>	45.6	22.8	45.6	34.9	
20	<b>63.1</b>	31.5	63.1	<b>20.8</b>	10.2	20.8	<b>3.03</b>	43.8	21.9	43.8	34.9	
19	<b>61.3</b>	30.6	61.3	<b>20.8</b>	10.2	20.8	<b>2.95</b>	42.0	21.0	42.0	34.9	
18	<b>59.6</b>	29.8	59.6	<b>20.8</b>	10.2	20.8	<b>2.87</b>	40.3	20.1	40.3	34.9	
17	<b>57.9</b>	28.9	57.9	<b>20.8</b>	10.2	20.8	<b>2.78</b>	38.6	19.3	38.6	34.9	
16	<b>56.3</b>	28.1	56.3	<b>20.8</b>	10.2	20.8	<b>2.71</b>	37.0	18.5	37.0	35.0	
15	<b>54.7</b>	27.3	54.7	<b>20.8</b>	10.2	20.8	<b>2.63</b>	35.4	17.7	35.4	35.0	
14	<b>53.2</b>	26.6	53.2	<b>20.8</b>	10.2	20.8	<b>2.55</b>	33.9	16.9	33.9	35.0	
13	<b>51.7</b>	25.8	51.7	<b>20.8</b>	10.2	20.8	<b>2.48</b>	32.4	16.2	32.4	35.0	
12	<b>50.2</b>	25.1	50.2	<b>20.8</b>	10.2	20.8	<b>2.41</b>	30.9	15.5	30.9	35.0	
11	<b>48.8</b>	24.4	48.8	<b>20.8</b>	10.2	20.8	<b>2.35</b>	29.5	14.8	29.5	35.0	
10	<b>47.5</b>	23.7	47.5	<b>20.8</b>	10.2	20.8	<b>2.28</b>	28.2	14.1	28.2	35.0	
9												
8												
7												
6												
5												

-- attention: operating limits not reflected in performance table

**WAMAK TWW 110 WHR HeavyDuty 2L1**

Th -OU	80										
[°C]	Qh nom	Qh min	Qh max	Pin nom	Pin min	Pin max	COP nom	Qc nom	Qc min	Qc max	I nom
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]
45	<b>113.2</b>	56.6	113.2	<b>25.3</b>	12.4	25.3	<b>4.47</b>	89.7	44.9	89.7	41.0
44	<b>110.1</b>	55.1	110.1	<b>25.3</b>	12.4	25.3	<b>4.35</b>	86.6	43.3	86.6	41.0
43	<b>107.1</b>	53.5	107.1	<b>25.3</b>	12.4	25.3	<b>4.23</b>	83.6	41.8	83.6	41.0
42	<b>104.2</b>	52.1	104.2	<b>25.3</b>	12.5	25.3	<b>4.11</b>	80.7	40.3	80.7	41.0
41	<b>101.3</b>	50.7	101.3	<b>25.3</b>	12.5	25.3	<b>4.00</b>	77.8	38.9	77.8	41.0
40	<b>98.5</b>	49.3	98.5	<b>25.4</b>	12.5	25.4	<b>3.89</b>	75.0	37.5	75.0	41.0
39	<b>95.8</b>	47.9	95.8	<b>25.4</b>	12.5	25.4	<b>3.78</b>	72.3	36.2	72.3	41.1
38	<b>93.2</b>	46.6	93.2	<b>25.4</b>	12.5	25.4	<b>3.67</b>	69.7	34.8	69.7	41.1
37	<b>90.6</b>	45.3	90.6	<b>25.4</b>	12.5	25.4	<b>3.57</b>	67.1	33.6	67.1	41.1
36	<b>88.2</b>	44.1	88.2	<b>25.4</b>	12.5	25.4	<b>3.47</b>	64.6	32.3	64.6	41.1
35	<b>85.8</b>	42.9	85.8	<b>25.4</b>	12.5	25.4	<b>3.37</b>	62.2	31.1	62.2	41.1
34	<b>83.4</b>	41.7	83.4	<b>25.4</b>	12.5	25.4	<b>3.28</b>	59.8	29.9	59.8	41.1
33	<b>81.1</b>	40.6	81.1	<b>25.4</b>	12.5	25.4	<b>3.19</b>	57.5	28.8	57.5	41.2
32	<b>78.9</b>	39.5	78.9	<b>25.5</b>	12.5	25.5	<b>3.10</b>	55.3	27.7	55.3	41.2
31	<b>76.8</b>	38.4	76.8	<b>25.5</b>	12.5	25.5	<b>3.01</b>	53.2	26.6	53.2	41.2
30	<b>74.7</b>	37.4	74.7	<b>25.5</b>	12.5	25.5	<b>2.93</b>	51.1	25.5	51.1	41.2
29	<b>72.7</b>	36.4	72.7	<b>25.5</b>	12.5	25.5	<b>2.85</b>	49.0	24.5	49.0	41.2
28	<b>70.8</b>	35.4	70.8	<b>25.5</b>	12.6	25.5	<b>2.77</b>	47.1	23.5	47.1	41.3
27	<b>68.9</b>	34.4	68.9	<b>25.6</b>	12.6	25.6	<b>2.69</b>	45.2	22.6	45.2	41.3
26	<b>67.0</b>	33.5	67.0	<b>25.6</b>	12.6	25.6	<b>2.62</b>	43.3	21.7	43.3	41.3
25	<b>65.2</b>	32.6	65.2	<b>25.6</b>	12.6	25.6	<b>2.55</b>	41.5	20.8	41.5	41.3
24	<b>63.5</b>	31.8	63.5	<b>25.6</b>	12.6	25.6	<b>2.48</b>	39.8	19.9	39.8	41.4
23	<b>61.9</b>	30.9	61.9	<b>25.6</b>	12.6	25.6	<b>2.41</b>	38.1	19.0	38.1	41.4
22	<b>60.2</b>	30.1	60.2	<b>25.7</b>	12.6	25.7	<b>2.35</b>	36.4	18.2	36.4	41.4
21	<b>58.7</b>	29.3	58.7	<b>25.7</b>	12.6	25.7	<b>2.28</b>	34.8	17.4	34.8	41.5
20	<b>57.2</b>	28.6	57.2	<b>25.7</b>	12.6	25.7	<b>2.22</b>	33.3	16.6	33.3	41.5
19											
18											
17											
16											
15											
14											
13											
12											
11											
10											
9											
8											
7											
6											
5											

-- attention: operating limits not reflected in performance table

# WAMAK TWW 110 WHR HeavyDuty 2L1

Tc -OU		W 12 / 7 °C										
[°C]	Qc nom	Qc min	Qc max	Pin nom	Pin min	Pin max	EER	Qh nom	Qh min	Qh max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
40	<b>27.6</b>	13.8	27.6	<b>13.3</b>	6.5	13.3	<b>2.08</b>	39.9	20.0	39.9	25.7	
39	<b>28.1</b>	14.0	28.1	<b>13.0</b>	6.4	13.0	<b>2.16</b>	40.1	20.1	40.1	25.4	
38	<b>28.6</b>	14.3	28.6	<b>12.7</b>	6.3	12.7	<b>2.24</b>	40.4	20.2	40.4	25.1	
37	<b>29.0</b>	14.5	29.0	<b>12.5</b>	6.1	12.5	<b>2.32</b>	40.6	20.3	40.6	24.9	
36	<b>29.5</b>	14.7	29.5	<b>12.2</b>	6.0	12.2	<b>2.41</b>	40.8	20.4	40.8	24.6	
35	<b>29.9</b>	15.0	29.9	<b>12.0</b>	5.9	12.0	<b>2.49</b>	41.1	20.5	41.1	24.3	
34	<b>30.4</b>	15.2	30.4	<b>11.8</b>	5.8	11.8	<b>2.58</b>	41.3	20.7	41.3	24.1	
33	<b>30.8</b>	15.4	30.8	<b>11.5</b>	5.7	11.5	<b>2.67</b>	41.6	20.8	41.6	23.8	
32	<b>31.3</b>	15.6	31.3	<b>11.3</b>	5.6	11.3	<b>2.76</b>	41.8	20.9	41.8	23.6	
31	<b>31.7</b>	15.9	31.7	<b>11.1</b>	5.5	11.1	<b>2.86</b>	42.0	21.0	42.0	23.4	
30	<b>32.2</b>	16.1	32.2	<b>10.9</b>	5.4	10.9	<b>2.95</b>	42.3	21.1	42.3	23.2	
29	<b>32.6</b>	16.3	32.6	<b>10.7</b>	5.3	10.7	<b>3.05</b>	42.5	21.3	42.5	23.0	
28	<b>33.0</b>	16.5	33.0	<b>10.5</b>	5.2	10.5	<b>3.15</b>	42.8	21.4	42.8	22.8	
27	<b>33.4</b>	16.7	33.4	<b>10.3</b>	5.1	10.3	<b>3.25</b>	43.0	21.5	43.0	22.6	
26	<b>33.9</b>	16.9	33.9	<b>10.1</b>	5.0	10.1	<b>3.35</b>	43.2	21.6	43.2	22.4	
25	<b>34.3</b>	17.1	34.3	<b>9.9</b>	4.9	9.9	<b>3.45</b>	43.5	21.7	43.5	22.2	
24	<b>34.7</b>	17.3	34.7	<b>9.8</b>	4.8	9.8	<b>3.56</b>	43.7	21.9	43.7	22.0	
23	<b>35.1</b>	17.5	35.1	<b>9.6</b>	4.7	9.6	<b>3.66</b>	44.0	22.0	44.0	21.9	
22	<b>35.5</b>	17.7	35.5	<b>9.4</b>	4.6	9.4	<b>3.77</b>	44.2	22.1	44.2	21.7	
21	<b>35.9</b>	17.9	35.9	<b>9.2</b>	4.5	9.2	<b>3.88</b>	44.4	22.2	44.4	21.6	
20	<b>36.3</b>	18.1	36.3	<b>9.1</b>	4.5	9.1	<b>4.00</b>	44.7	22.3	44.7	21.4	

Tc [°C]		W 23 / 18 °C										
0	Qc nom	Qc min	Qc max	Pin nom	Pin min	Pin max	EER	Qh nom	Qh min	Qh max	I nom	
[°C]	[kW]	[kW]	[kW]	[kW]	[kW]	[kW]	kW / kW	[kW]	[kW]	[kW]	[A]	
40	<b>42.9</b>	21.4	42.9	<b>13.3</b>	6.5	13.3	<b>3.23</b>	55.3	27.6	51.4	25.9	
39	<b>43.5</b>	21.7	43.5	<b>13.0</b>	6.4	13.0	<b>3.34</b>	55.7	27.8	51.8	25.6	
38	<b>44.1</b>	22.1	44.1	<b>12.7</b>	6.3	12.7	<b>3.46</b>	56.1	28.0	52.2	25.3	
37	<b>44.7</b>	22.4	44.7	<b>12.5</b>	6.1	12.5	<b>3.58</b>	56.5	28.2	52.6	25.0	
36	<b>45.4</b>	22.7	45.4	<b>12.2</b>	6.0	12.2	<b>3.70</b>	56.9	28.4	53.0	24.8	
35	<b>46.0</b>	23.0	46.0	<b>12.0</b>	5.9	12.0	<b>3.83</b>	57.3	28.6	53.3	24.5	
34	<b>46.6</b>	23.3	46.6	<b>11.8</b>	5.8	11.8	<b>3.95</b>	57.6	28.8	53.7	24.3	
33	<b>47.2</b>	23.6	47.2	<b>11.5</b>	5.7	11.5	<b>4.08</b>	58.0	29.0	54.1	24.0	
32	<b>47.7</b>	23.9	47.7	<b>11.3</b>	5.6	11.3	<b>4.22</b>	58.4	29.2	54.5	23.8	
31	<b>48.3</b>	24.2	48.3	<b>11.1</b>	5.5	11.1	<b>4.35</b>	58.8	29.4	54.9	23.6	
30	<b>48.9</b>	24.5	48.9	<b>10.9</b>	5.4	10.9	<b>4.49</b>	59.2	29.6	55.3	23.4	
29	<b>49.5</b>	24.7	49.5	<b>10.7</b>	5.3	10.7	<b>4.63</b>	59.6	29.8	55.7	23.2	
28	<b>50.0</b>	25.0	50.0	<b>10.5</b>	5.2	10.5	<b>4.77</b>	60.0	30.0	56.1	23.0	
27	<b>50.6</b>	25.3	50.6	<b>10.3</b>	5.1	10.3	<b>4.91</b>	60.3	30.2	56.5	22.8	
26	<b>51.2</b>	25.6	51.2	<b>10.1</b>	5.0	10.1	<b>5.06</b>	60.7	30.4	56.9	22.6	
25	<b>51.7</b>	25.9	51.7	<b>9.9</b>	4.9	9.9	<b>5.21</b>	61.1	30.5	57.3	22.4	
24	<b>52.2</b>	26.1	52.2	<b>9.8</b>	4.8	9.8	<b>5.36</b>	61.5	30.7	57.6	22.2	
23	<b>52.8</b>	26.4	52.8	<b>9.6</b>	4.7	9.6	<b>5.51</b>	61.8	30.9	58.0	22.0	
22	<b>53.3</b>	26.7	53.3	<b>9.4</b>	4.6	9.4	<b>5.67</b>	62.2	31.1	58.4	21.9	
21	<b>53.8</b>	26.9	53.8	<b>9.2</b>	4.5	9.2	<b>5.83</b>	62.6	31.3	58.8	21.7	
20	<b>54.3</b>	27.2	54.3	<b>9.1</b>	4.5	9.1	<b>5.99</b>	62.9	31.5	59.2	21.6	


-- attention: operating limits not reflected in performance table




LEGEND:





Ts-IN: Temperature renewable source - inlet [°C]  
Th-OU: Temperature heating - outlet (flow) [°C]  
Tc-OU: Temperature cooling - outlet (flow) [°C]  
Qh nom: Heating capacity nominal  
Qh min: Heating capacity minimal  
Qh max: Heating capacity maximal  
Pin nom: Power input at nominal heating capacity  
Pin min: Power input at minimal heating capacity  
Pin max: Power input at maximal heating capacity  
COP nom: coefficient of performance at nominal heating capacity  
Qc nom: cooling / heat extraction capacity at nominal heating capacity  
Qc min: cooling / heat extraction at minimal heating capacity  
Qc max: cooling / heat extraction at maximal heating capacity  
I nom: Current at nominal heating capacity  
EER: energy efficiency ratio at nominal cooling capacity



## Operating limits


Temp °C

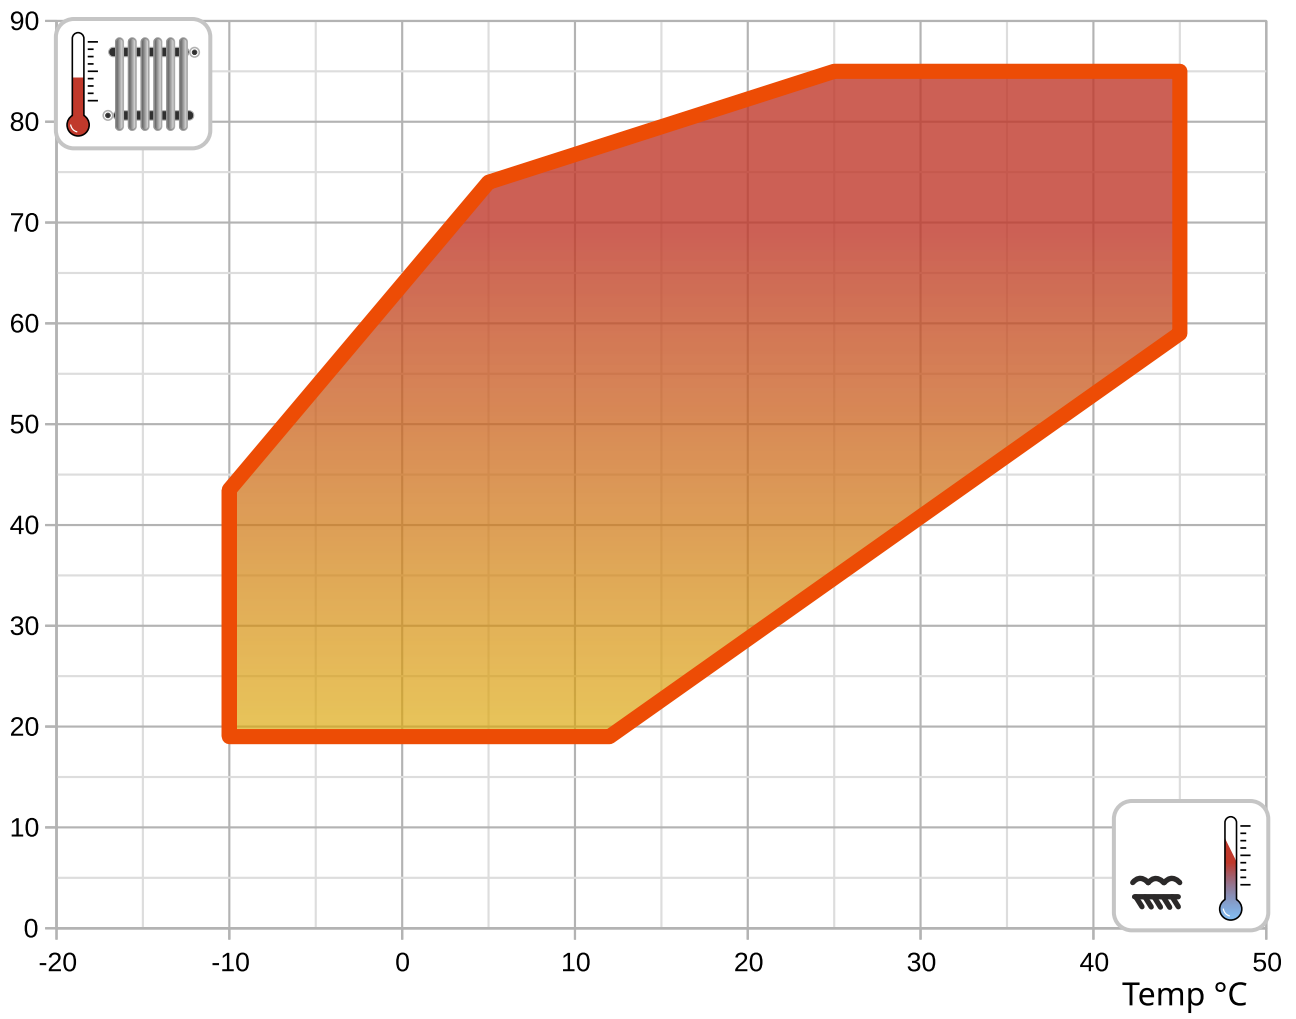

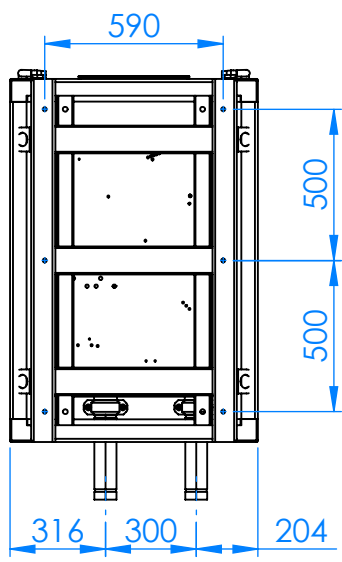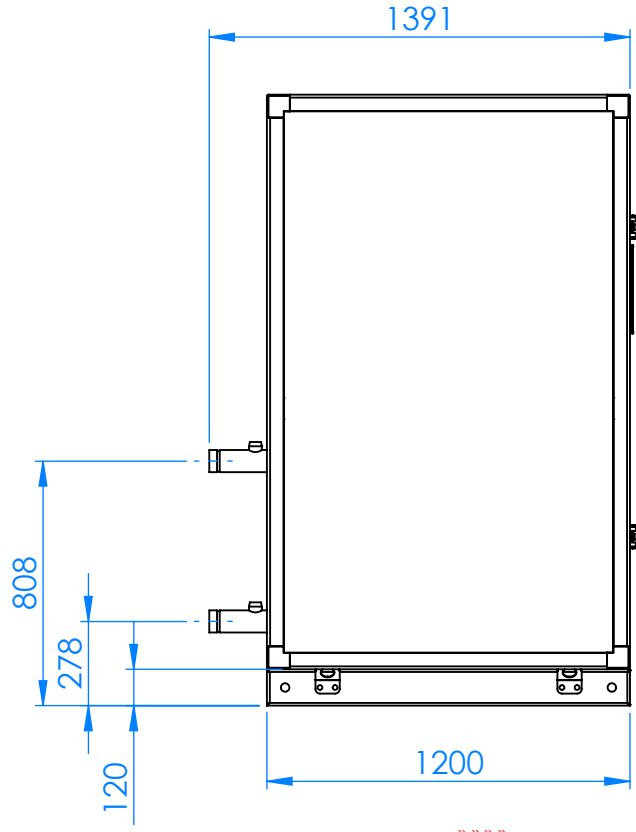
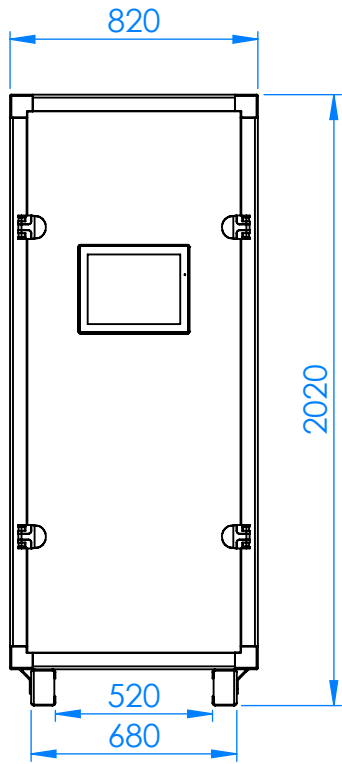



- A - 
- B - 
- D - 
- E - 

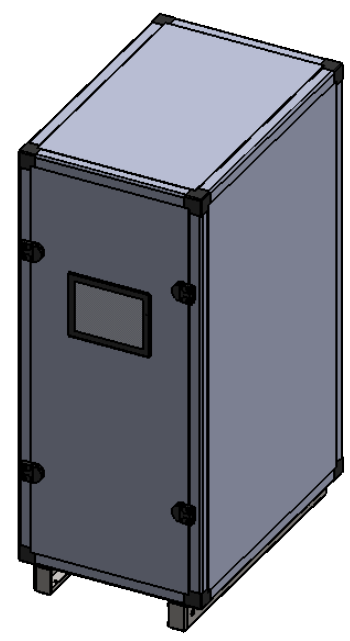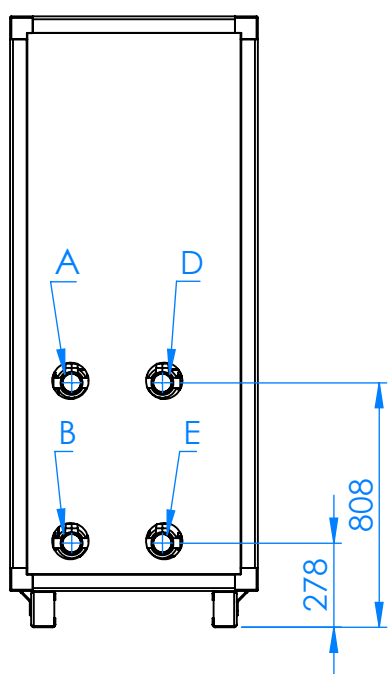

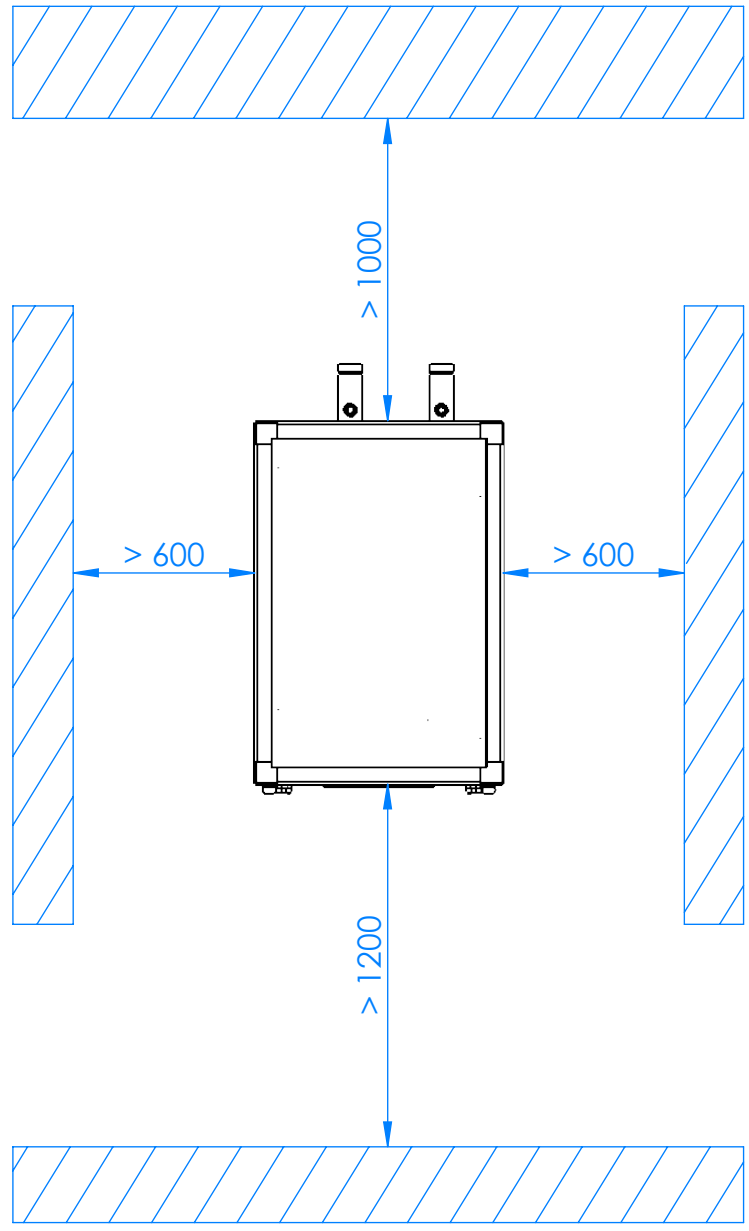

WAMAK TWW 110 WHR HeavyDuty 2L1

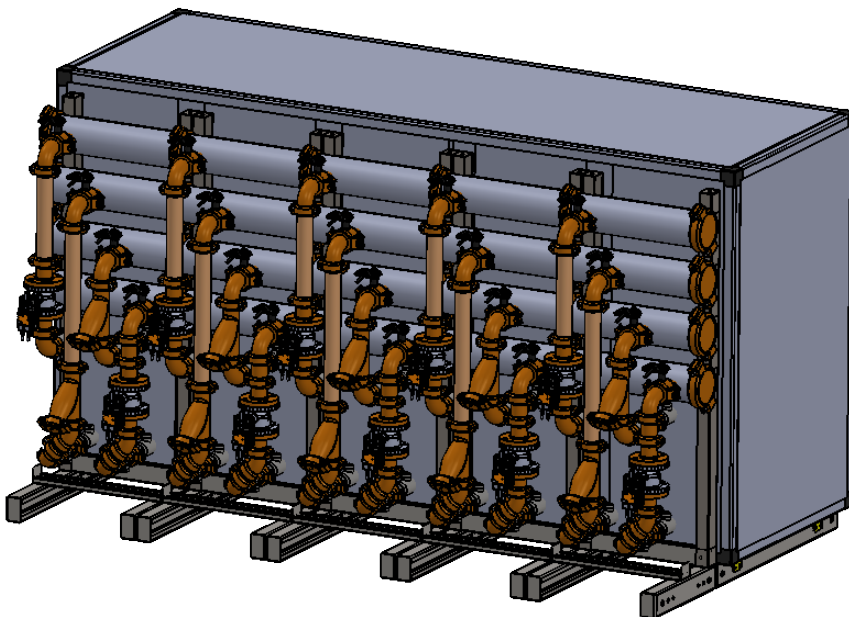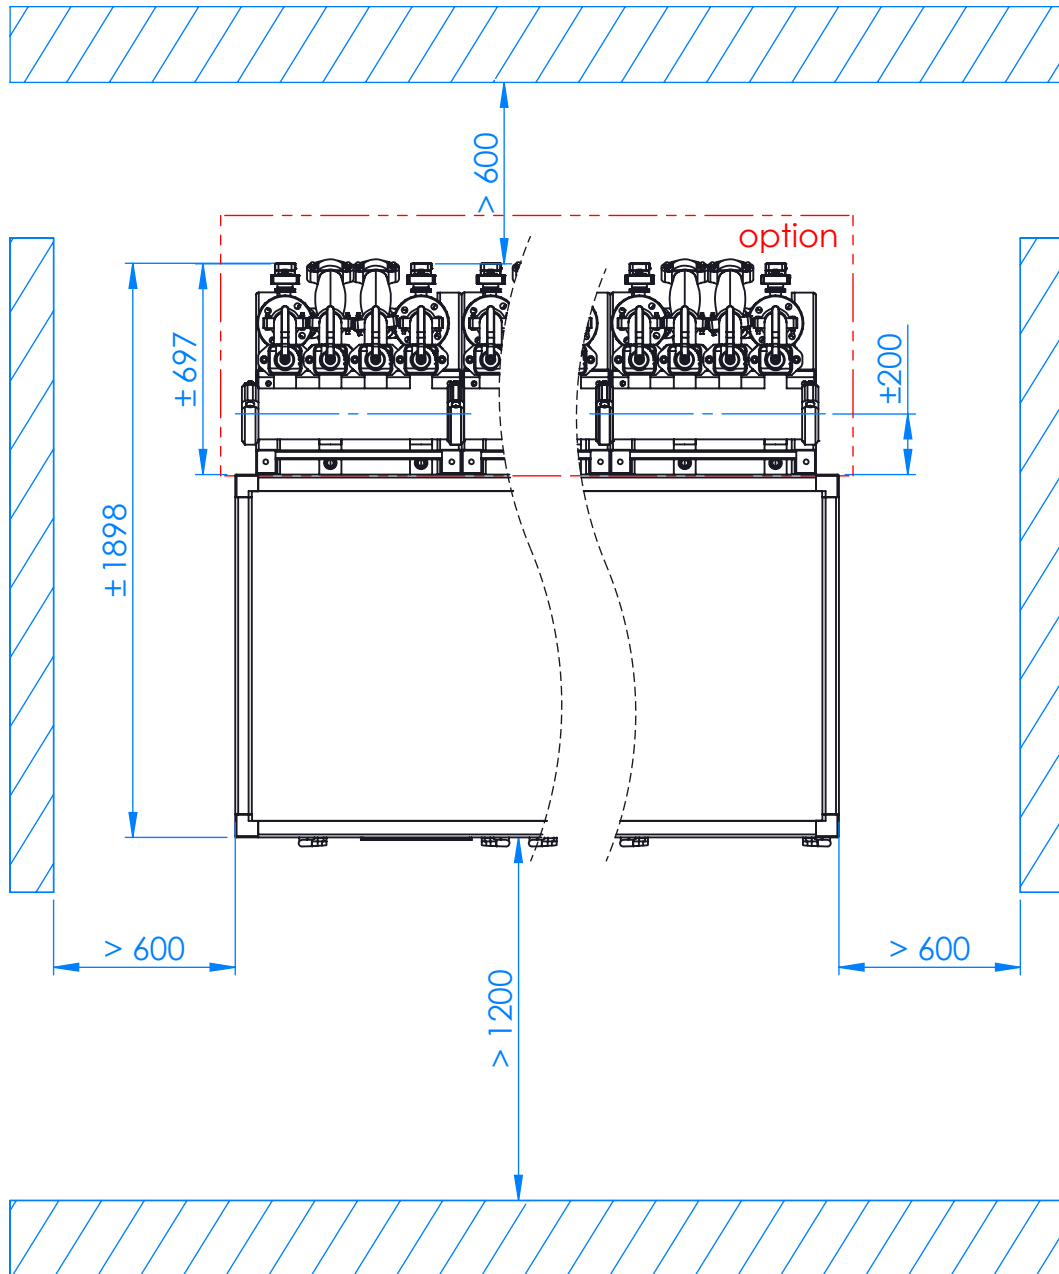

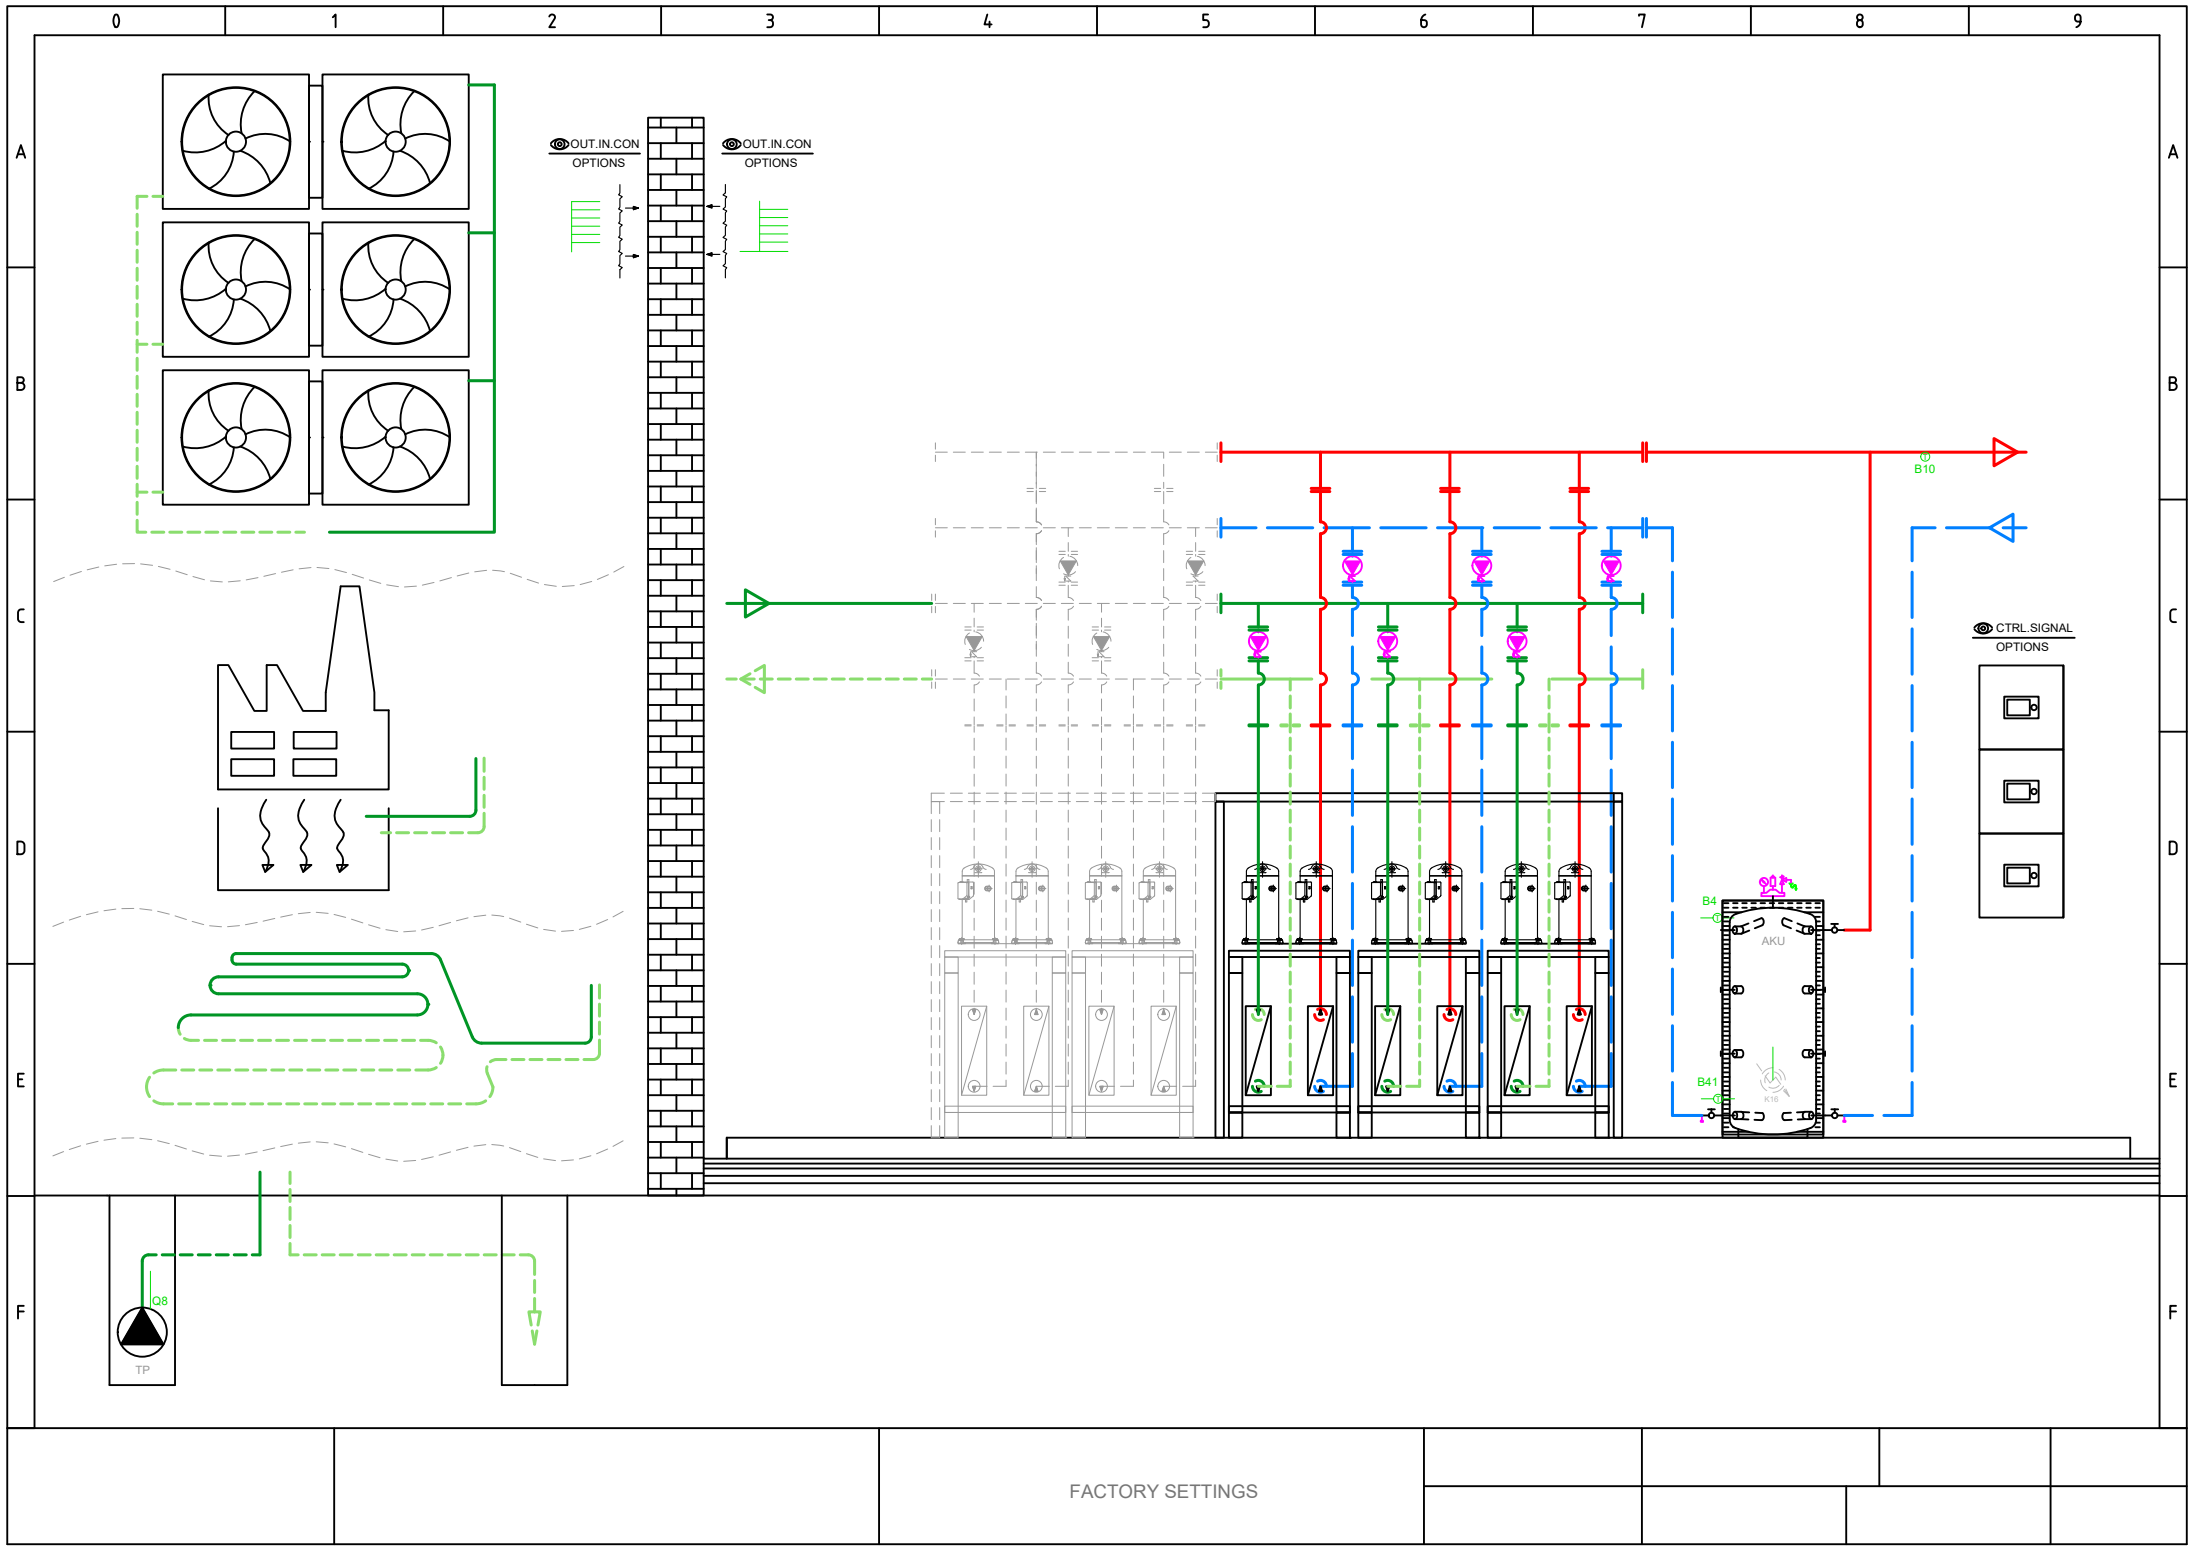

Total: max 6A  
1 x QX...: max 2A

Main power supply 230V / 50 Hz  
Ground  
Neutral conductor

- E9 Low-pressure switch E9
- E10 High-pressure switch E10
- E15 Flow switch source E15
- E24 Flow switch consumers E24
- E6 Electrical utility lock E6
- E12 Overload compressor 2 E12
- E21 Mains supervision E21
- E22 Mains supervision E22
- E23 Mains supervision E23
- E11 Overload compressor 1 E11
- K1 Compressor stage 1 K1

Q8 Source pump Q8

Q9 Condenser pump Q9


K10 Alarm output K10

K40 Crankcase heater K40

K81 Valve evaporator K81

K82 Valve EVI K82


K2 Compressor stage 2 K2

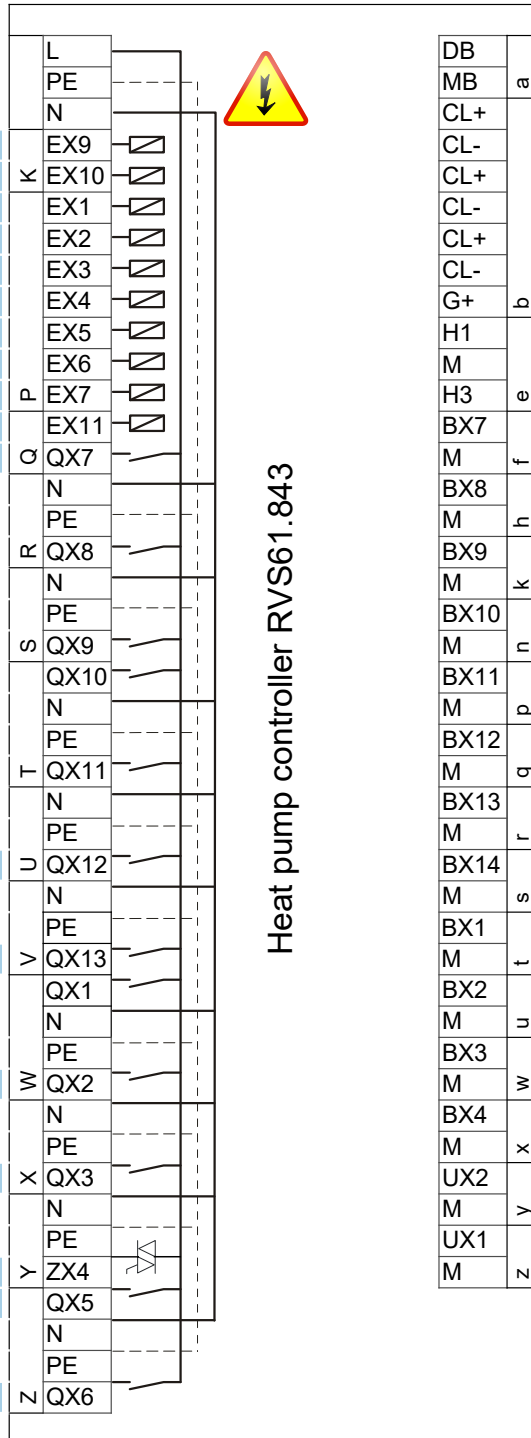

- DB LPB Bus data
- MB LPB Bus GND
- CL+ Room unit QAA...
- CL- Room unit QAA...
- CL+ Room unit QAA... 2.
- CL- Room unit QAA... 2.
- CL+ Room unit QAA... 3.
- CL- Room unit QAA... 3.
- G+ 12V supply → OUT
- H1
- M
- H3 Consumer request VK1
- BX7 B81 Hot-gas sensor K1 B81
- M
- BX8
- M
- BX9
- M
- BX10 B21 HP flow sensor B21
- M
- BX11
- M
- BX12 B71 HP return sensor B71
- M
- BX13 B91 Source inlet sensor B91
- M
- BX14 B84 Source outl sens B92/B84
- M
- BX1
- M
- BX2
- M
- BX3 B83 Refrig sensor liquid B83
- M
- BX4 B82 Hot-gas sensor K2 B82
- M
- UX2 Condenser pump Q9
- M
- UX1 0..10 V Signal
- M
- Z 0..10 V Signal






- AVS75.390
- AVS75.391
- AVS75.370

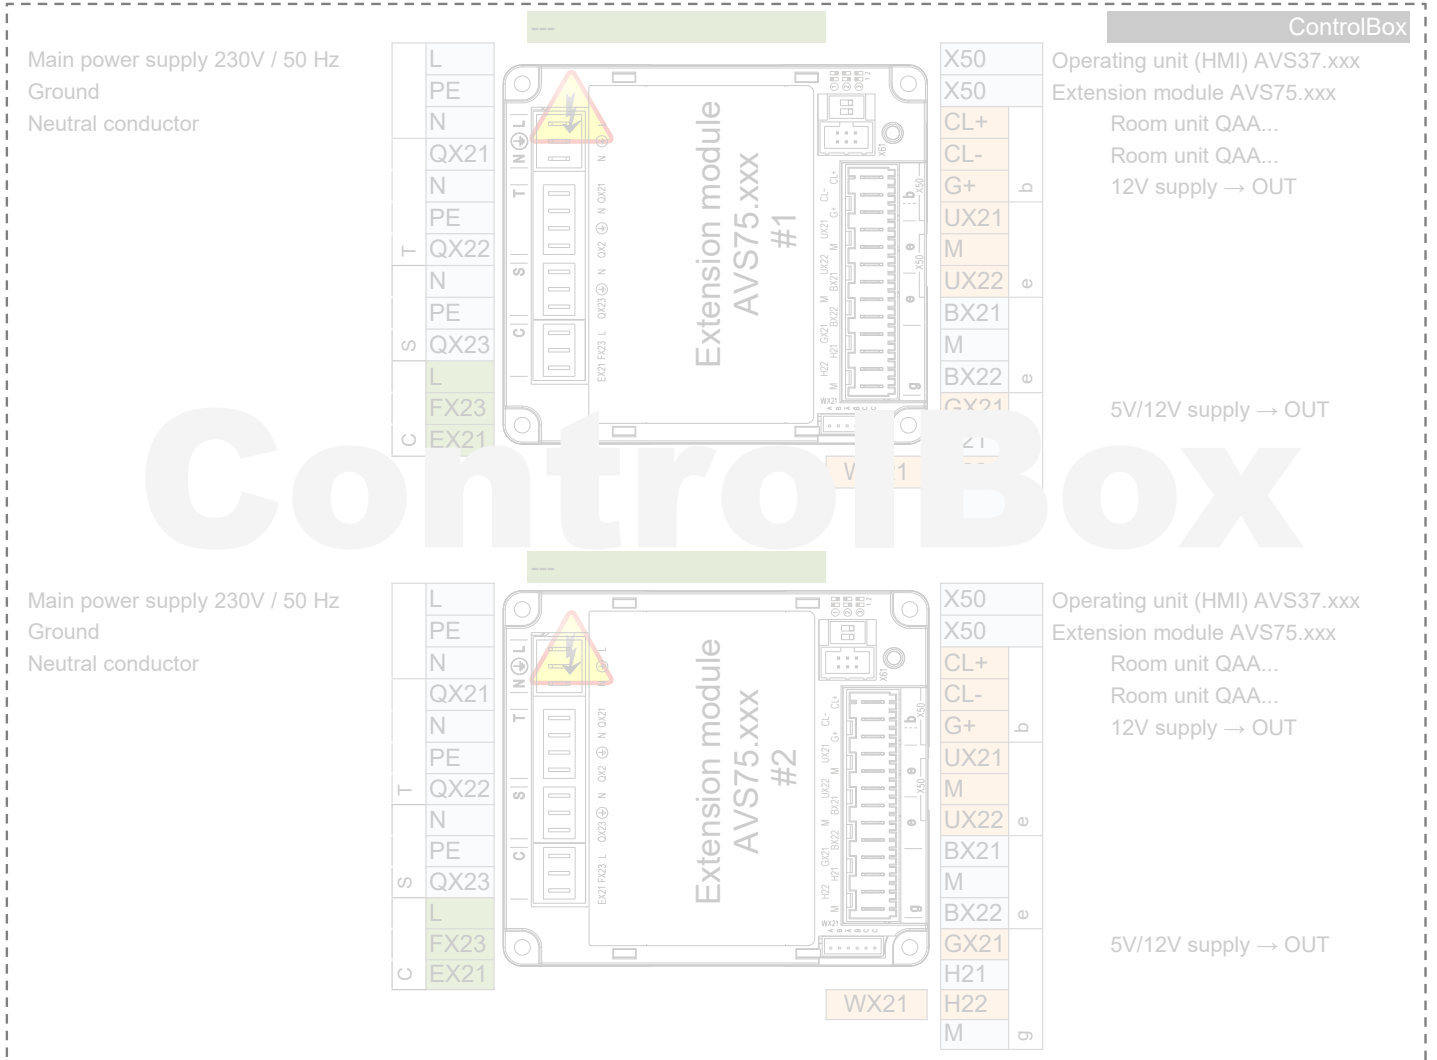

HEAT PUMP

EXTERNAL  
INTERNAL



K1

K2

K82

K81

K40

K10

Q8 UX1

Q9 UX2

E11  
KRW1  
F1K  
E11


E12  
KRW2  
F2K  
E12

E6

E24  
Q9 ERR  
F1S  
E24

E15  
Q8.ERR  
F1Z  
E15

E10  
E9





230V,50Hz  
max 6A

0...10V


230V,50Hz  
max 6A

0...10V

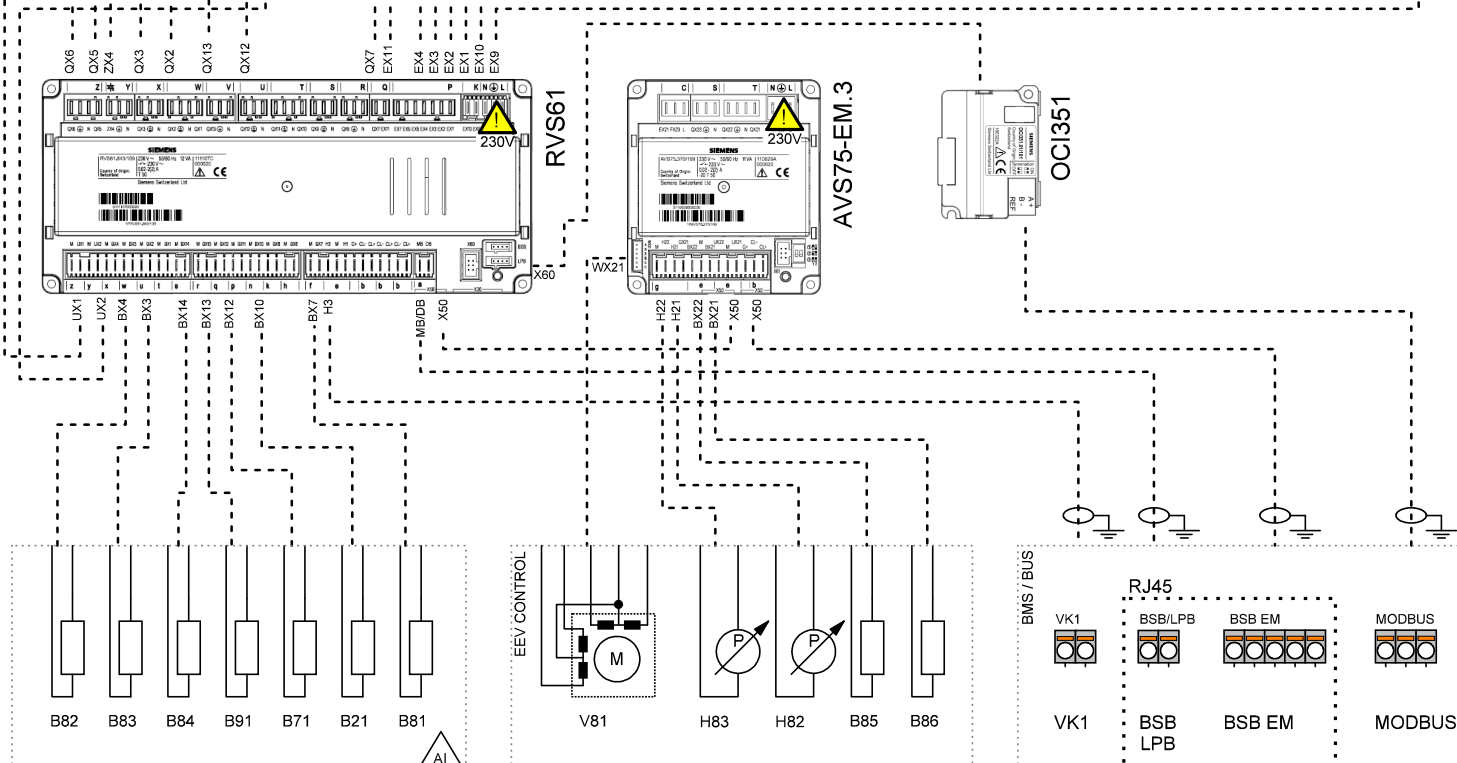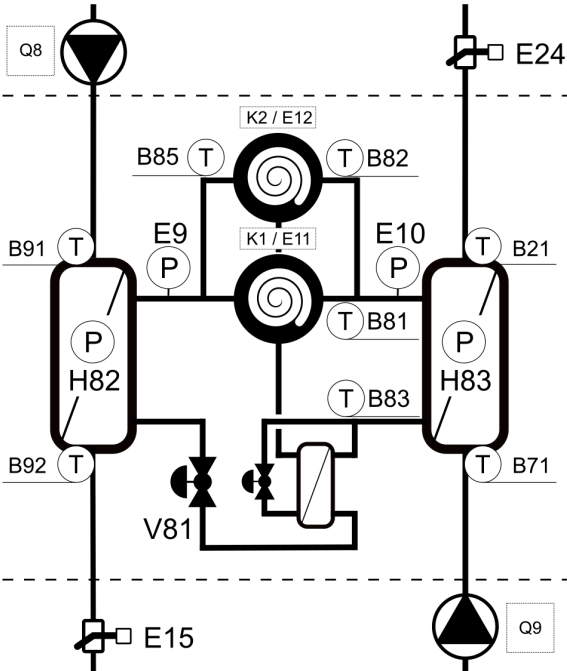

PWR SPLY: ..... 3~ 400V, 50 Hz  
CTRL: ..... 1~ 230V, 50 HZ

Company	Title	Version / Note	Number	Created by	Date	Page
	TBW-TWW	05/2024				1

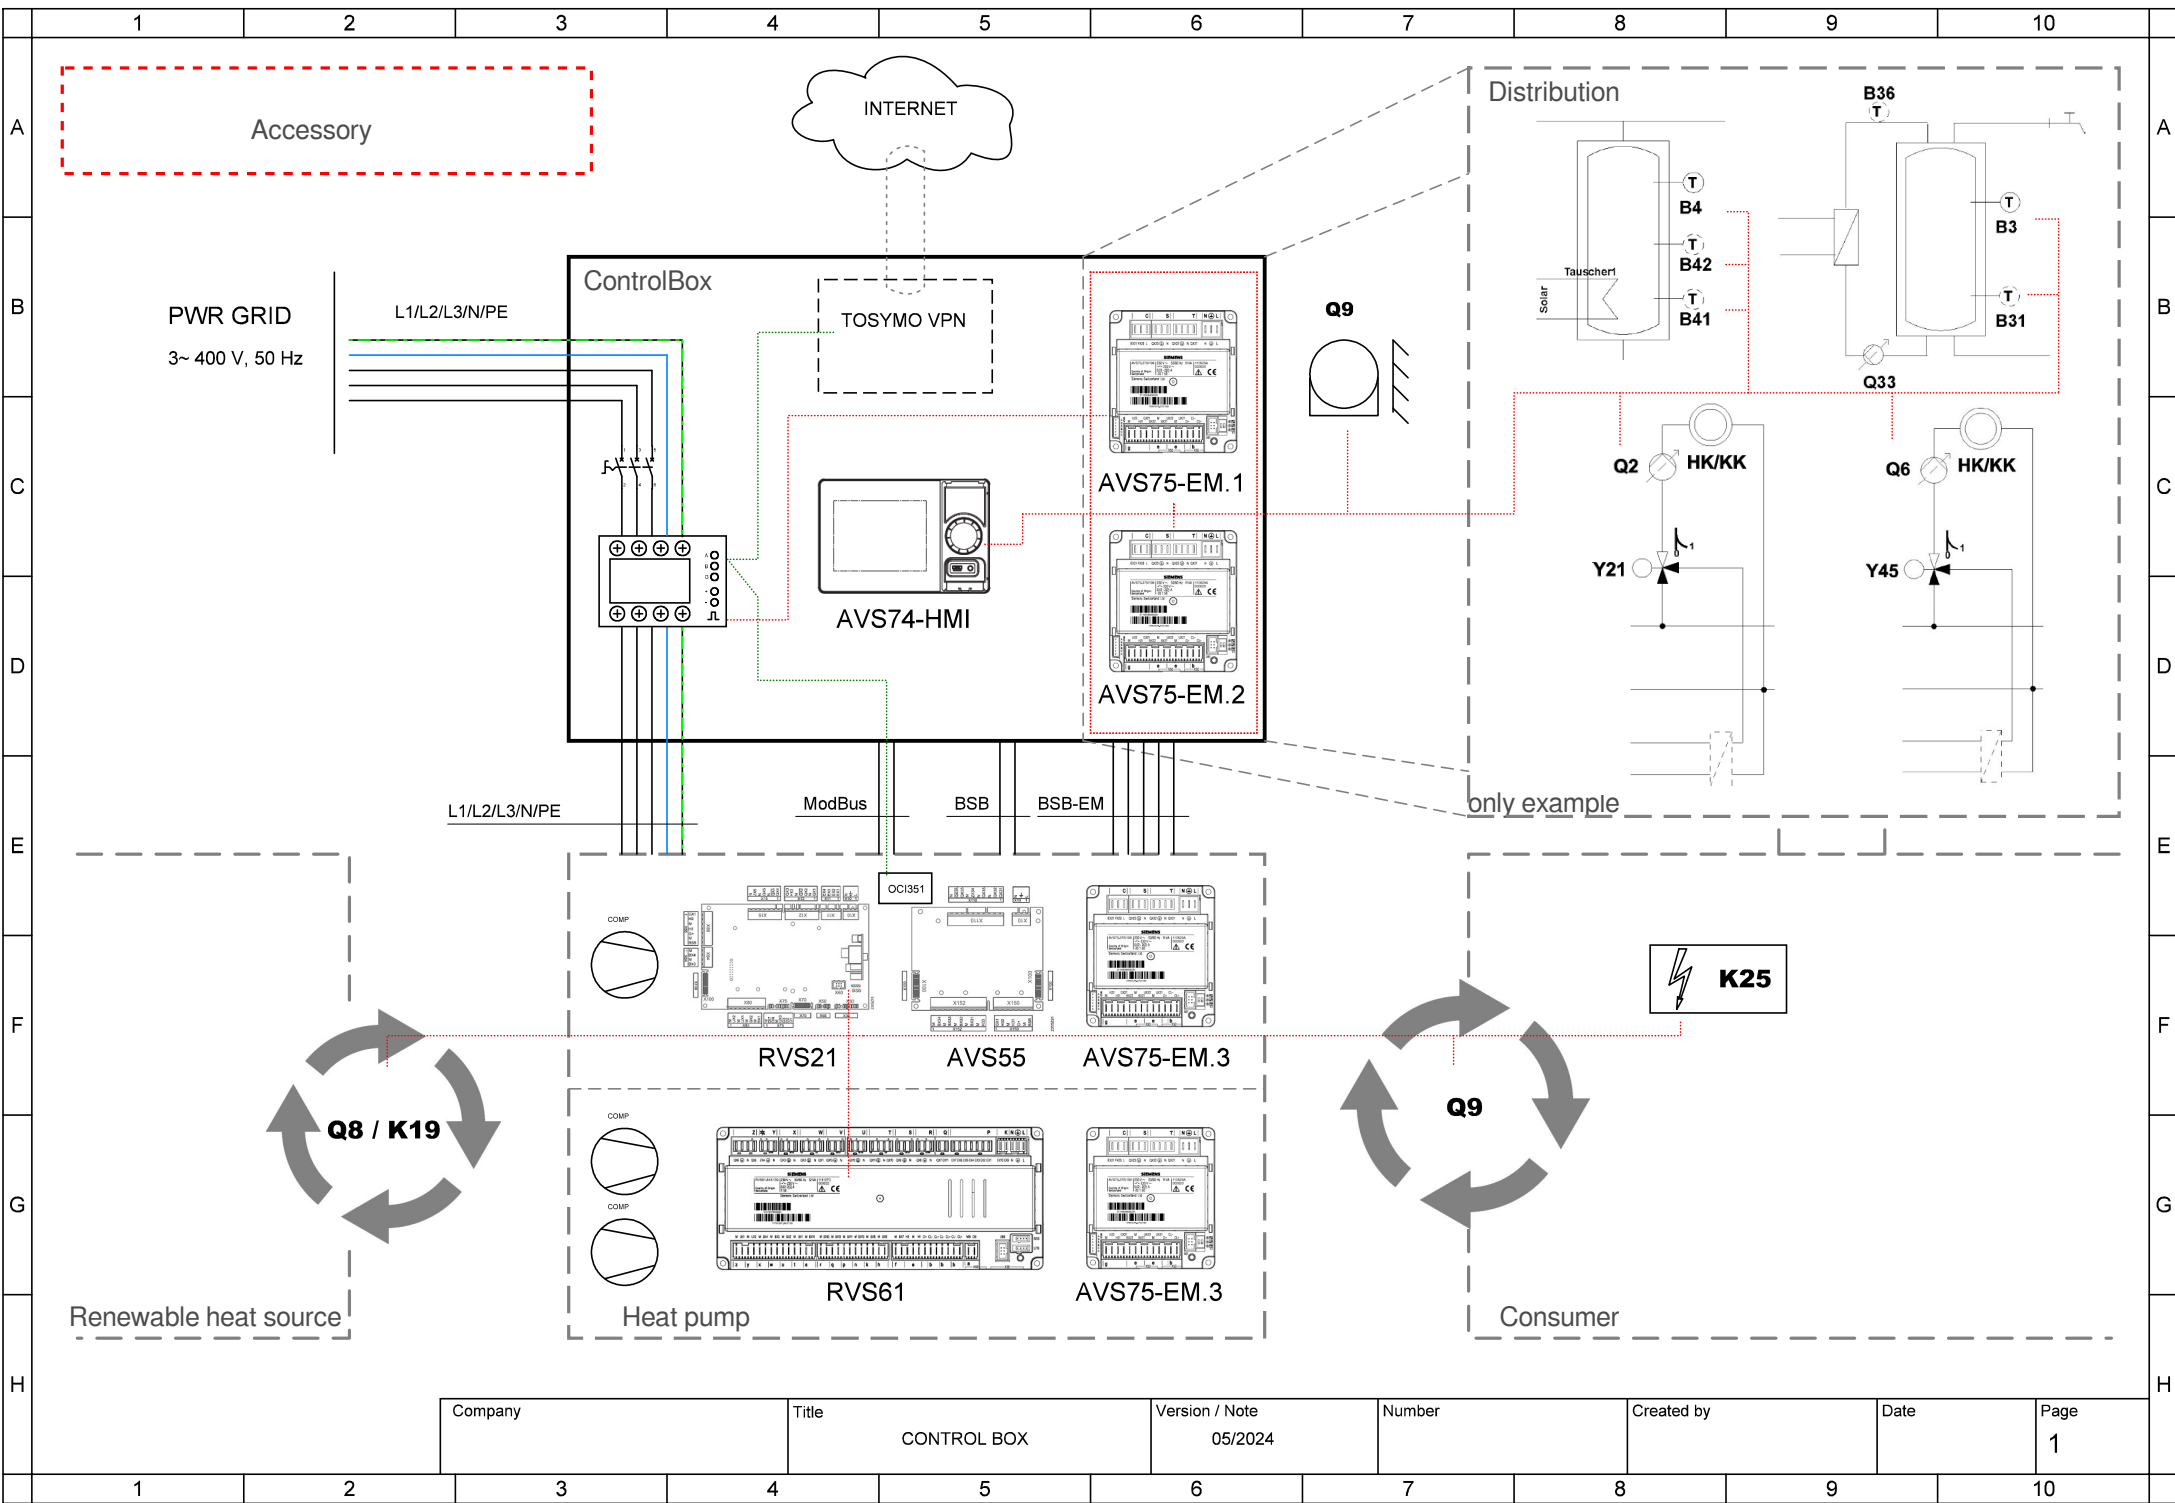

Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				1



Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				2




Company	Title	Version / Note	Number	Created by	Date	Page
	CONTROL BOX	05/2024				3




- AVS75.390
- AVS75.391
- AVS75.370

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Y1** Mixing valve Open  
  
**Y2** Mixing valve Close  
  
**Q2** Heat circuit pump HC1 Q2  
  
**L** Phase 230V  
**E61** Smart grid E61

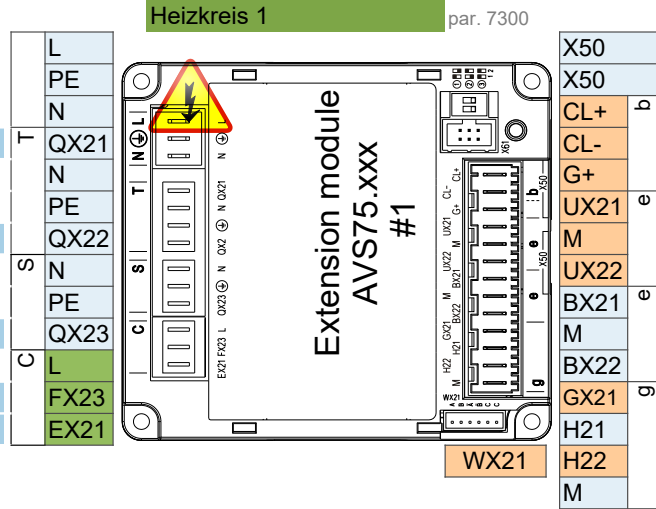


- Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B1** Flow sensor 1  
  
 Pulse count

- AVS75.370**  
 Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor  
**Q3** DHW ctrl elem Q3  
  
**K6** El imm heater DHW K6  
  
**Q6** Heat circuit pump HC2 Q6  
  
**L** Phase 230V  
**E62** Smart grid E62

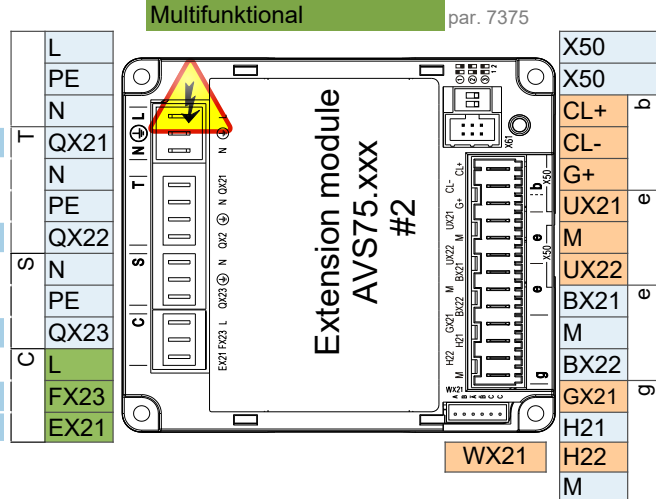

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...  
  
**B3** DHW sensor B3  
  
**B4** Buffer sensor B4

- Main power supply 230V / 50 Hz  
 Ground  
 Neutral conductor

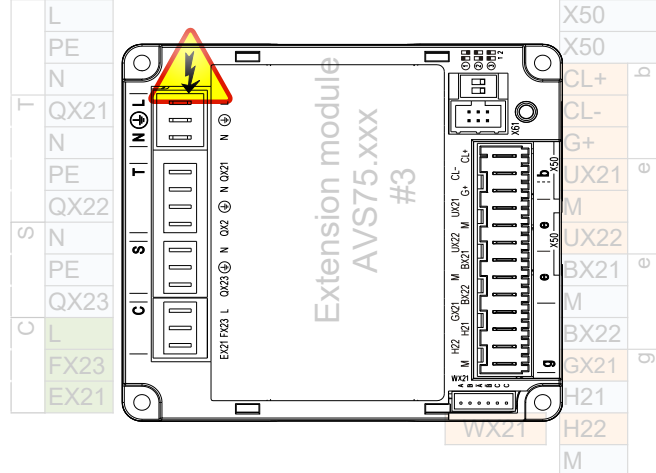

- Operating unit (HMI) AVS37.xxx  
 Extension module AVS75.xxx  
 Room unit QAA...  
 Room unit QAA...

Attention: Extension module 3 is inside the heat pump

## Control connection options

### 1 ControlBox

---

ControlBox, with two built-in extension modules, enables numerous options for application control on the consumer side behind the heat pump. For more, see the ControlBox schematic and the application diagrams sheet.

### 2 Fix flow temperature setpoint - On / Off dry (potential free) contact

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint = 45°C (editable by param. 1859)

Connection terminal - see wiring diagram

### 3 Analog 0..10V flow temperature setpoint control

---

2 wire shielded cable 2 x 0.5 mm<sup>2</sup> - Setpoint: 0V = 16°C ~ 10V = 60°C ( editable in parameter set )

Connection terminal - see wiring diagram

### 4 ModBus RTU communication command

---

3 wire shielded cable min. 3 x 0.25mm<sup>2</sup>

For ModBus mapping table contact technical support

### 5 MQTT IoT communication protocol

---

For more information contact technical support